


NOTES:

1. MINIMUM CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS 3000 PSI (20 MPa).
2. REINFORCING STEEL SHALL BE HARD GRADE DEFORMED BARS CONFORMING TO CSA G30.12 GRADE 400.
3. WALL REINFORCING SHALL BE IN ACCORDANCE WITH NUDURA INTEGRATED BUILDING SYSTEM, LOCAL CODE OR ENGINEERING DRAWINGS.
4. BRICK UNIT WEIGHT: 40LBS/FT (1.9 KPa) IN VERTICAL PLANE.
5. MAXIMUM BRICK VENEER TO BE: 27' (8.23m) UNLESS ENGINEERED OTHERWISE
6. ASSUME BRICK LAYING IN ACCORDANCE WITH APPLICABLE CODES.



DISCLAIMER NOTICE:
 SPECIFIC INFORMATION
 REQUIRED FOR COMPLIANCE
 WITH LOCAL CODES IS THE
 RESPONSIBILITY OF THE
 DESIGNER

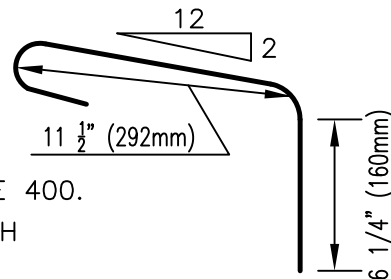

NUDURA 8" (203mm) BRICK LEDGE REINFORCEMENT DETAIL OWSJ FLOOR CONNECTION AT GRADE BRICK VENEER FINISH VERTICAL SECTION VIEW	
REV. NO. 003 TV	DWG NO. A8B02
DATE: APR 2007	
DRAWN BY: J. NEILON	SCALE: 1 : 8