


TRADITIONAL FIRE  
SEPARATION STC 50  
2 OR 4 HOUR FIREWALL



NUDURA 8" (203mm)  
STANDARD FORM UNIT

PROVIDE TEMPORARY FORMING  
AT CONCRETE CHECK

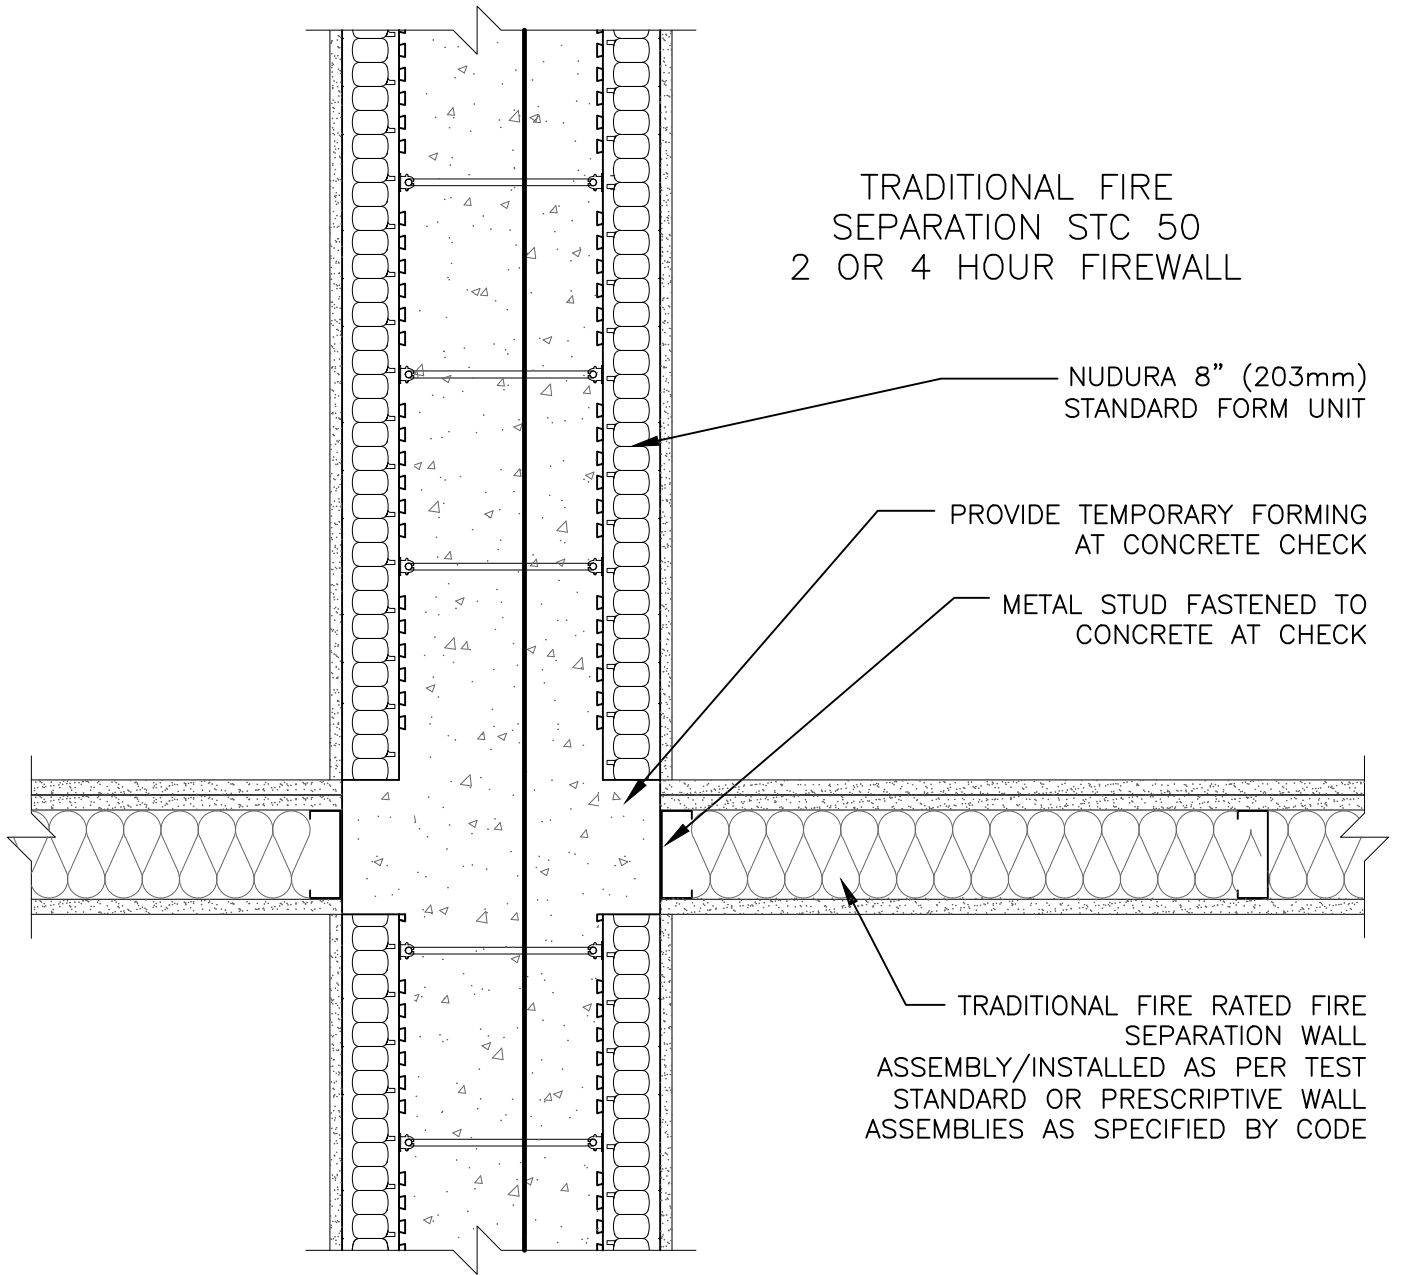

METAL STUD FASTENED TO  
CONCRETE AT CHECK

TRADITIONAL FIRE RATED FIRE  
SEPARATION WALL  
ASSEMBLY/INSTALLED AS PER TEST  
STANDARD OR PRESCRIPTIVE WALL  
ASSEMBLIES AS SPECIFIED BY CODE

**DISCLAIMER NOTICE:**  
SPECIFIC INFORMATION  
REQUIRED FOR COMPLIANCE  
WITH LOCAL CODES IS THE  
RESPONSIBILITY OF THE  
DESIGNER

*The architecture, engineering, and design of the project using the Nudura products are the responsibility of the project's design professional. All products and systems must comply with local building codes and standards. This detail is for general information and guidance only and Nudura specifically disclaims any liability for the use of this detail. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project. This detail is subject to change without notice. Contact Nudura to ensure you have the most recent version.*

**Fire Wall**

|  |  |              |                     |  |
|--|--|--------------|---------------------|--|
| <br>Nudura Technical Support: 866-468-6299<br>International: +1 705-726-9499 | Detail: Nudura 8" (203mm) Form Unit STC / Fire Wall Details<br>Traditional Fire Separation Plan View At 2 Or 4 Hour Firewall |              | File Name:<br>FW8D6 | <br>Construction Products Group |
|  | Drawn by: K.S  | Scale: 1 : 8 | Date: 12/1/2021     |  |