

NUDURA 10" (254mm)
STANDARD FORM UNIT

FASTEN MESH TO BUCK
PRIOR TO PLACING BUCK AT
HEAD CONDITION

DECORATIVE EPS FOAM
TRIM (HEAD AND SILL)
APPLIED TO NUDURA
FORM USING EPS
COMPATIBLE ADHESIVE

WINDOW FRAME,
BY OTHERS


FOR MULTI-STOREY
APPLICATIONS, MESH TO
LAP BACK AROUND
BUCK TO LINK w/
CONCRETE

FOAM BACKER ROD
AND CONTINUOUS
CAULKING AROUND
FRAME

2x2" (38x38mm)
ROUGH NAILER

OPENING REINFORCEMENT
AS PER CODE OR AS
SPECIFIED

DRYVIT TEXTURED
ACRYLIC FINISH OR
FUNCTIONAL EQUIVALENT

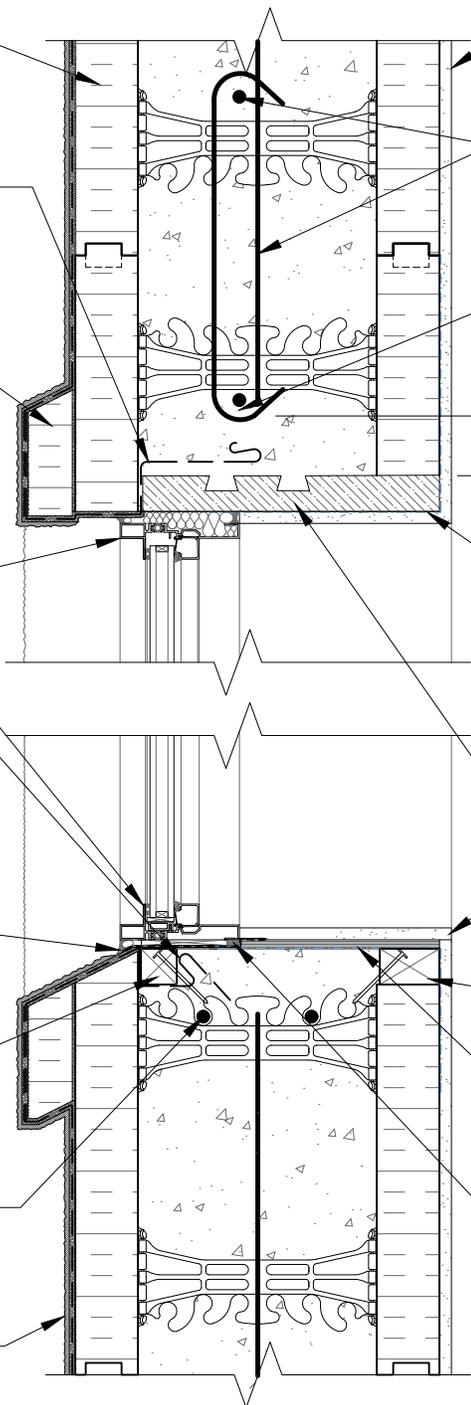

MIN 1/2" (13mm) GYPSUM BOARD

HORIZ/VERT REINFORCEMENT
AS PER CODE OR AS SPECIFIED
(SEE NOTE 1)

LINTEL REINFORCEMENT AS
PER CODE OR AS SPECIFIED

1 1/2"
(38mm) MIN.
COVER

EXOAIR 110AT, DYMONIC 100 OR
FUNCTIONAL EQUIVALENT 3" MIN.
ON INTERIOR SIDE OF EPS c/w
FOAM ROD/CAULK OR SEAL TO
INTERIOR EDGE OF FRAME

ENGINEERED FRAMING SYSTEM BY
PREBUCK LLC OR FUNCTIONAL
EQUIVALENT

GYPSUM BOARD RETURN TO FRAME

2x3" (38x64mm) ROUGH NAILER

EXOAIR 110AT, DYMONIC 100 OR
FUNCTIONAL EQUIVALENT 3"
MIN. ON INTERIOR SIDE OF EPS

COMPRESSIBLE AIR SEAL GASKET
APPLIED TO FULL LENGTH REAR
EDGE OF SILL PRIOR TO FRAME
INSTALLATION

NOTES:

- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
- 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows

Detail: Nudura 10" (254mm) Form Unit, Window Head/Sill, Aluminum Framed
Window, Wood Rough Buck, EIFS Lamina Finish

File Name:

Drawn by: TVC

Checked by: KS

Scale: 1:8

E10D01

Revision #: 04

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

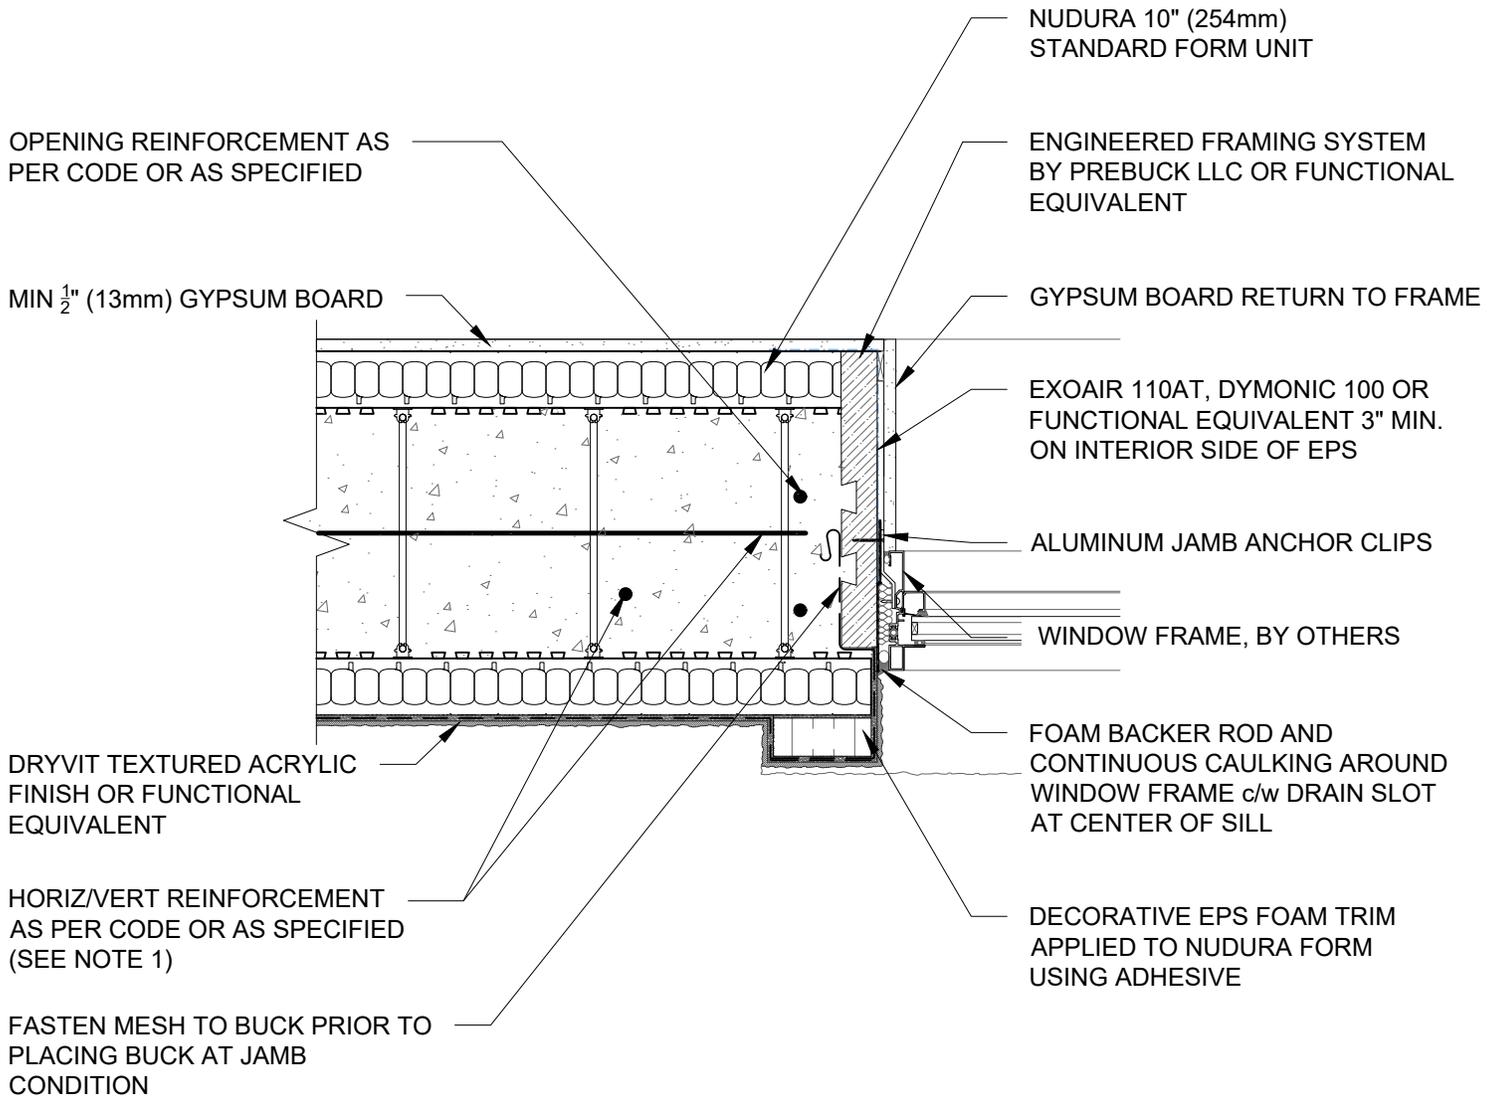

NOTES:

- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
- 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows




Detail: Nudura 10" (254mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, EIFS Lamina Finish		
Drawn by: TVC	Checked by: KS	Scale: 1:8
Revision #: 04	Revised by: KAB	Date: 3/13/2024

File Name:

E10D02



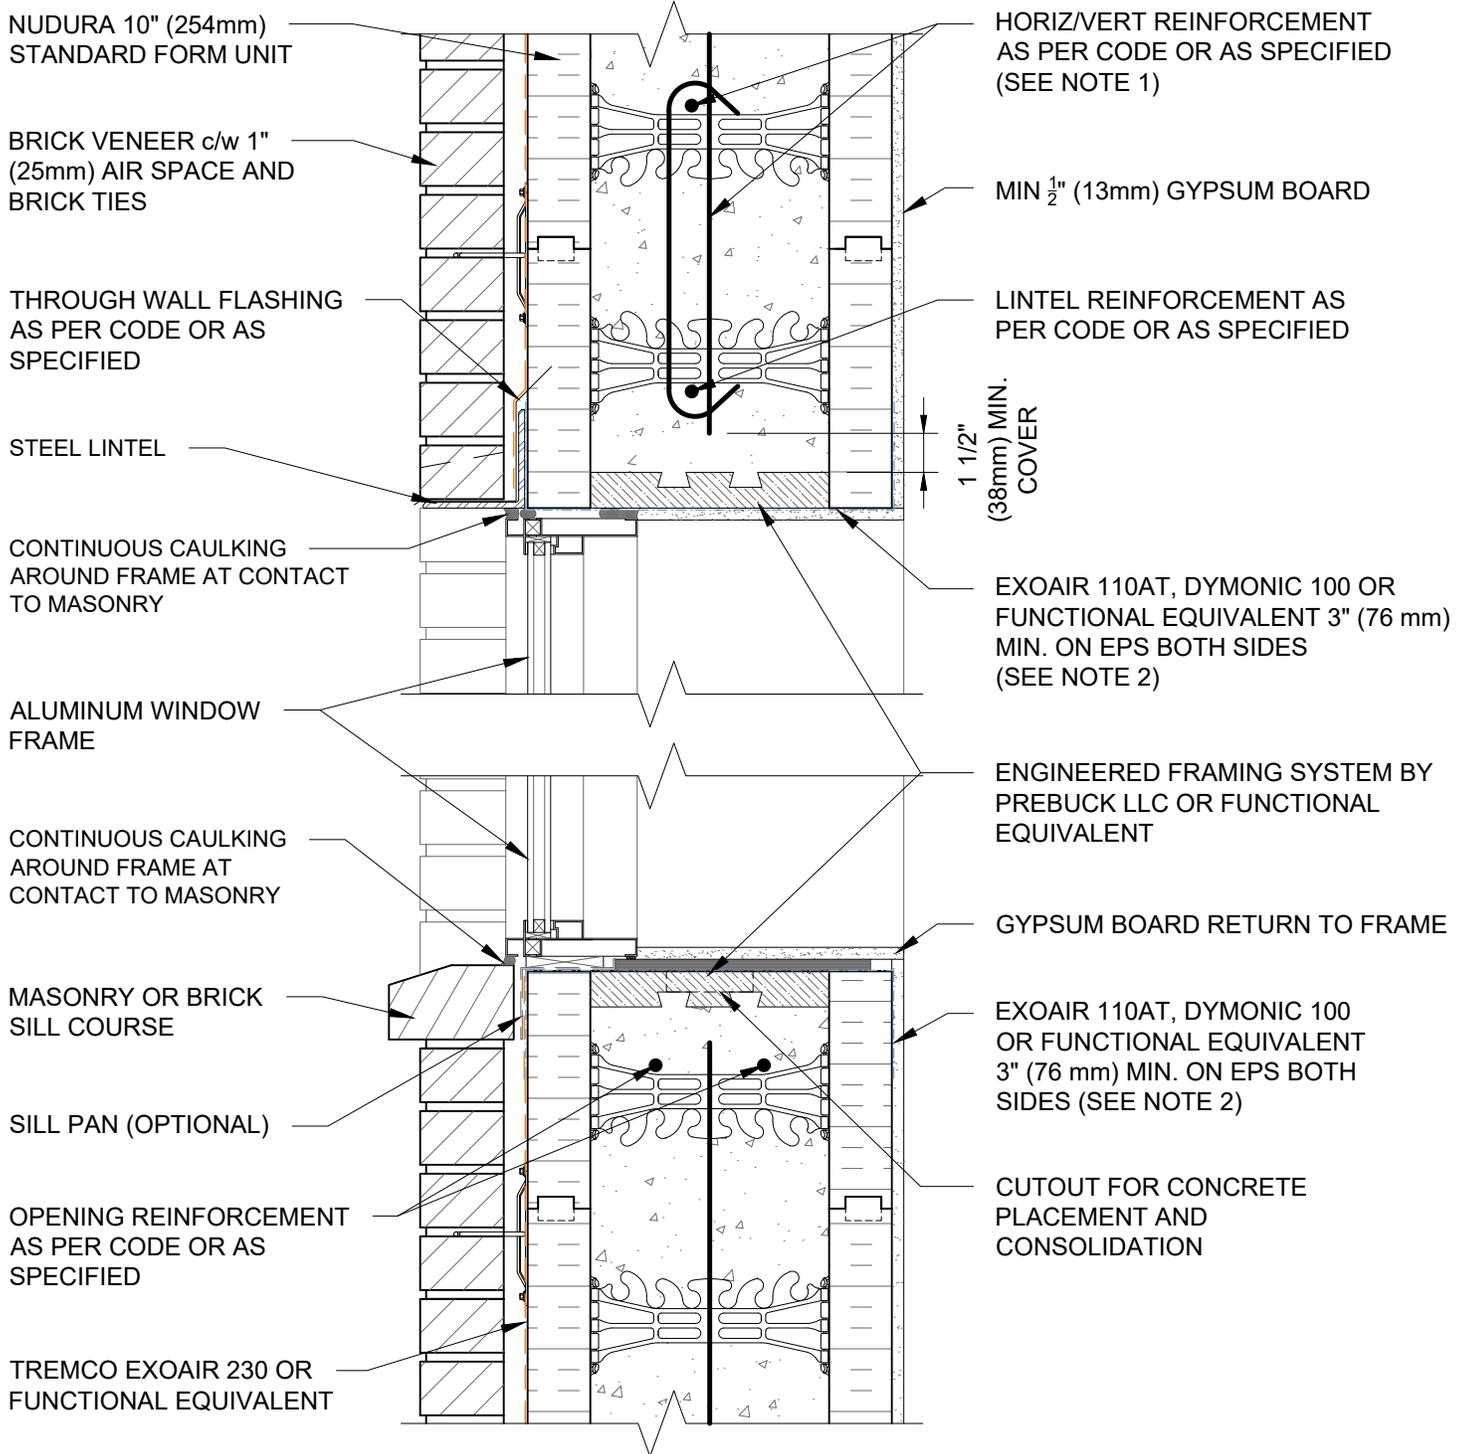

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
 - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)
 - 3) THIS DETAIL IS SUITABLE FOR NON-COMBUSTIBLE 1 TO 3 STOREY HIGH APPLICATIONS AS PERMITTED UNDER LOCAL CODES; FOR WINDOWS IN BRICK CLAD MULTI-STOREY APPLICATIONS, REFER TO DETAIL E10D05 UNDER THIS SECTION.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows

Detail: Nudura 10" (254mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish

File Name:

Drawn by: TVC

Checked by: KS

Scale: 1:8

E10D03

Revision #: 04

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

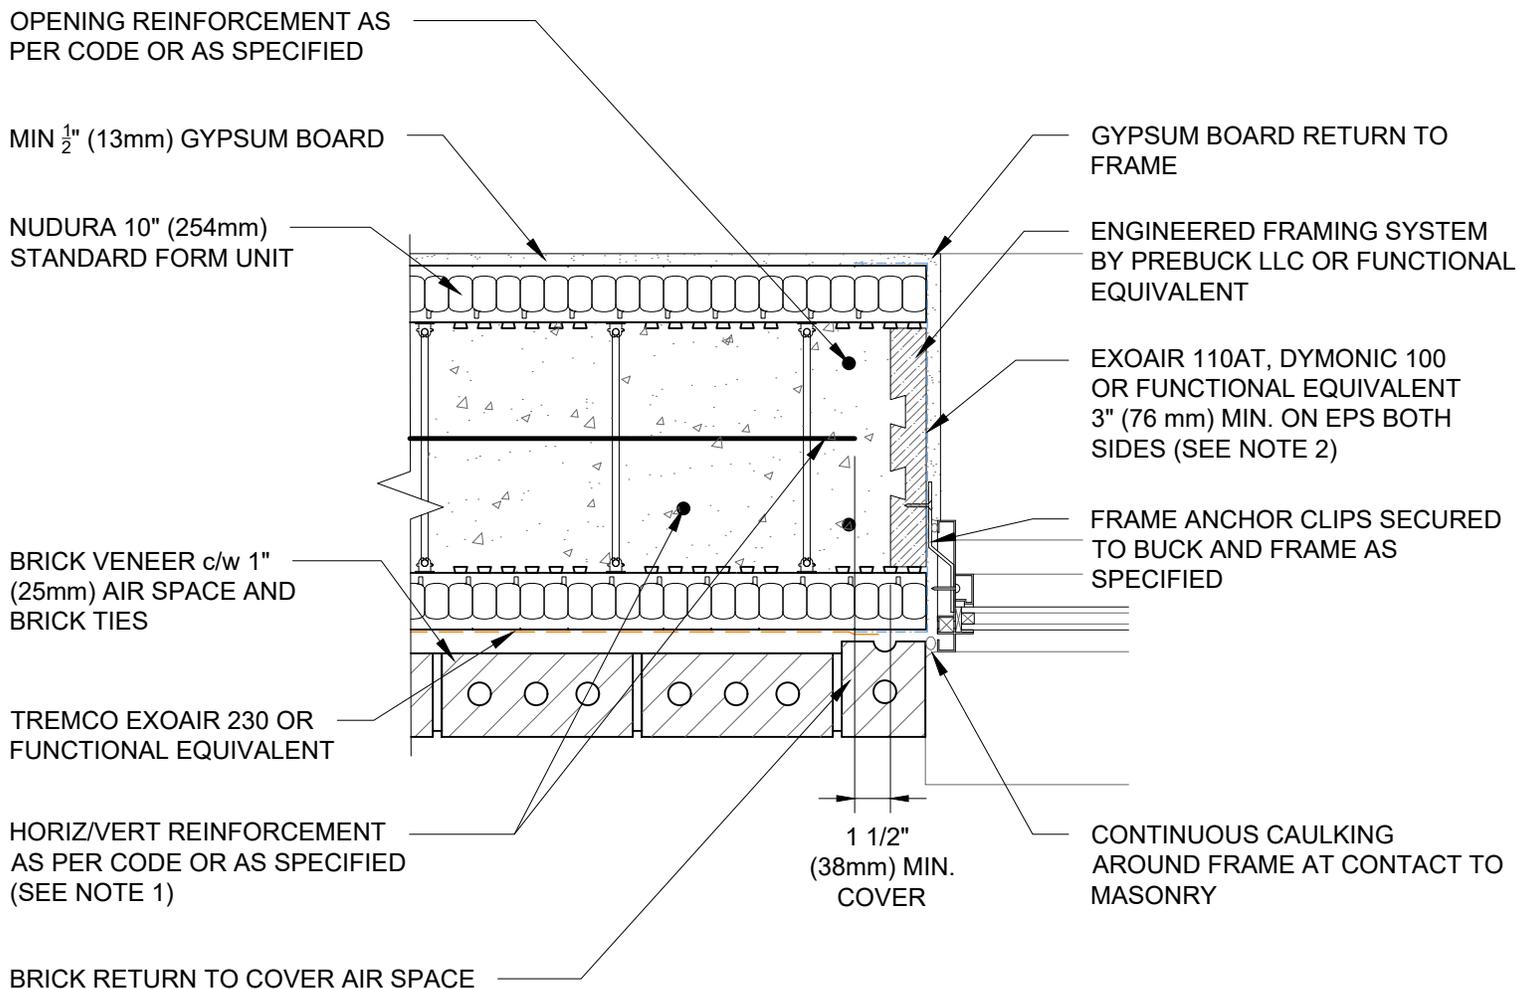

NOTES:

- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
- 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)
- 3) THIS DETAIL IS SUITABLE FOR NON-COMBUSTIBLE 1 TO 3 STOREY HIGH APPLICATIONS AS PERMITTED UNDER LOCAL CODES; FOR WINDOWS IN BRICK CLAD MULTI-STOREY APPLICATIONS, REFER TO DETAIL E10D06 UNDER THIS SECTION.

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.


Non-Combustible Construction - Windows



Detail: Nudura 10" (254mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish		
Drawn by: TVC	Checked by: KS	Scale: 1:8
Revision #: 04	Revised by: KAB	Date: 3/13/2024

File Name:
E10D04



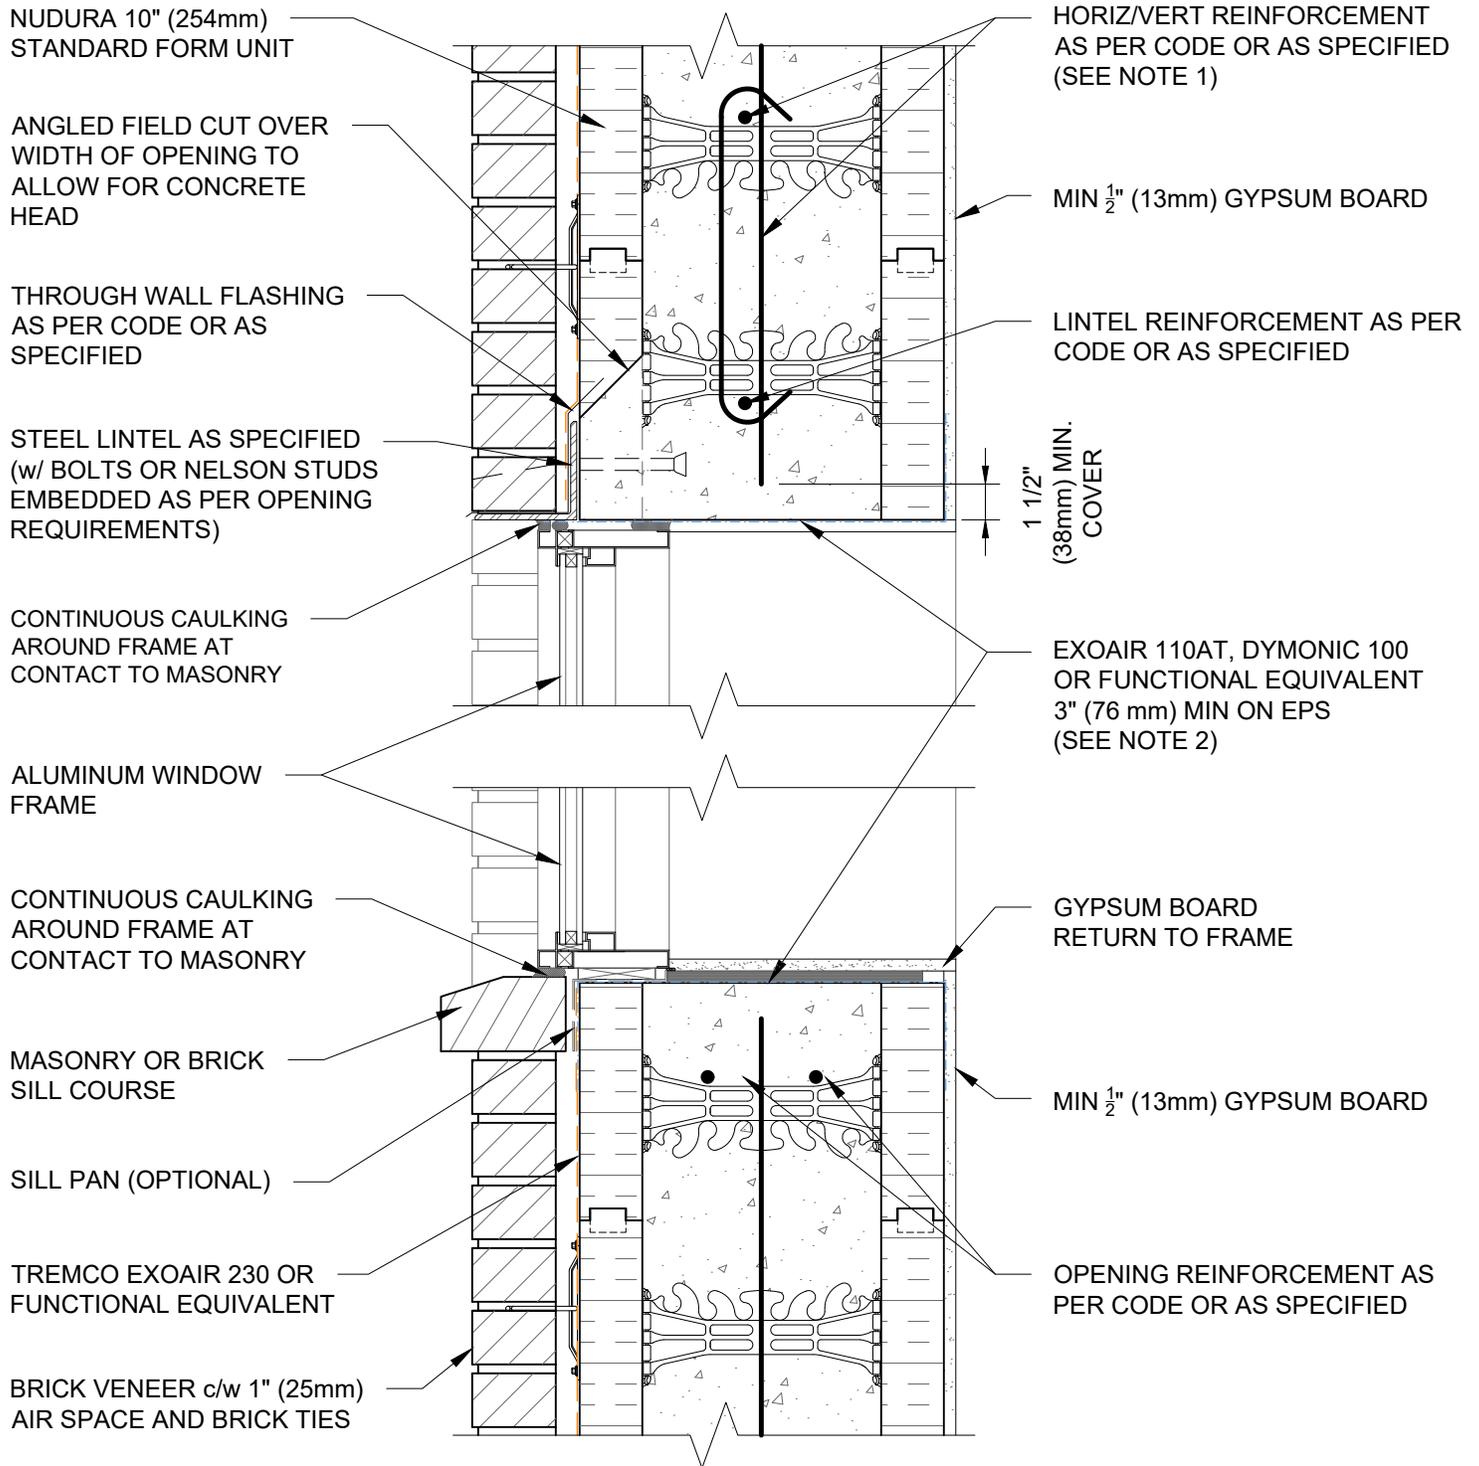

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
 - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows



Nudura Technical Support: 866-468-6299
International: +1 705-726-9499

Detail: Nudura 10" (254mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Concrete Mounted, Brick Veneer Finish

Drawn by: TVC

Checked by: KS

Scale: 1:8

Revision #: 03

Revised by: KAB

Date: 3/13/2024

File Name:

E10D05



Construction Products Group

www.tremcocpg.com

OPENING REINFORCEMENT AS PER CODE OR AS SPECIFIED

MIN 1/2" (13mm) GYPSUM BOARD

NUDURA 10" (254mm) STANDARD FORM UNIT

TREMCO EXOAIR 230 OR FUNCTIONAL EQUIVALENT

BRICK VENEER c/w 1" (25mm) AIR SPACE AND BRICK TIES

HORIZ/VERT REINFORCEMENT AS PER CODE OR AS SPECIFIED (SEE NOTE 1)

BRICK RETURN TO CONTACT CONCRETE CORE

1 1/2" (38mm) MIN. COVER

GYPSUM BOARD RETURN TO FRAME

EXOAIR 110AT, DYMONIC 100 OR FUNCTIONAL EQUIVALENT 3" (76 mm) MIN. ON EPS BOTH SIDES (SEE NOTE 2)

FRAME ANCHOR CLIPS SECURED TO CONCRETE AND FRAME AS SPECIFIED

ALUMINUM WINDOW FRAME

CONTINUOUS CAULKING AROUND FRAME AT CONTACT TO MASONRY

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows

Detail: Nudura 10" (254mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Brick Veneer Finish

File Name:

Drawn by: TVC

Checked by: KS

Scale: 1:8

E10D06

Revision #: 02

Revised by: KAB

Date: 3/13/2024



Nudura Technical Support: 866-468-6299
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

NUDURA 10" (254mm)
STANDARD FORM UNIT

FASTEN MESH TO BACK OF
TEMPORARY BUCK TO
ALLOW MESH TO BOND WITH
CONCRETE

DECORATIVE EPS FOAM
TRIM (HEAD AND SILL)
APPLIED TO NUDURA
FORM USING EPS
COMPATIBLE ADHESIVE

WINDOW FRAME,
BY OTHERS

FOR MULTI-STOREY
APPLICATIONS, MESH TO
LAP BACK AROUND
BUCK TO LINK w/
CONCRETE

FOAM BACKER ROD
AND CONTINUOUS
CAULKING AROUND
FRAME

OPENING REINFORCEMENT
AS PER CODE OR AS
SPECIFIED

DRYVIT TEXTURED
ACRYLIC FINISH OR
FUNCTIONAL EQUIVALENT

MIN 1/2" (13mm) GYPSUM BOARD

HORIZ/VERT REINFORCEMENT
AS PER CODE OR AS SPECIFIED
(SEE NOTE 1)

LINTEL REINFORCEMENT AS
PER CODE OR AS SPECIFIED

1 1/2"
(38mm) MIN.
COVER

EXOAIR 110AT, DYMONIC 100
OR FUNCTIONAL EQUIVALENT
3" MIN. ON INTERIOR SIDE OF
EPS c/w FOAM ROD/CAULK OR
SEAL TO INTERIOR EDGE OF
FRAME

GYPSUM BOARD RETURN TO FRAME

EXOAIR 110AT, DYMONIC 100 OR
FUNCTIONAL EQUIVALENT 3"
MIN. ON INTERIOR SIDE OF EPS

COMPRESSIBLE AIR SEAL GASKET
APPLIED TO FULL LENGTH REAR
EDGE OF SILL PRIOR TO FRAME
INSTALLATION

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows

Detail: Nudura 10" (254mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Concrete Mounted, EIFS Lamina Finish

File Name:

Drawn by: TVC

Checked by: KS

Scale: 1:8

E10D07

Revision #: 02

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

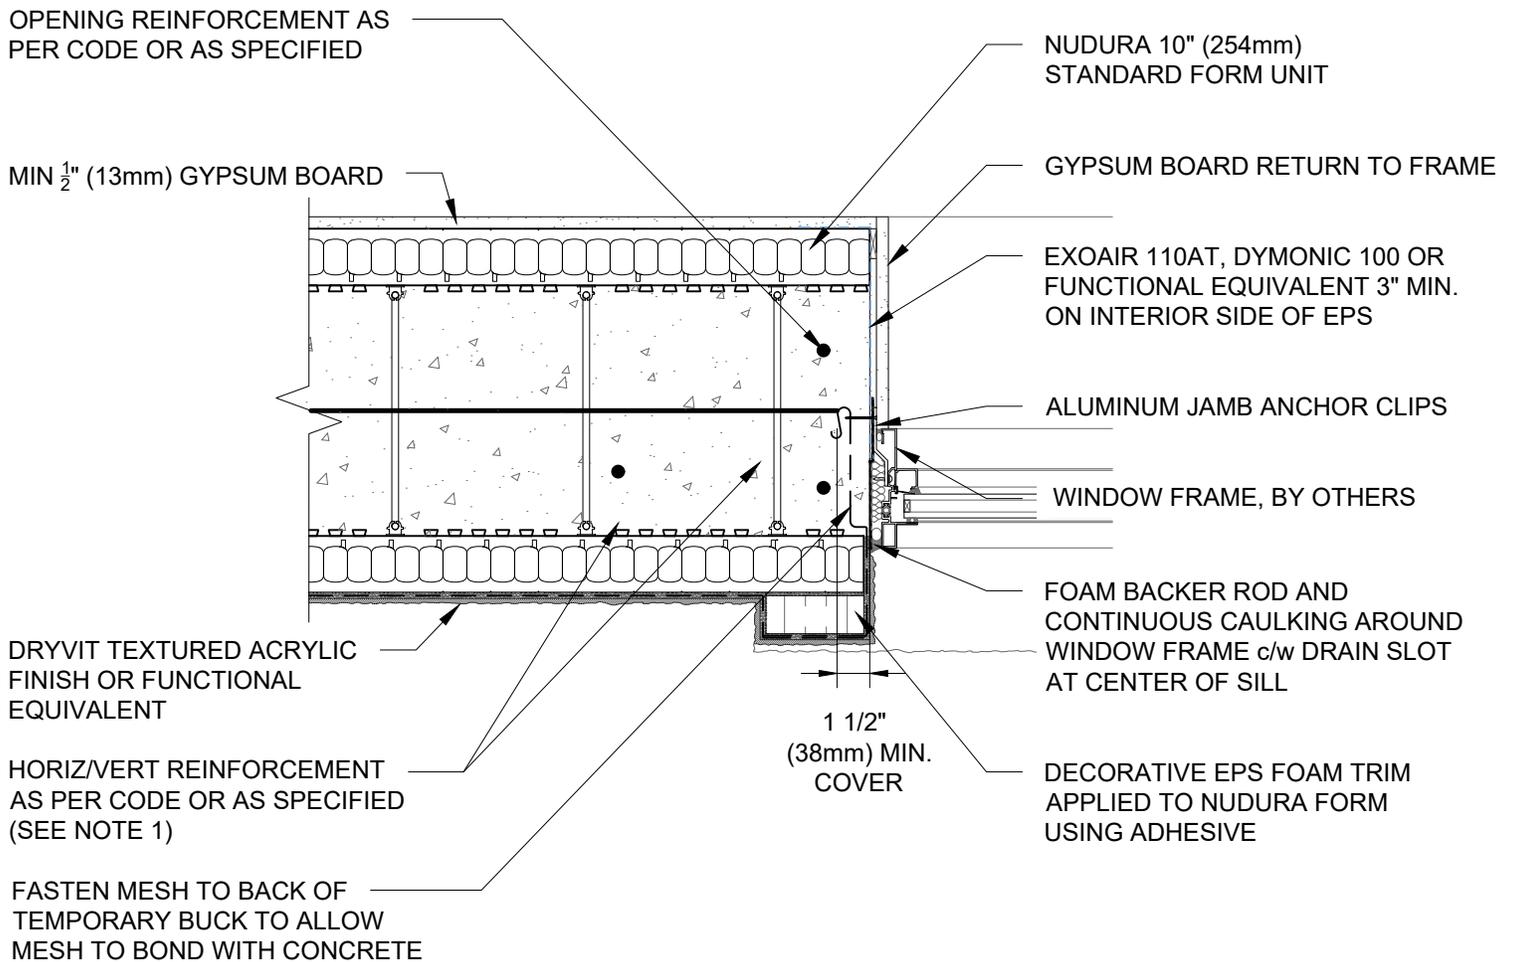

NOTES:

- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
- 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.

Non-Combustible Construction - Windows



Detail: Nudura 10" (254mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, EIFS Lamina Finish		
Drawn by: TVC	Checked by: KS	Scale: 1:8
Revision #: 02	Revised by: KAB	Date: 3/13/2024

File Name:
E10D08

