

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)
  - 3) THIS DETAIL IS SUITABLE FOR NON-COMBUSTIBLE 1 TO 3 STOREY HIGH APPLICATIONS AS PERMITTED UNDER LOCAL CODES; FOR WINDOWS IN BRICK CLAD MULTI-STOREY APPLICATIONS, REFER TO DETAIL E6D03 IN THIS SECTION.

*This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish		
Drawn by: JN	Checked by: KS	Scale: 1:8
Revision #: 07	Revised by: KAB	Date: 3/13/2024

File Name:  
E6D01



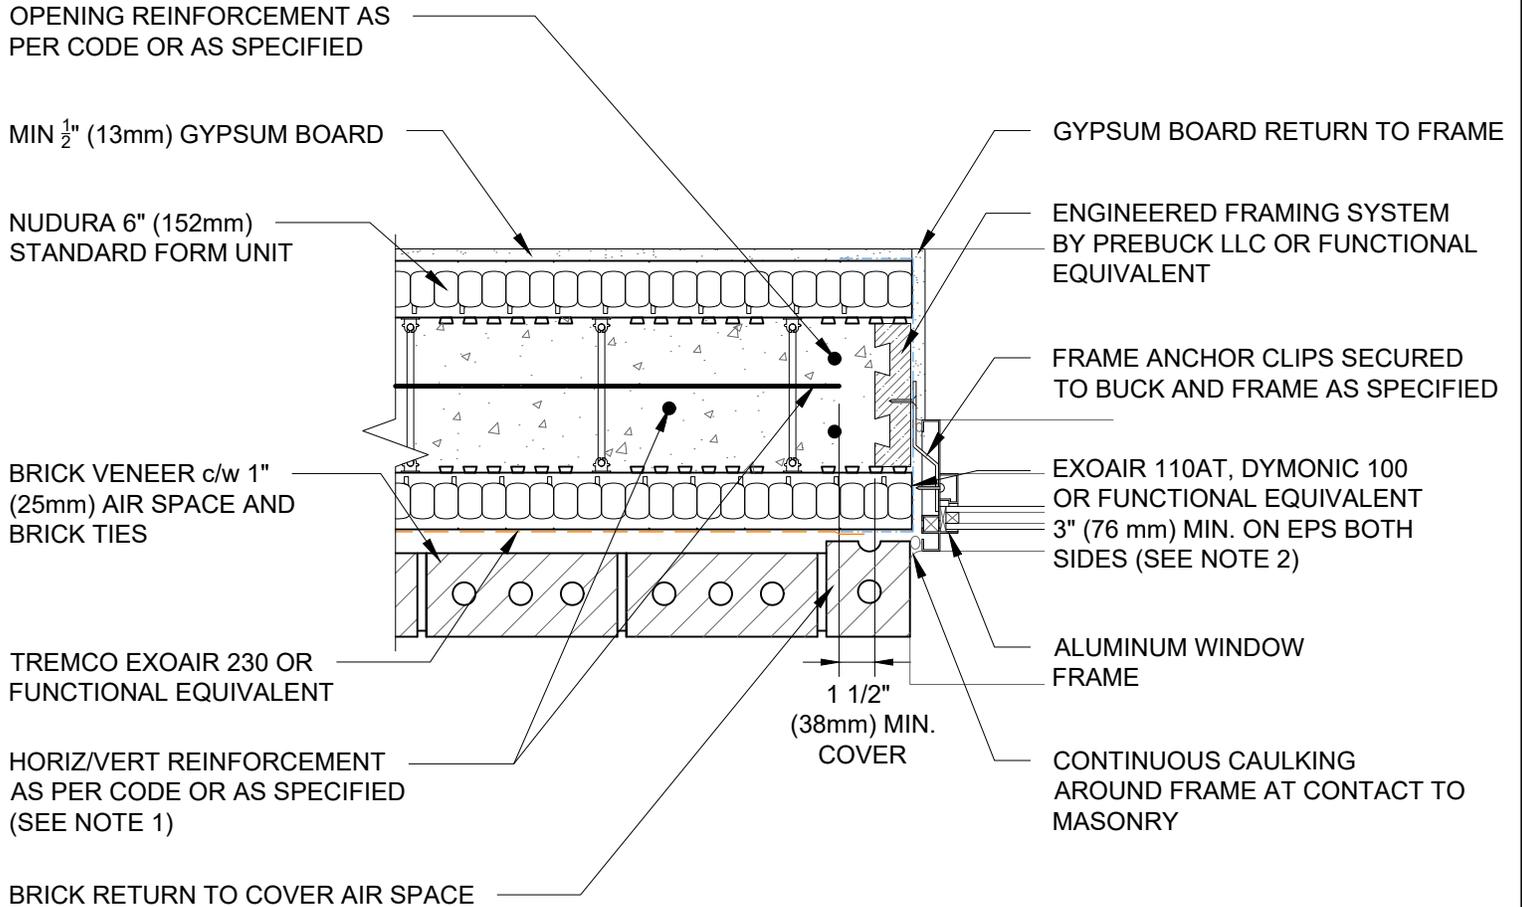

**NOTES:**

- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
- 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)
- 3) THIS DETAIL IS SUITABLE FOR NON-COMBUSTIBLE 1 TO 3 STOREY HIGH APPLICATIONS AS PERMITTED UNDER LOCAL CODES; FOR WINDOWS IN BRICK CLAD MULTI-STOREY APPLICATIONS, REFER TO DETAIL E6D11 IN THIS SECTION.

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**




Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish		
Drawn by: JN	Checked by: KS	Scale: 1:8
Revision #: 05	Revised by: KAB	Date: 3/13/2024

File Name:

E6D02



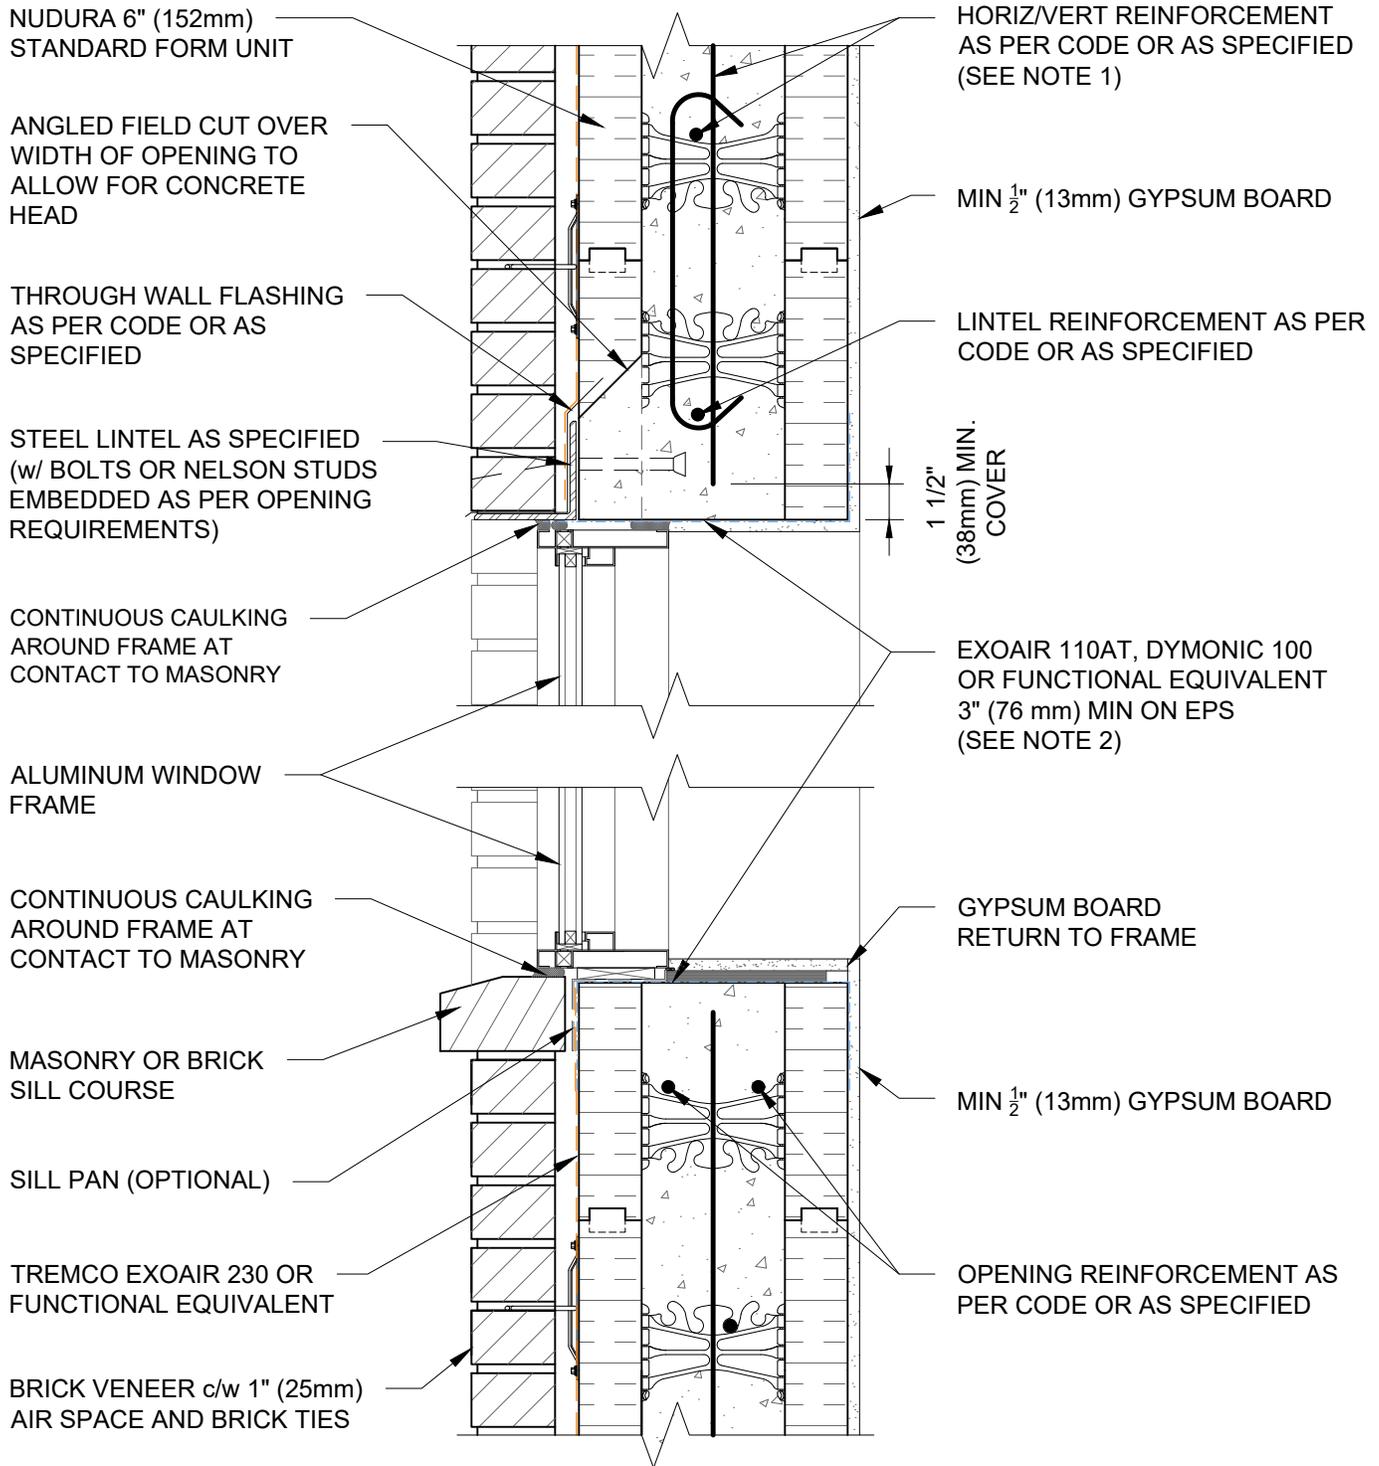

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Concrete Mounted, Brick Veneer Finish			File Name:
Drawn by: TVC	Checked by: KS	Scale: 1:8	E6D03
Revision #: 03	Revised by: KAB	Date: 3/13/2024	

www.tremcocpg.com



NUDURA 6" (152mm)  
STANDARD FORM UNIT

FASTEN MESH TO BUCK  
PRIOR TO PLACING BUCK AT  
HEAD CONDITION

DECORATIVE EPS FOAM  
TRIM (HEAD AND SILL)  
APPLIED TO NUDURA  
FORM USING EPS  
COMPATIBLE ADHESIVE

WINDOW FRAME,  
BY OTHERS

FOR MULTI-STOREY  
APPLICATIONS, MESH TO  
LAP BACK AROUND  
BUCK TO LINK w/  
CONCRETE

FOAM BACKER ROD  
AND CONTINUOUS  
CAULKING AROUND  
FRAME

2x2" (38x38mm)  
ROUGH NAILER

OPENING REINFORCEMENT  
AS PER CODE OR AS  
SPECIFIED

DRYVIT TEXTURED  
ACRYLIC FINISH OR  
FUNCTIONAL EQUIVALENT

MIN 1/2" (13mm) GYPSUM BOARD

HORIZ/VERT REINFORCEMENT  
AS PER CODE OR AS SPECIFIED  
(SEE NOTE 1)

LINTEL REINFORCEMENT AS  
PER CODE OR AS SPECIFIED

1 1/2"  
(38mm) MIN.  
COVER

EXOAIR 110AT, DYMONIC 100  
OR FUNCTIONAL EQUIVALENT  
3" MIN. ON INTERIOR SIDE OF  
EPS c/w FOAM ROD/CAULK OR  
SEAL TO INTERIOR EDGE OF  
FRAME

ENGINEERED FRAMING SYSTEM BY  
PREBUCK LLC OR FUNCTIONAL  
EQUIVALENT

GYPSUM BOARD RETURN TO FRAME

2x3" (38x64mm) ROUGH NAILER

EXOAIR 110AT, DYMONIC 100 OR  
FUNCTIONAL EQUIVALENT 3"  
MIN. ON INTERIOR SIDE OF EPS

COMPRESSIBLE AIR SEAL GASKET  
APPLIED TO FULL LENGTH REAR  
EDGE OF SILL PRIOR TO FRAME  
INSTALLATION

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

Detail: Nudura 6" (152mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Wood Rough Buck, Direct Applied Acrylic Finish

Drawn by: KS

Checked by: KS

Scale: 1:8

Revision #: 01

Revised by: KAB

Date: 3/13/2024


File Name:

E6D05



Construction Products Group

www.tremcocpg.com

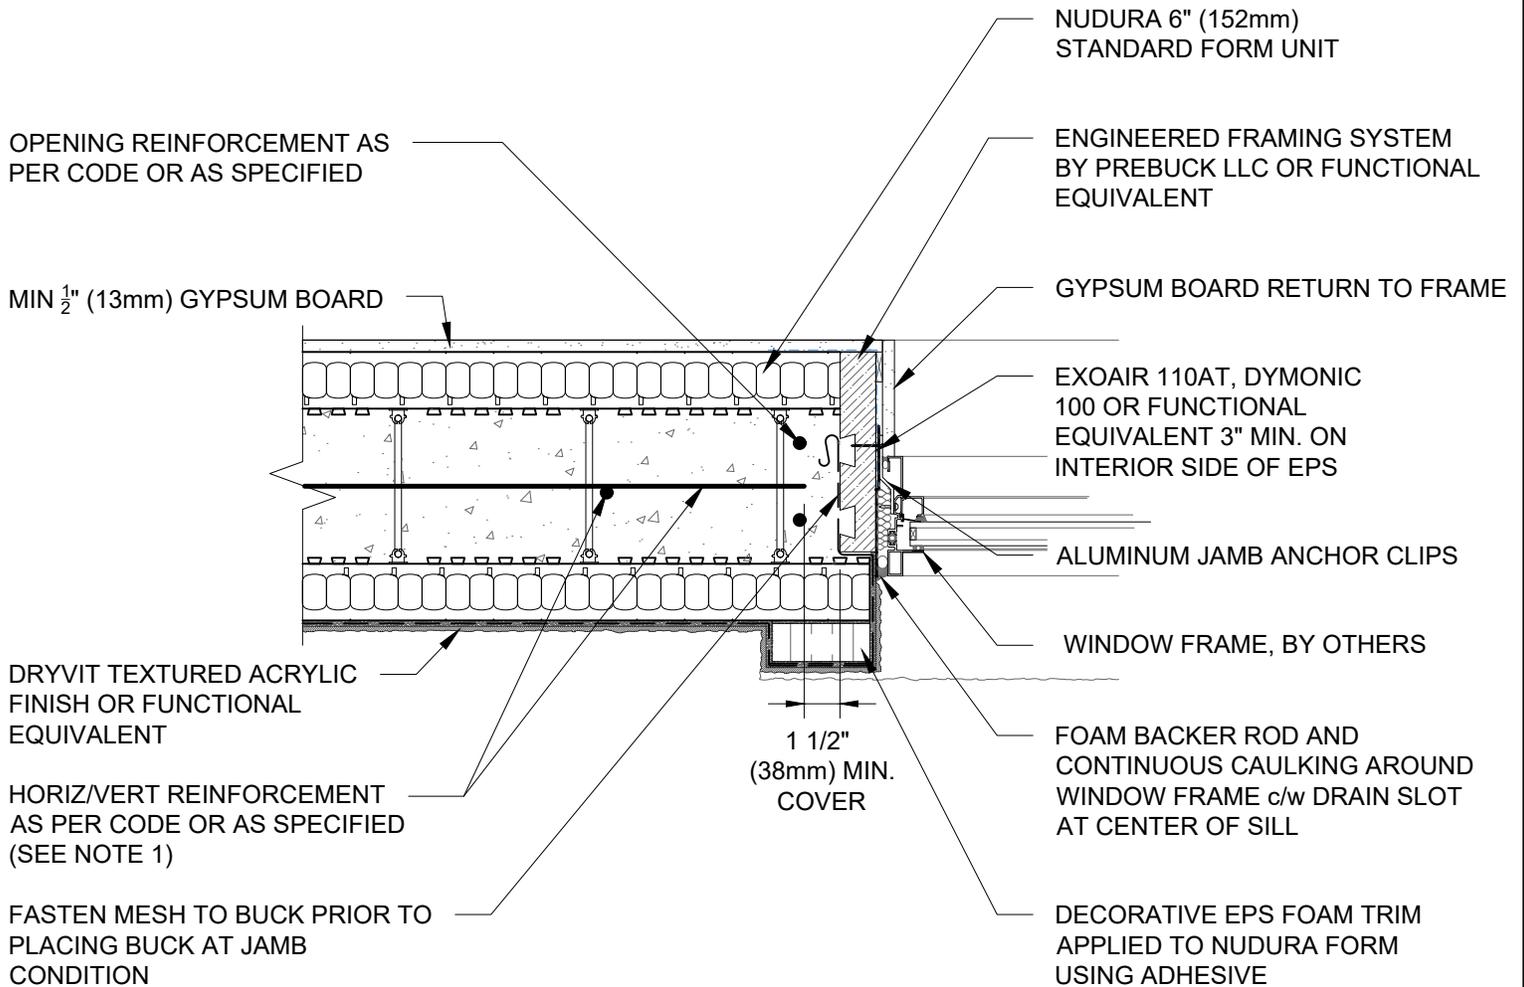

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows




Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Buck Mounted, Direct Applied Acrylic Finish		
Drawn by: KS	Checked by: KS	Scale: 1:8
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:

E6D06



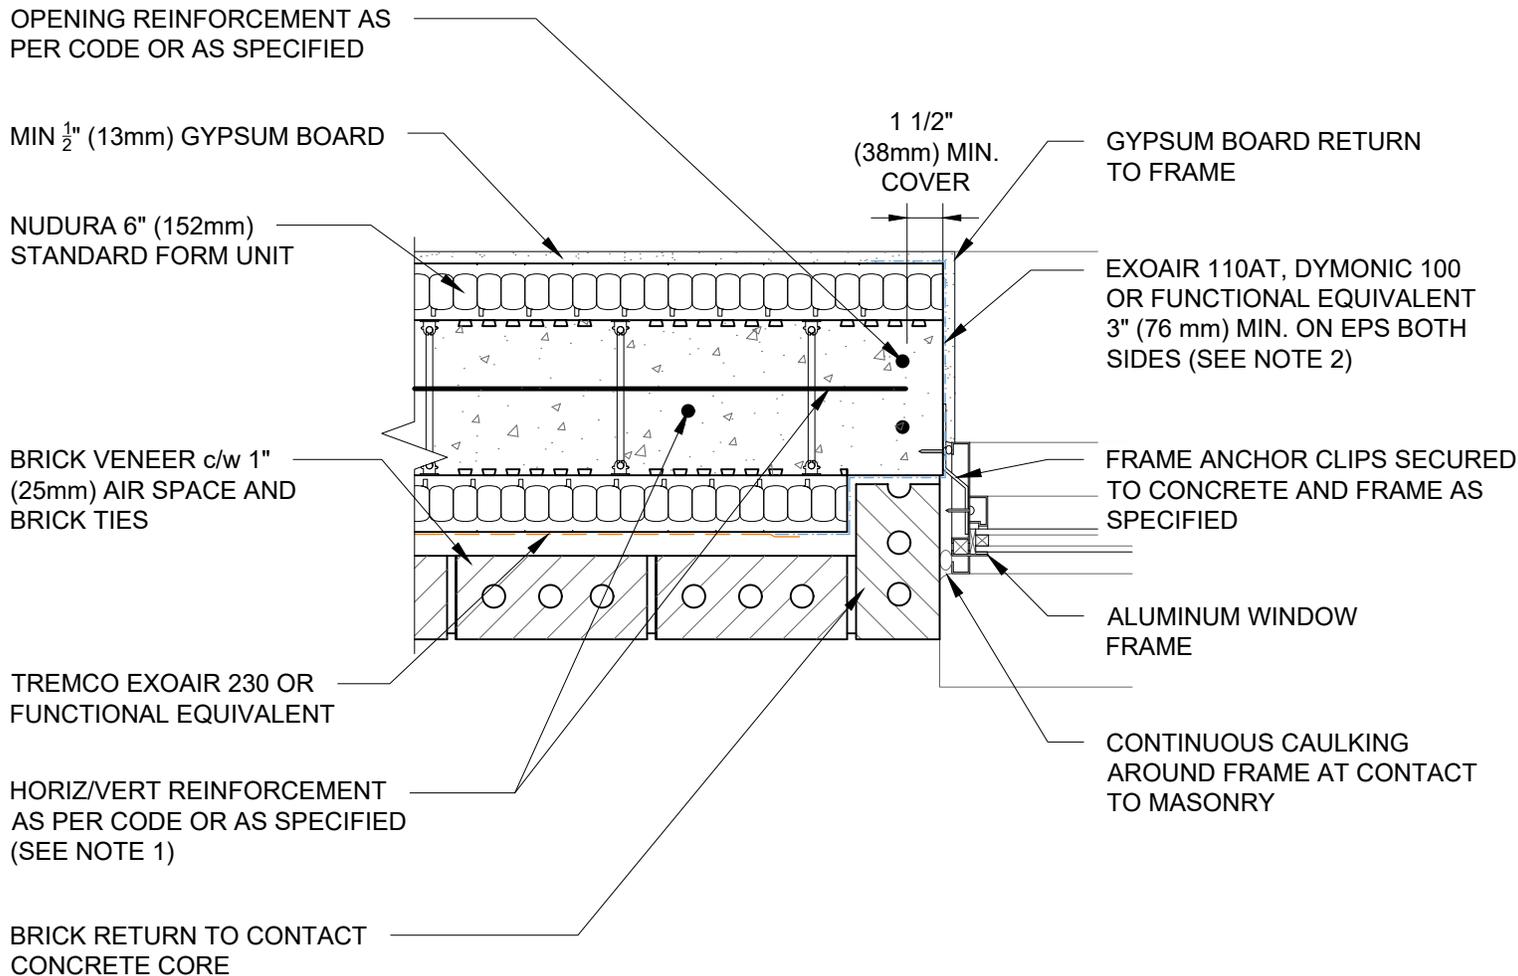

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows



Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Brick Veneer Finish

Drawn by: TVC

Checked by: KS

Scale: 1:8

Revision #: 05

Revised by: KAB

Date: 3/13/2024

File Name:

E6D11



NUDURA 6" (152mm)  
STANDARD FORM UNIT

MIN 1/2" (13mm) GYPSUM BOARD

FASTEN MESH TO BACK OF  
TEMPORARY BUCK TO  
ALLOW MESH TO BOND WITH  
CONCRETE

HORIZ/VERT REINFORCEMENT  
AS PER CODE OR AS SPECIFIED  
(SEE NOTE 1)

DECORATIVE EPS FOAM  
TRIM (HEAD AND SILL)  
APPLIED TO NUDURA  
FORM USING EPS  
COMPATIBLE ADHESIVE

LINTEL REINFORCEMENT AS  
PER CODE OR AS SPECIFIED

WINDOW FRAME,  
BY OTHERS

1 1/2"  
(38mm) MIN.  
COVER

EXOAIR 110AT, DYMONIC 100  
OR FUNCTIONAL EQUIVALENT  
3" MIN. ON INTERIOR SIDE OF  
EPS c/w FOAM ROD/CAULK OR  
SEAL TO INTERIOR EDGE OF  
FRAME

FOR MULTI-STOREY  
APPLICATIONS, MESH TO  
LAP BACK AROUND  
BUCK TO LINK w/  
CONCRETE

GYPSUM BOARD RETURN TO FRAME

FOAM BACKER ROD  
AND CONTINUOUS  
CAULKING AROUND  
FRAME

EXOAIR 110AT, DYMONIC 100 OR  
FUNCTIONAL EQUIVALENT 3"  
MIN. ON INTERIOR SIDE OF EPS

OPENING REINFORCEMENT  
AS PER CODE OR AS  
SPECIFIED

COMPRESSIBLE AIR SEAL GASKET  
APPLIED TO FULL LENGTH REAR  
EDGE OF SILL PRIOR TO FRAME  
INSTALLATION

DRYVIT TEXTURED  
ACRYLIC FINISH OR  
FUNCTIONAL EQUIVALENT

**NOTES:**

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**

Detail: Nudura 6" (152mm) Form Unit, Window Head/Sill, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish			File Name:
Drawn by: KS	Checked by: KS	Scale: 1:8	E6D12
Revision #: 01	Revised by: KAB	Date: 3/13/2024	



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

OPENING REINFORCEMENT AS PER CODE OR AS SPECIFIED

MIN 1/2" (13mm) GYPSUM BOARD

DRYVIT TEXTURED ACRYLIC FINISH OR FUNCTIONAL EQUIVALENT

HORIZ/VERT REINFORCEMENT AS PER CODE OR AS SPECIFIED (SEE NOTE 1)

FASTEN MESH TO BACK OF TEMPORARY BUCK TO ALLOW MESH TO BOND WITH CONCRETE

NUDURA 6" (152mm) STANDARD FORM UNIT

GYPSUM BOARD RETURN TO FRAME

EXOAIR 110AT, DYMONIC 100 OR FUNCTIONAL EQUIVALENT 3" MIN. ON INTERIOR SIDE OF EPS


ALUMINUM JAMB ANCHOR CLIPS

WINDOW FRAME, BY OTHERS

FOAM BACKER ROD AND CONTINUOUS CAULKING AROUND WINDOW FRAME c/w DRAIN SLOT AT CENTER OF SILL

DECORATIVE EPS FOAM TRIM APPLIED TO NUDURA FORM USING ADHESIVE

1 1/2" (38mm) MIN. COVER

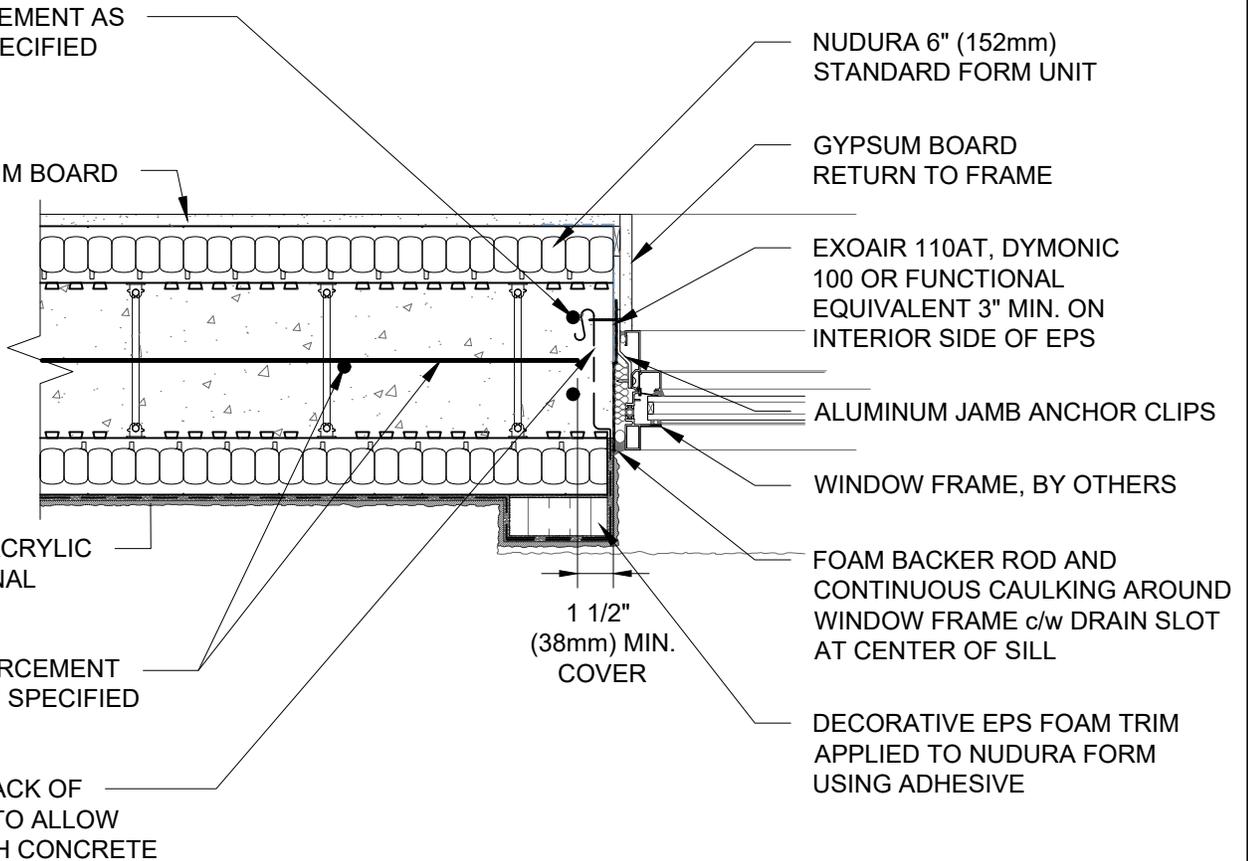

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**




Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish		
Drawn by: KS	Checked by: KS	Scale: 1:8
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:

E6D13



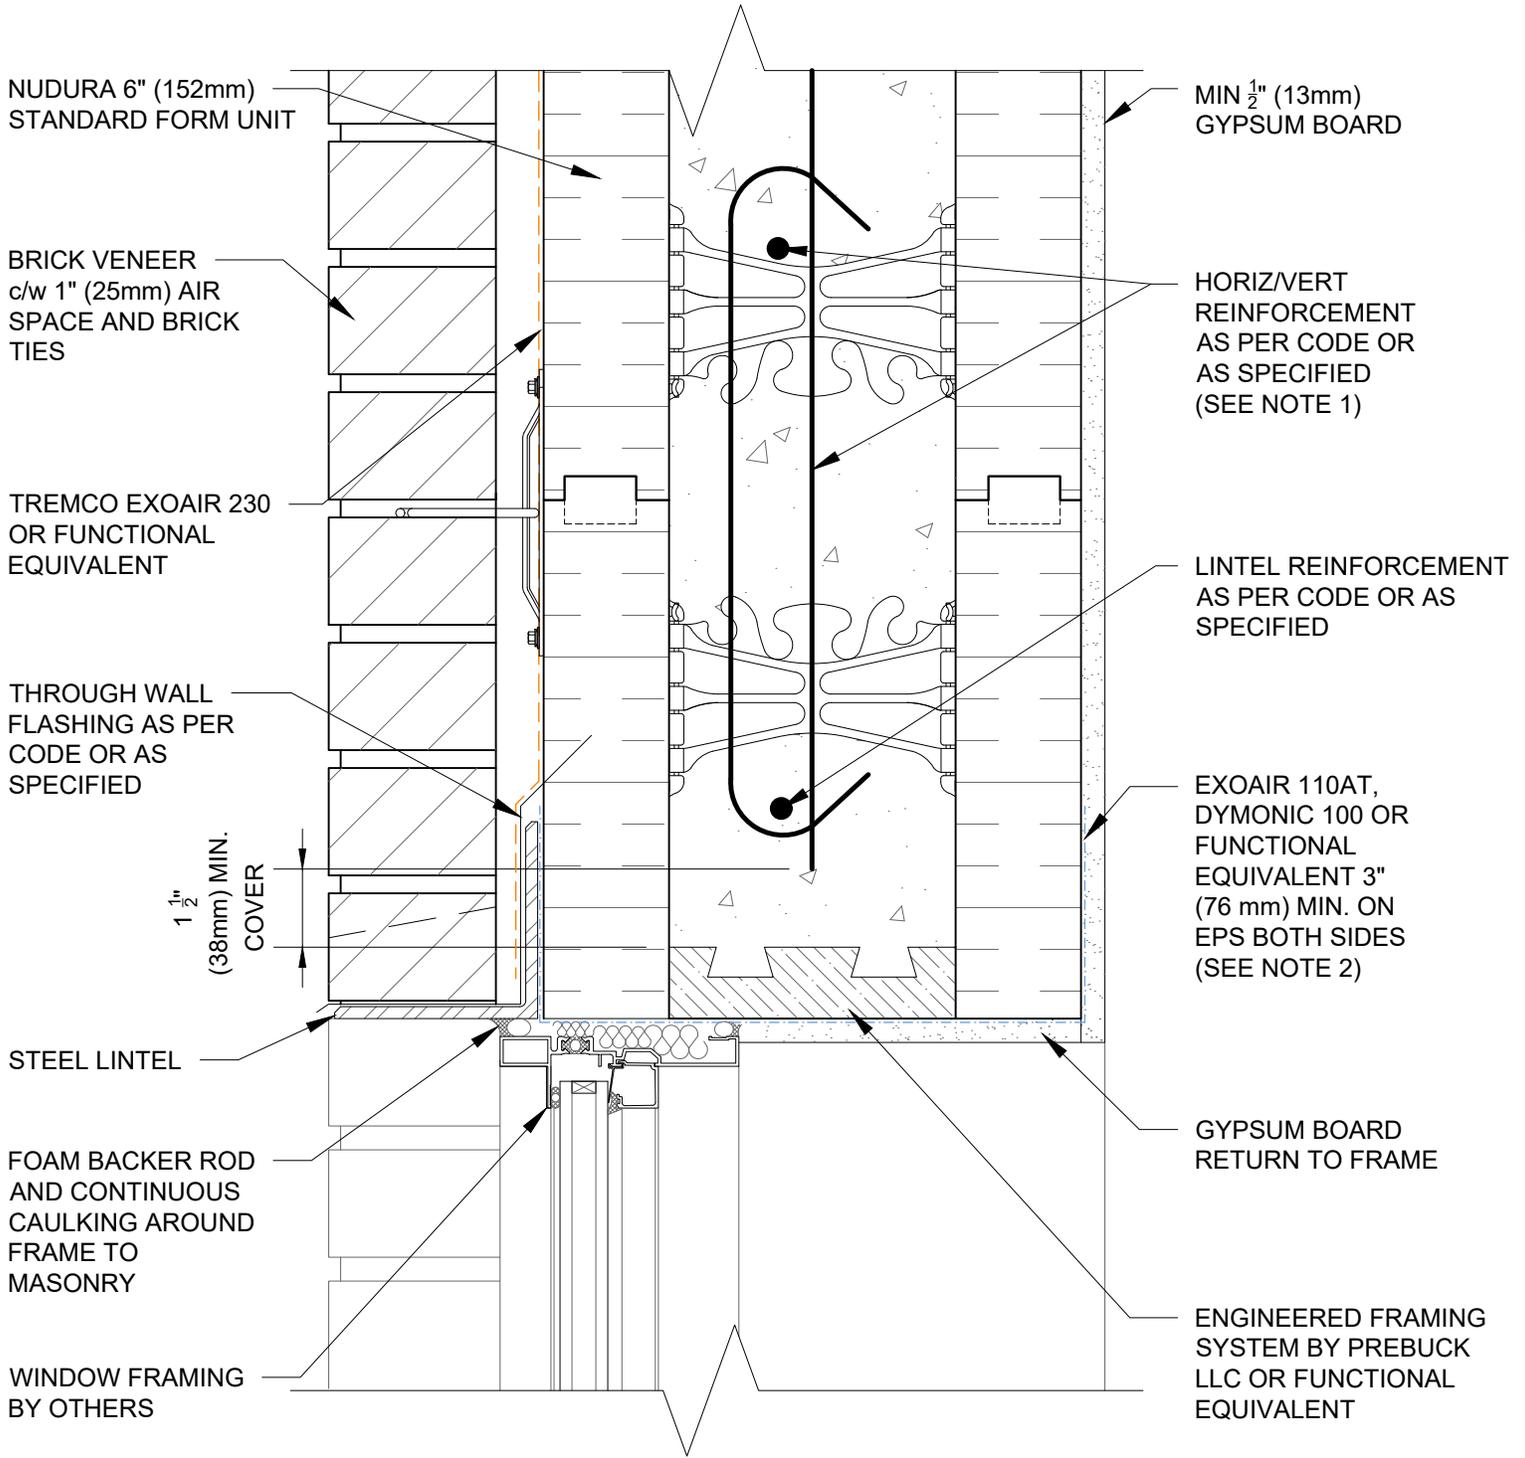

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6A01



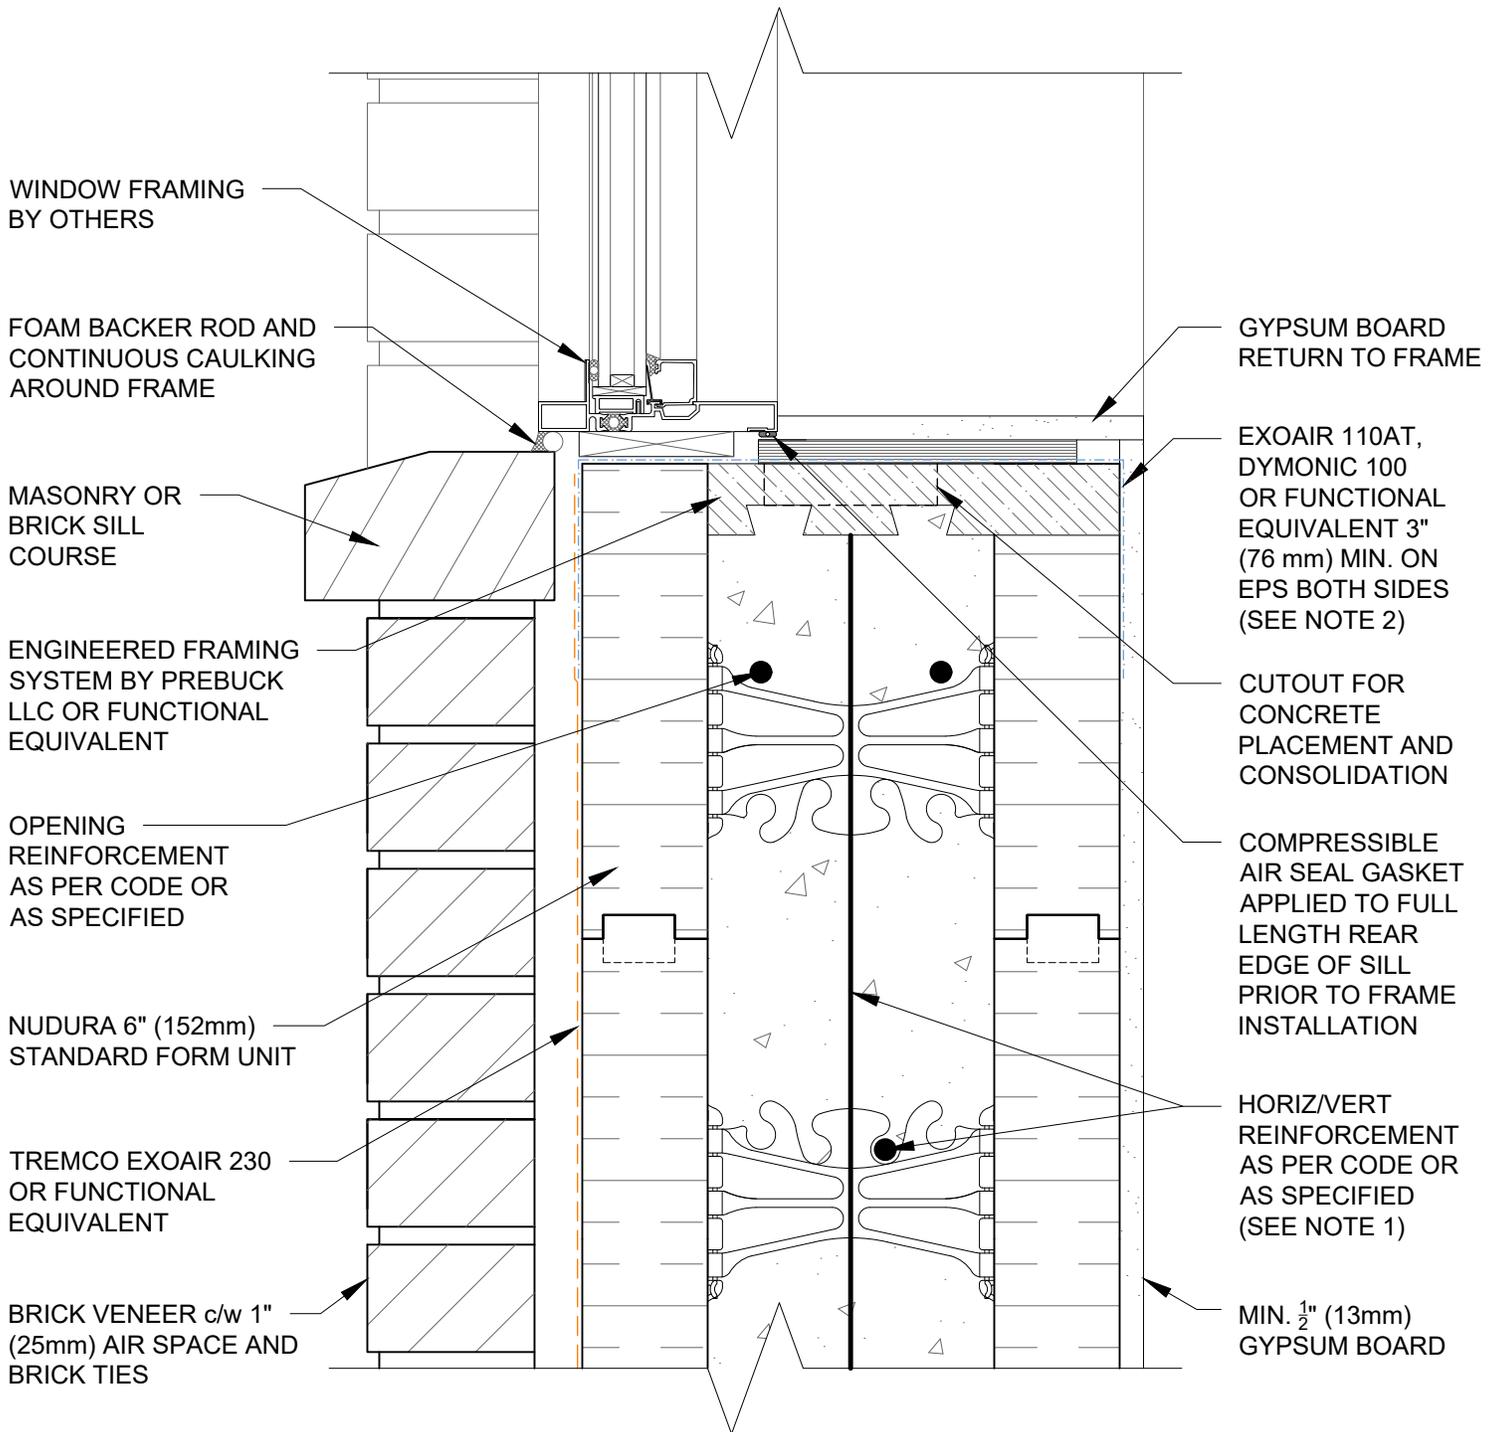

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)
  - 3) THIS DETAIL IS SUITABLE FOR NON-COMBUSTIBLE 1 TO 3 STOREY HIGH APPLICATIONS AS PERMITTED UNDER LOCAL CODES; FOR WINDOWS IN BRICK CLAD MULTI-STOREY APPLICATIONS, REFER TO DETAIL H6A04 & H6A05 UNDER THIS SECTION.

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


### Non-Combustible Construction - Windows



Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6A02



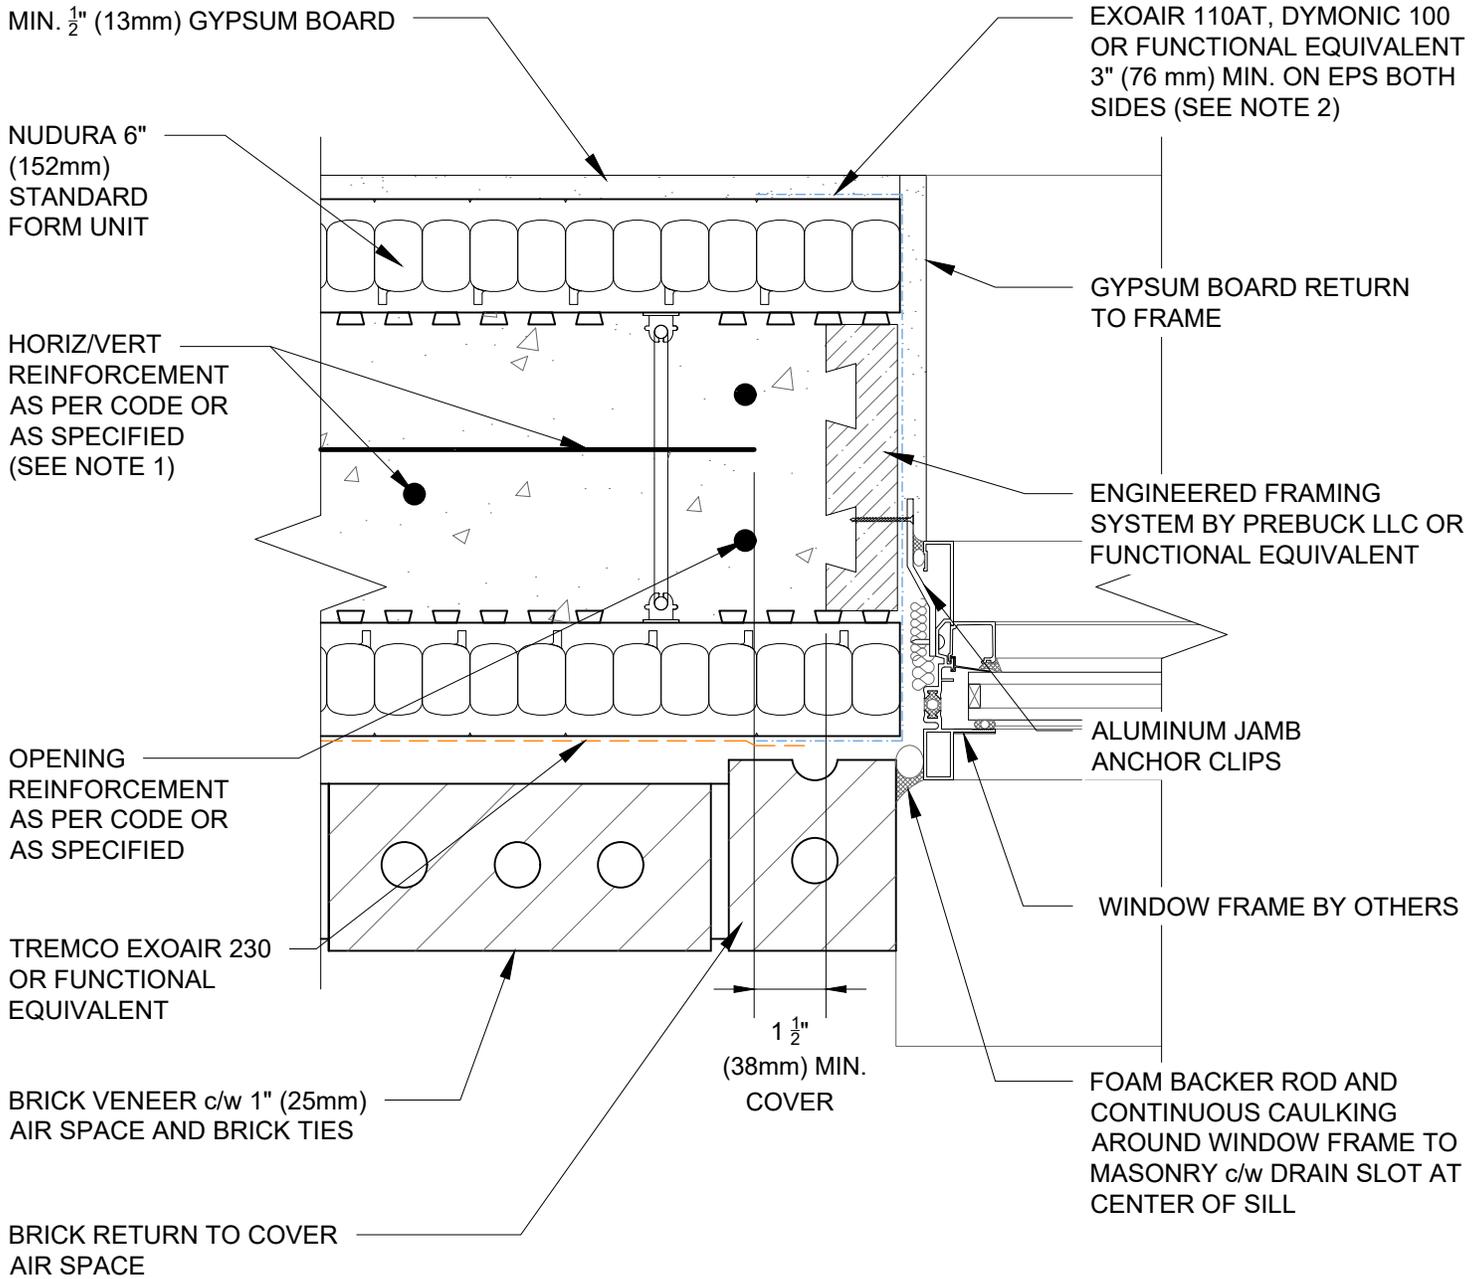

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)
  - 3) THIS DETAIL IS SUITABLE FOR NON-COMBUSTIBLE 1 TO 3 STOREY HIGH APPLICATIONS AS PERMITTED UNDER LOCAL CODES; FOR WINDOWS IN BRICK CLAD MULTI-STOREY APPLICATIONS, REFER TO DETAIL H6A04 & H6A05 UNDER THIS SECTION.

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Brick Veneer Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6A03



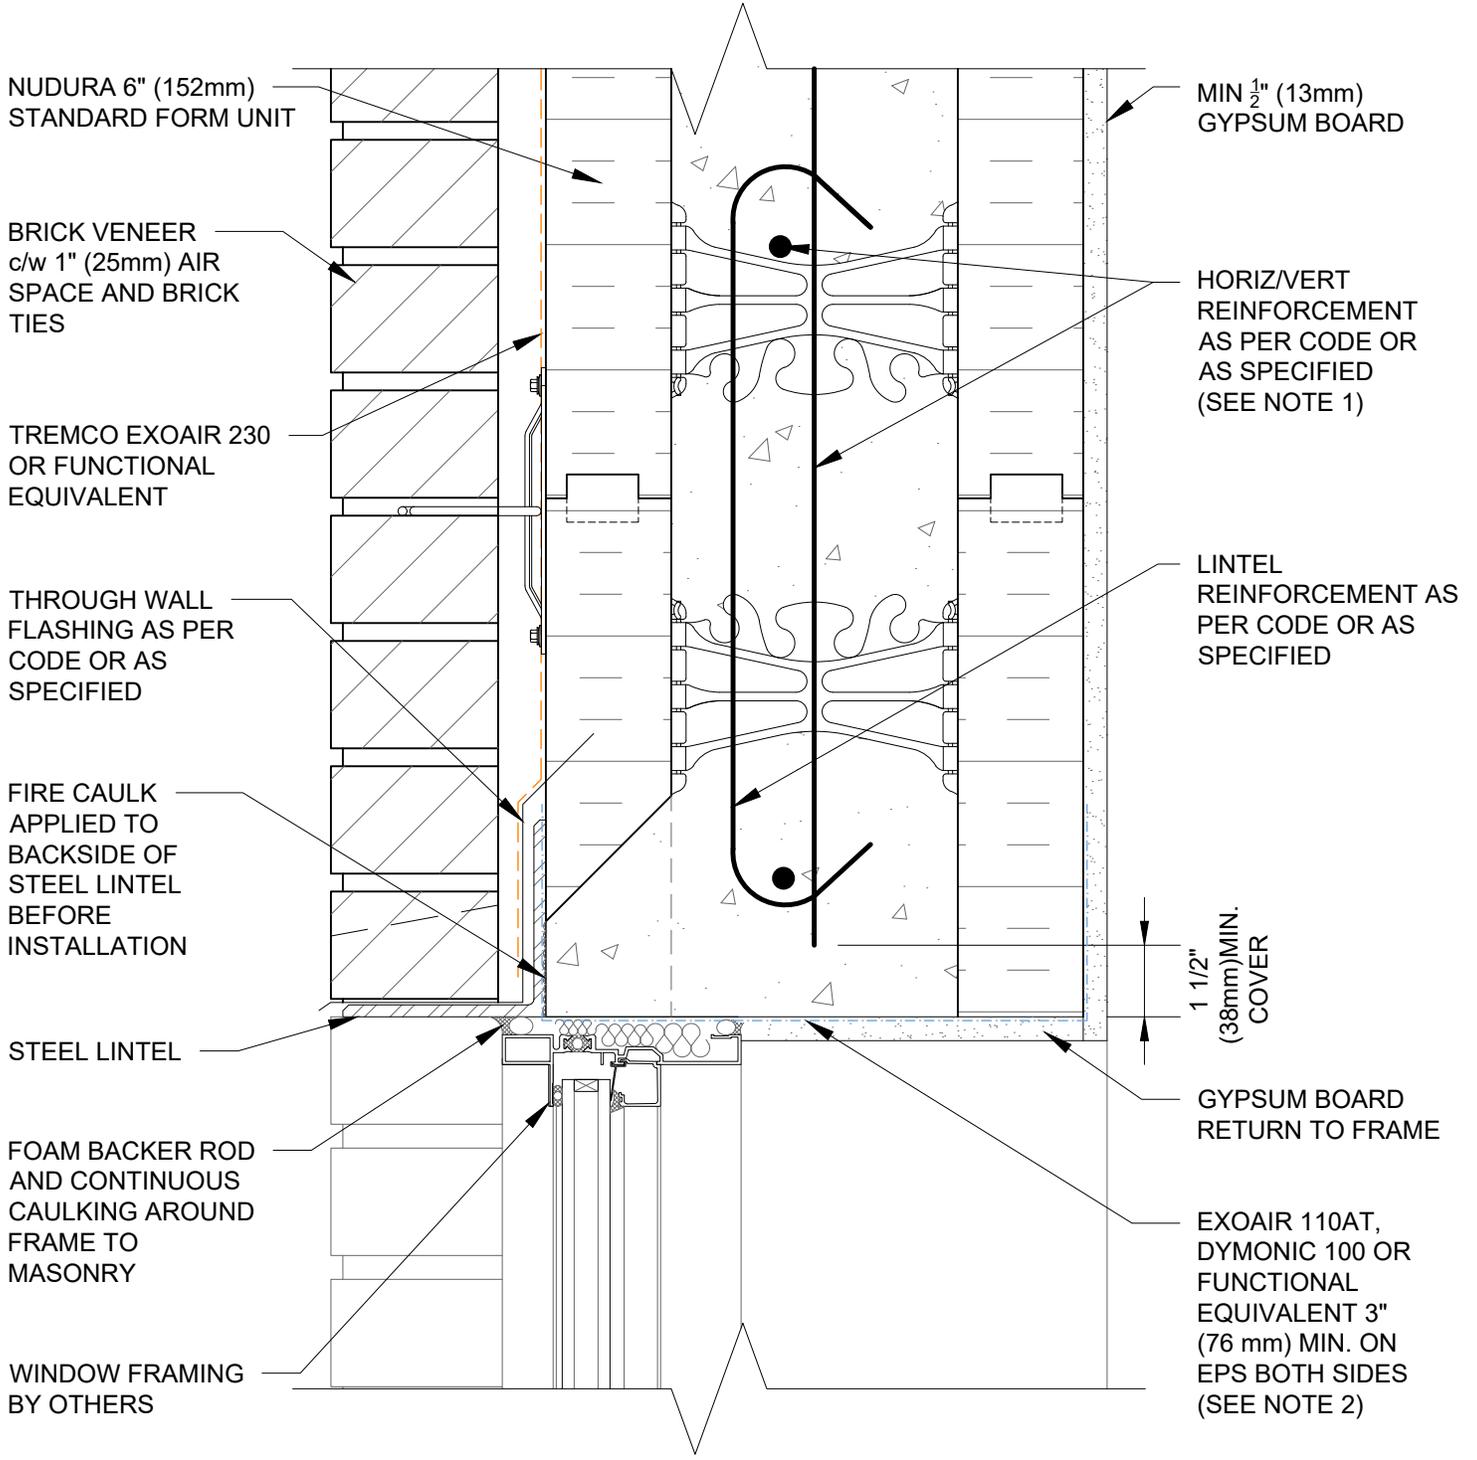

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, for Loose Fit Steel Lintel Compliant Openings, Brick Veneer Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 02	Revised by: KAB	Date: 3/13/2024

File Name:  
H6A04A



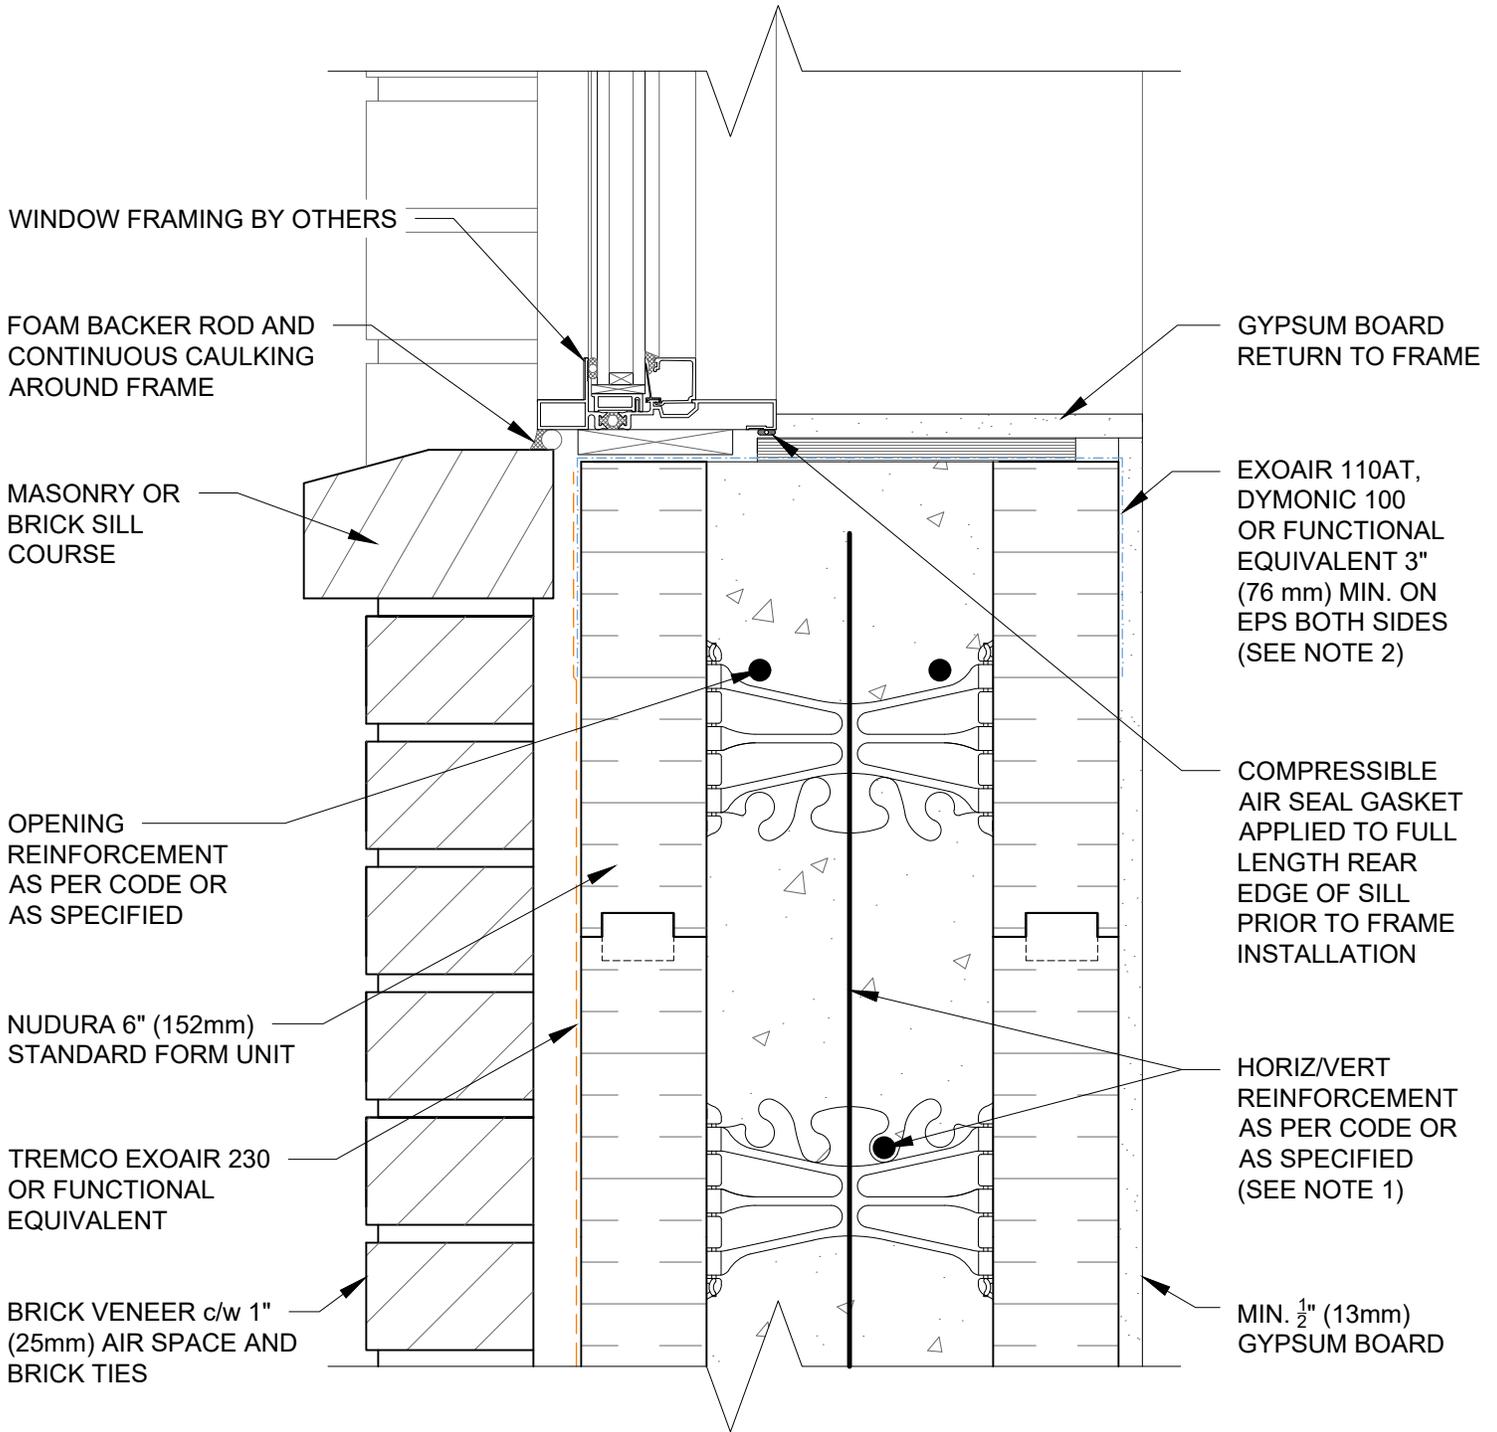

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Concrete Mounted, Brick Veneer Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6A05

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

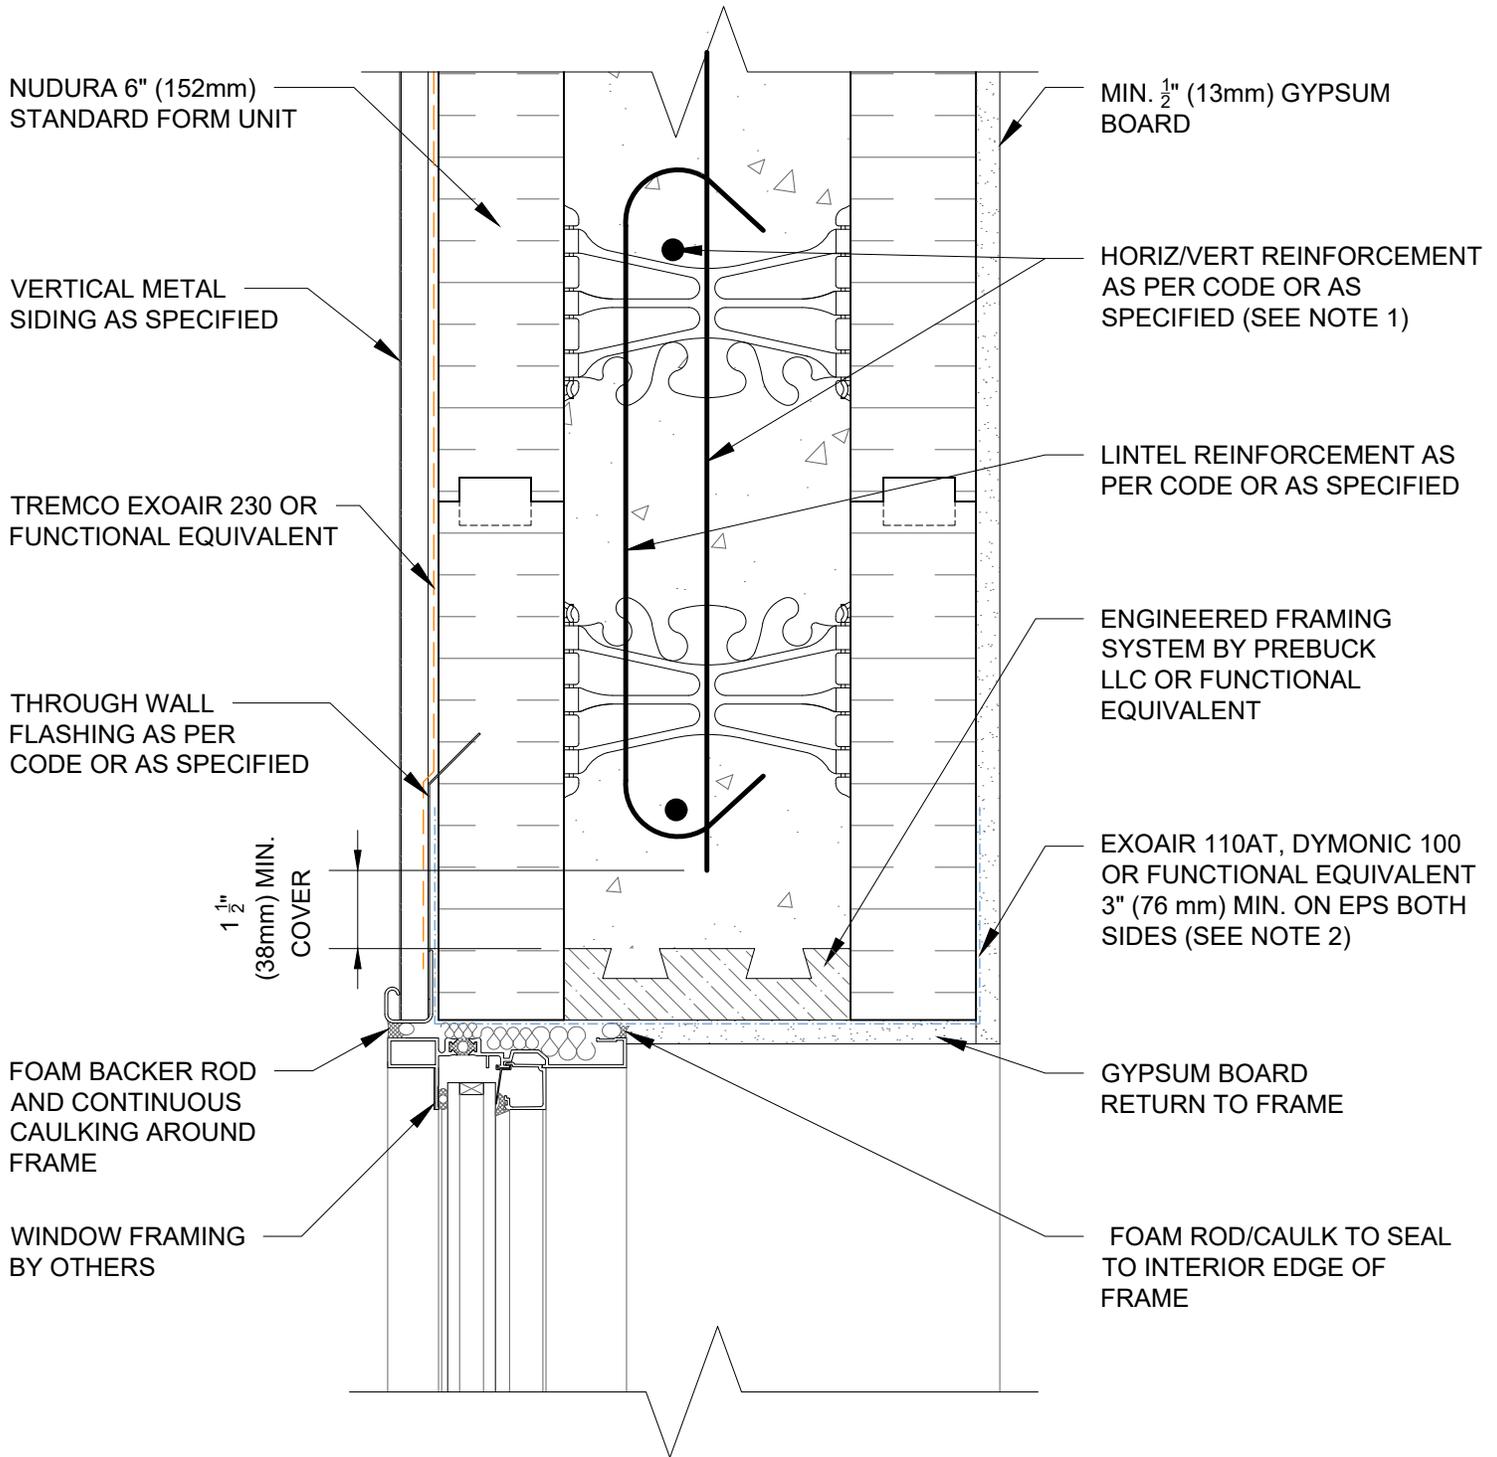

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Wood Rough Buck, Vertical Siding Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6B01

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

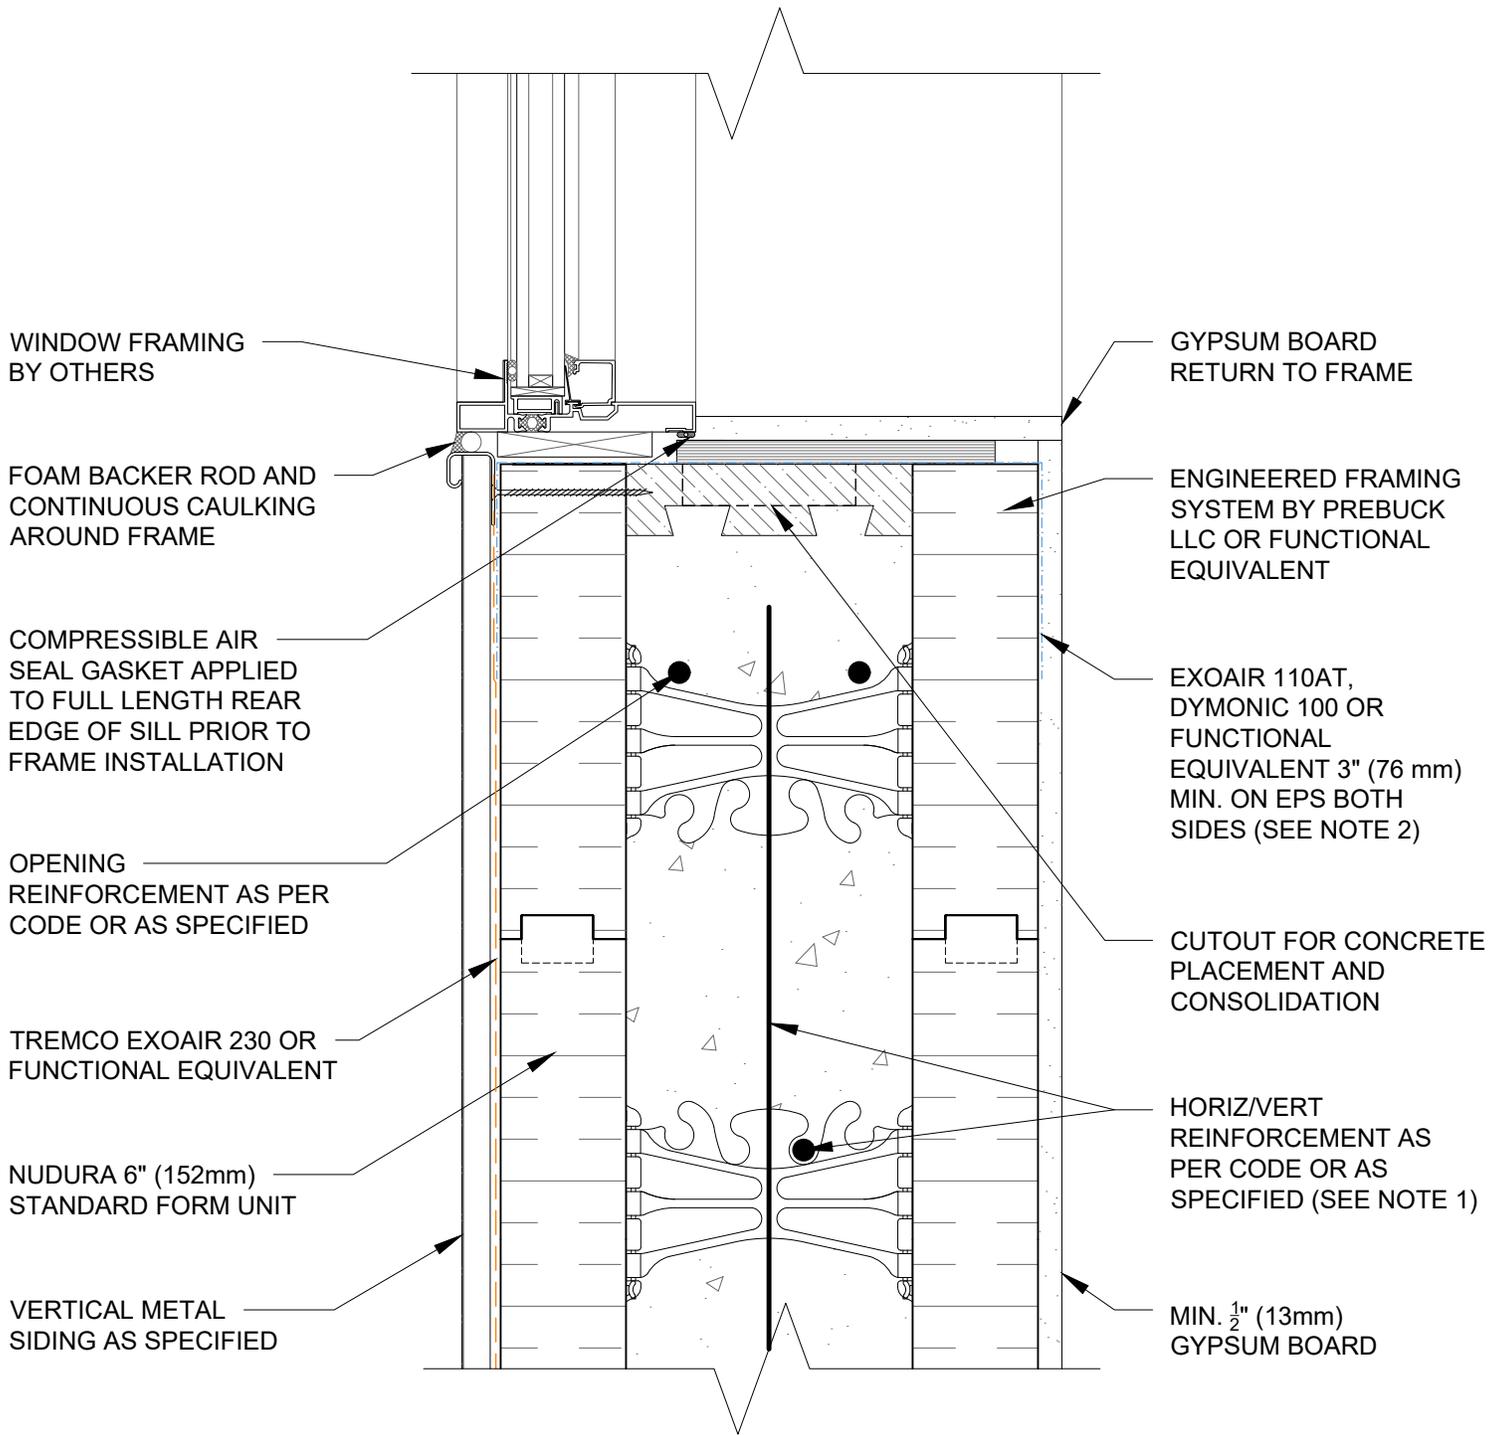

**NOTES:**

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Vertical Siding Finish

Drawn by: KS

Checked by: KS

Scale: 1:4

Revision #: 01


Revised by: KAB

Date: 3/13/2024

File Name:

H6B02



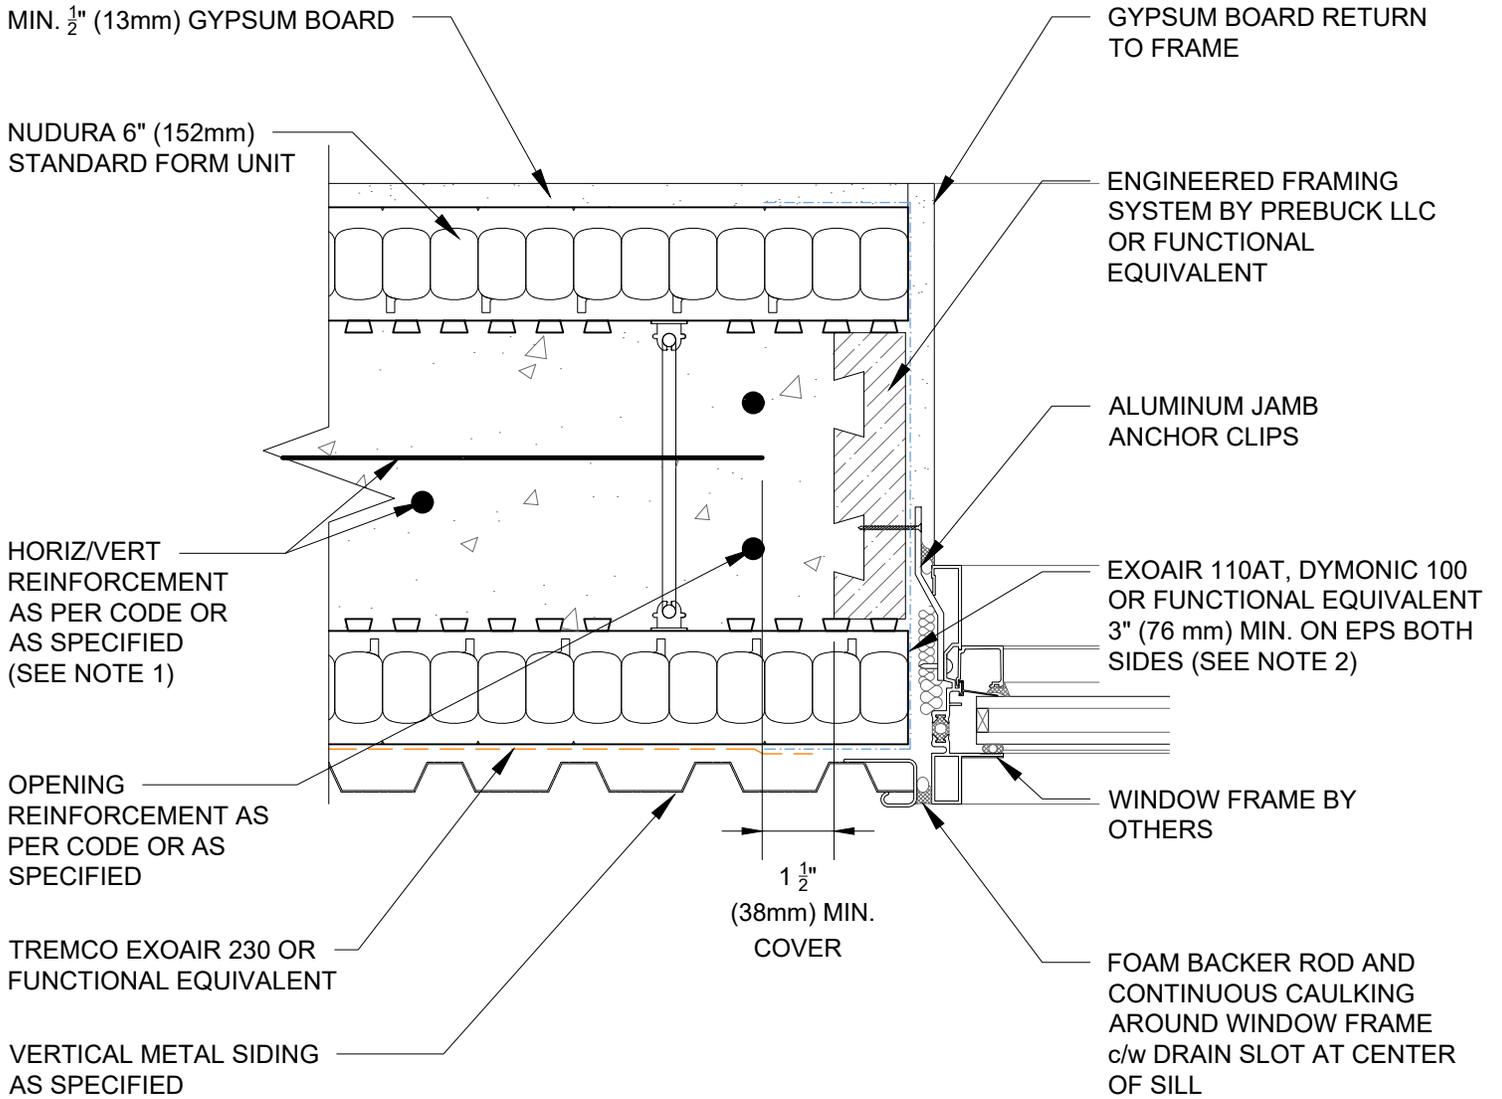

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Vertical Siding Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6B03



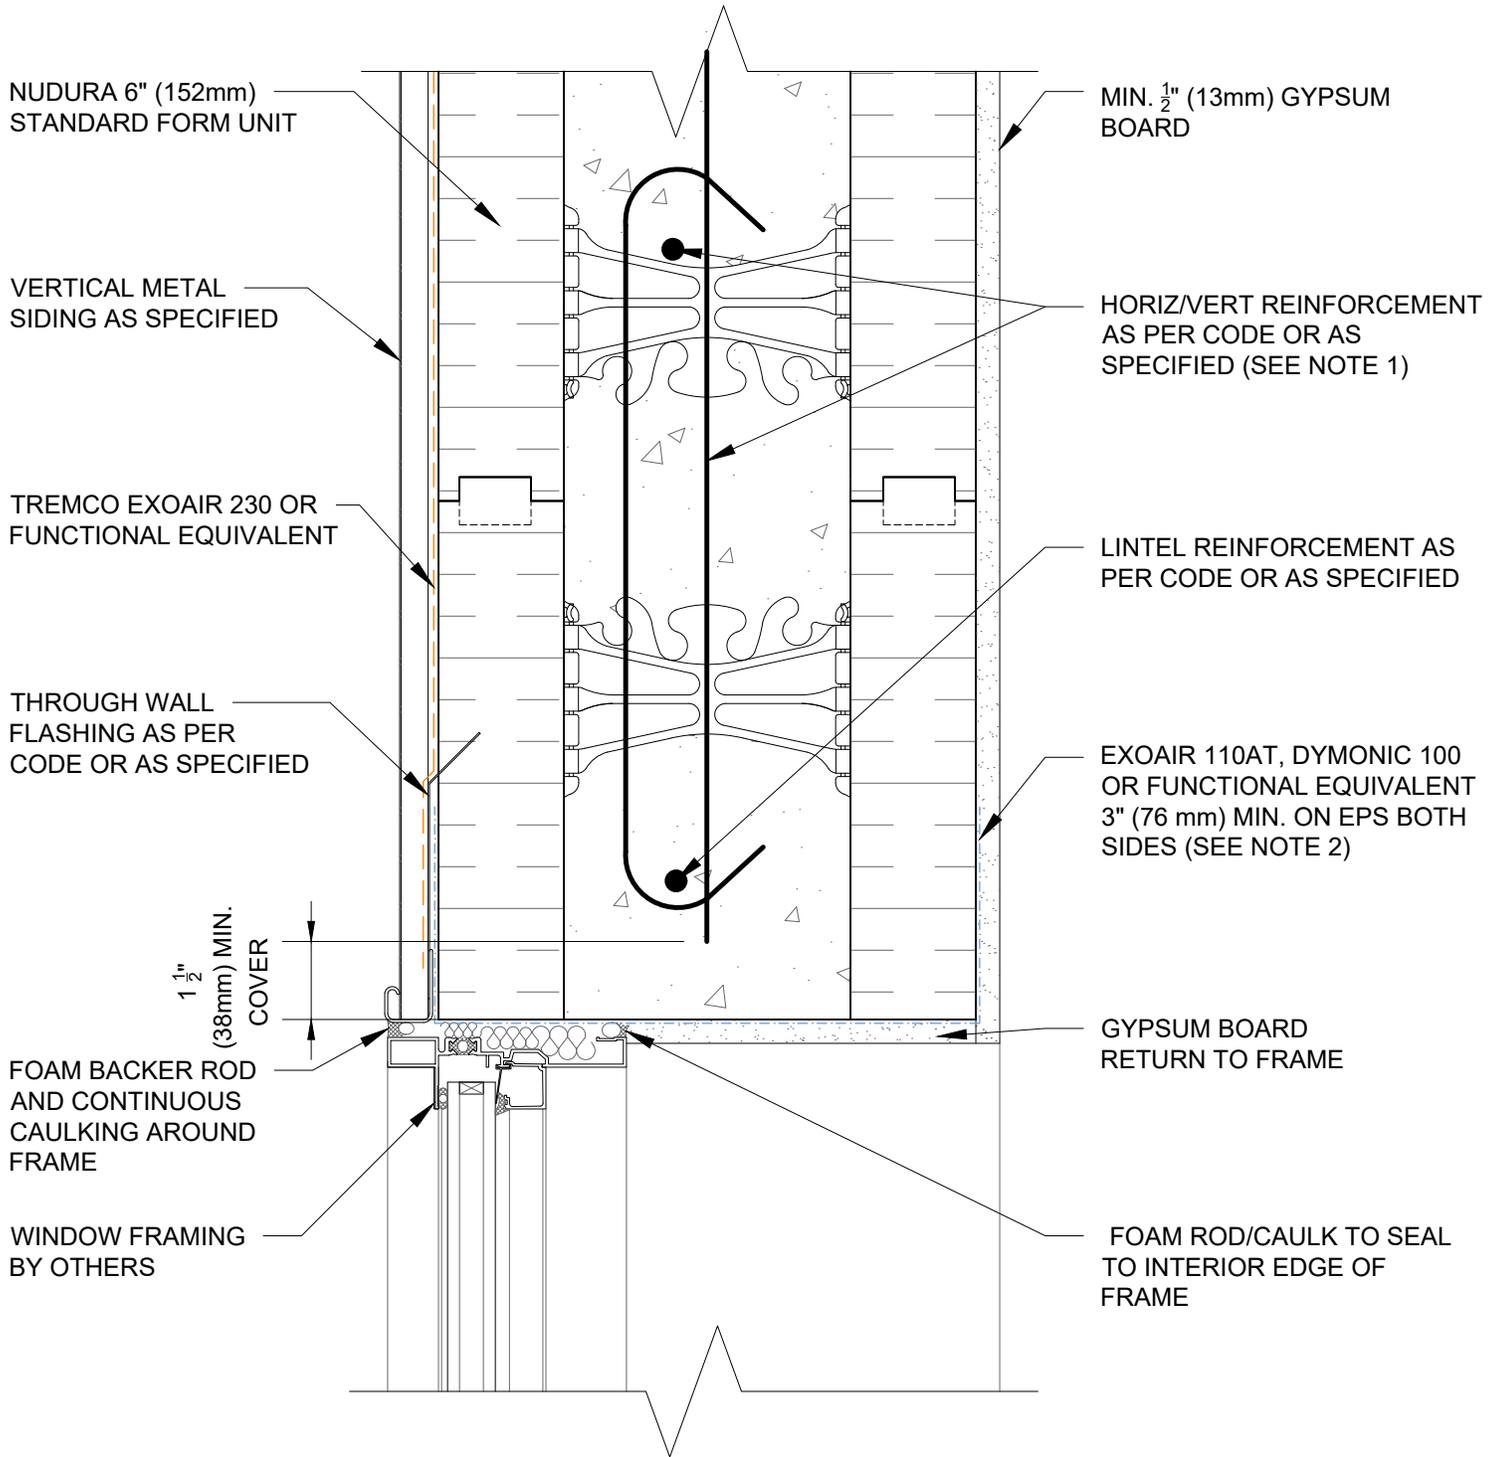

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Concrete Mounted, Vertical Siding Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6B04



WINDOW FRAMING  
BY OTHERS

GYPSUM BOARD  
RETURN TO FRAME

FOAM BACKER ROD AND  
CONTINUOUS CAULKING  
AROUND FRAME

COMPRESSIBLE AIR  
SEAL GASKET APPLIED  
TO FULL LENGTH REAR  
EDGE OF SILL PRIOR TO  
FRAME INSTALLATION

EXOAIR 110AT,  
DYMONIC 100 OR  
FUNCTIONAL  
EQUIVALENT 3" (76 mm)  
MIN. ON EPS BOTH  
SIDES (SEE NOTE 2)

OPENING  
REINFORCEMENT AS PER  
CODE OR AS SPECIFIED

HORIZ/VERT  
REINFORCEMENT AS  
PER CODE OR AS  
SPECIFIED (SEE NOTE 1)

TREMCO EXOAIR 230 OR  
FUNCTIONAL EQUIVALENT

NUDURA 6" (152mm)  
STANDARD FORM UNIT

MIN. 1/2" (13mm)  
GYPSUM BOARD

VERTICAL METAL  
SIDING AS SPECIFIED

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Concrete Mounted, Vertical Siding Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6B05

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

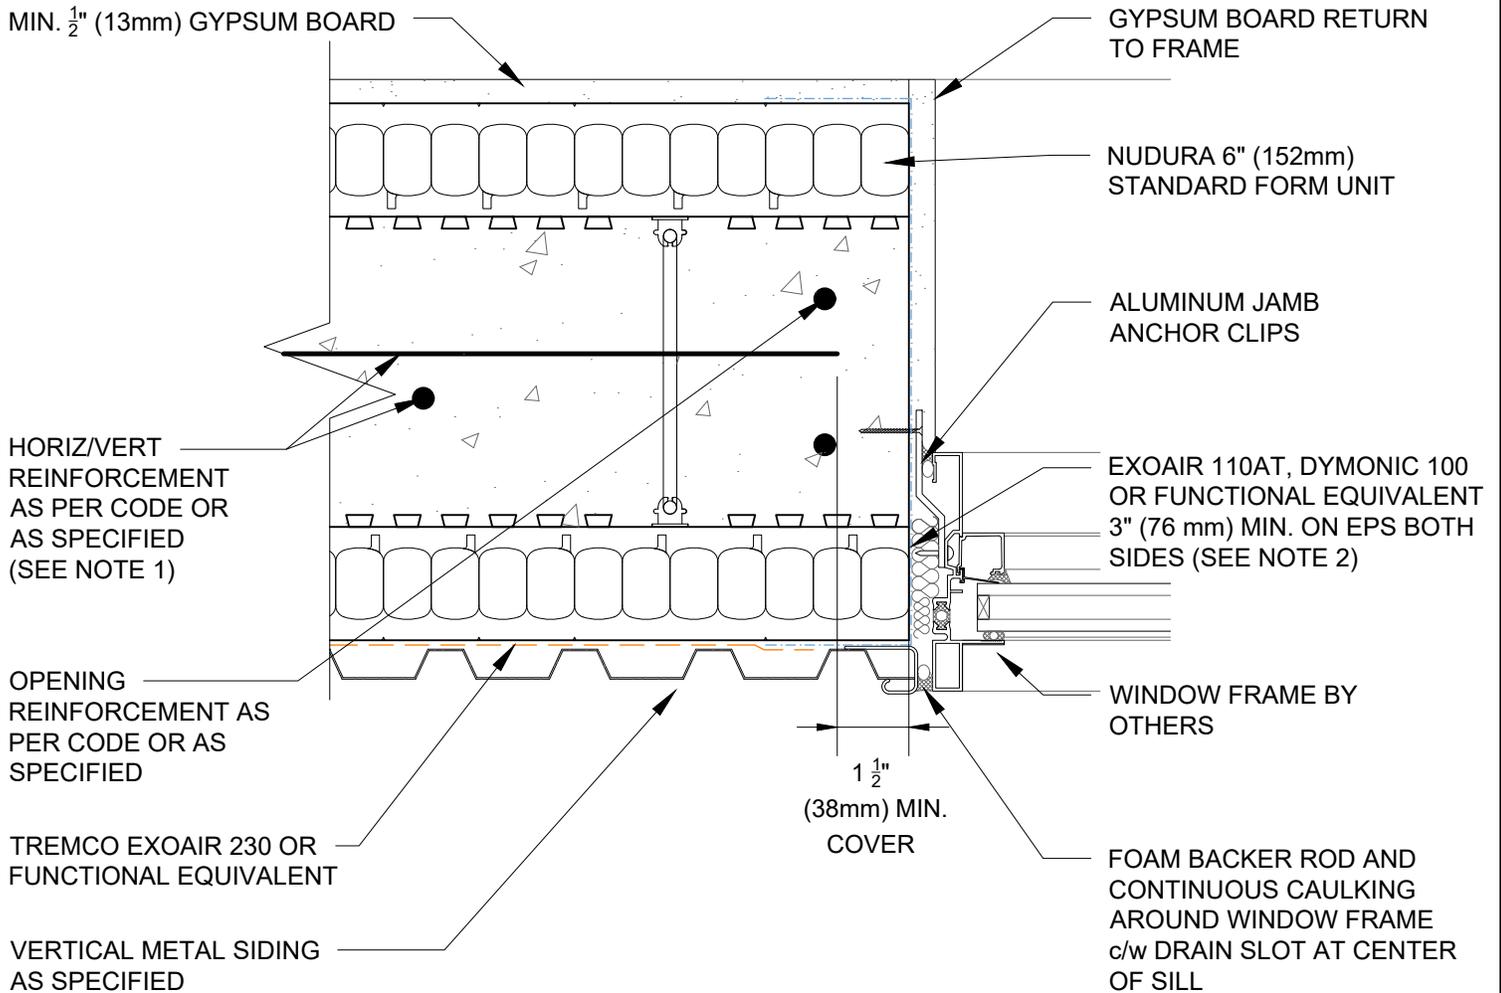

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows




Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Vertical Siding Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:

H6B06



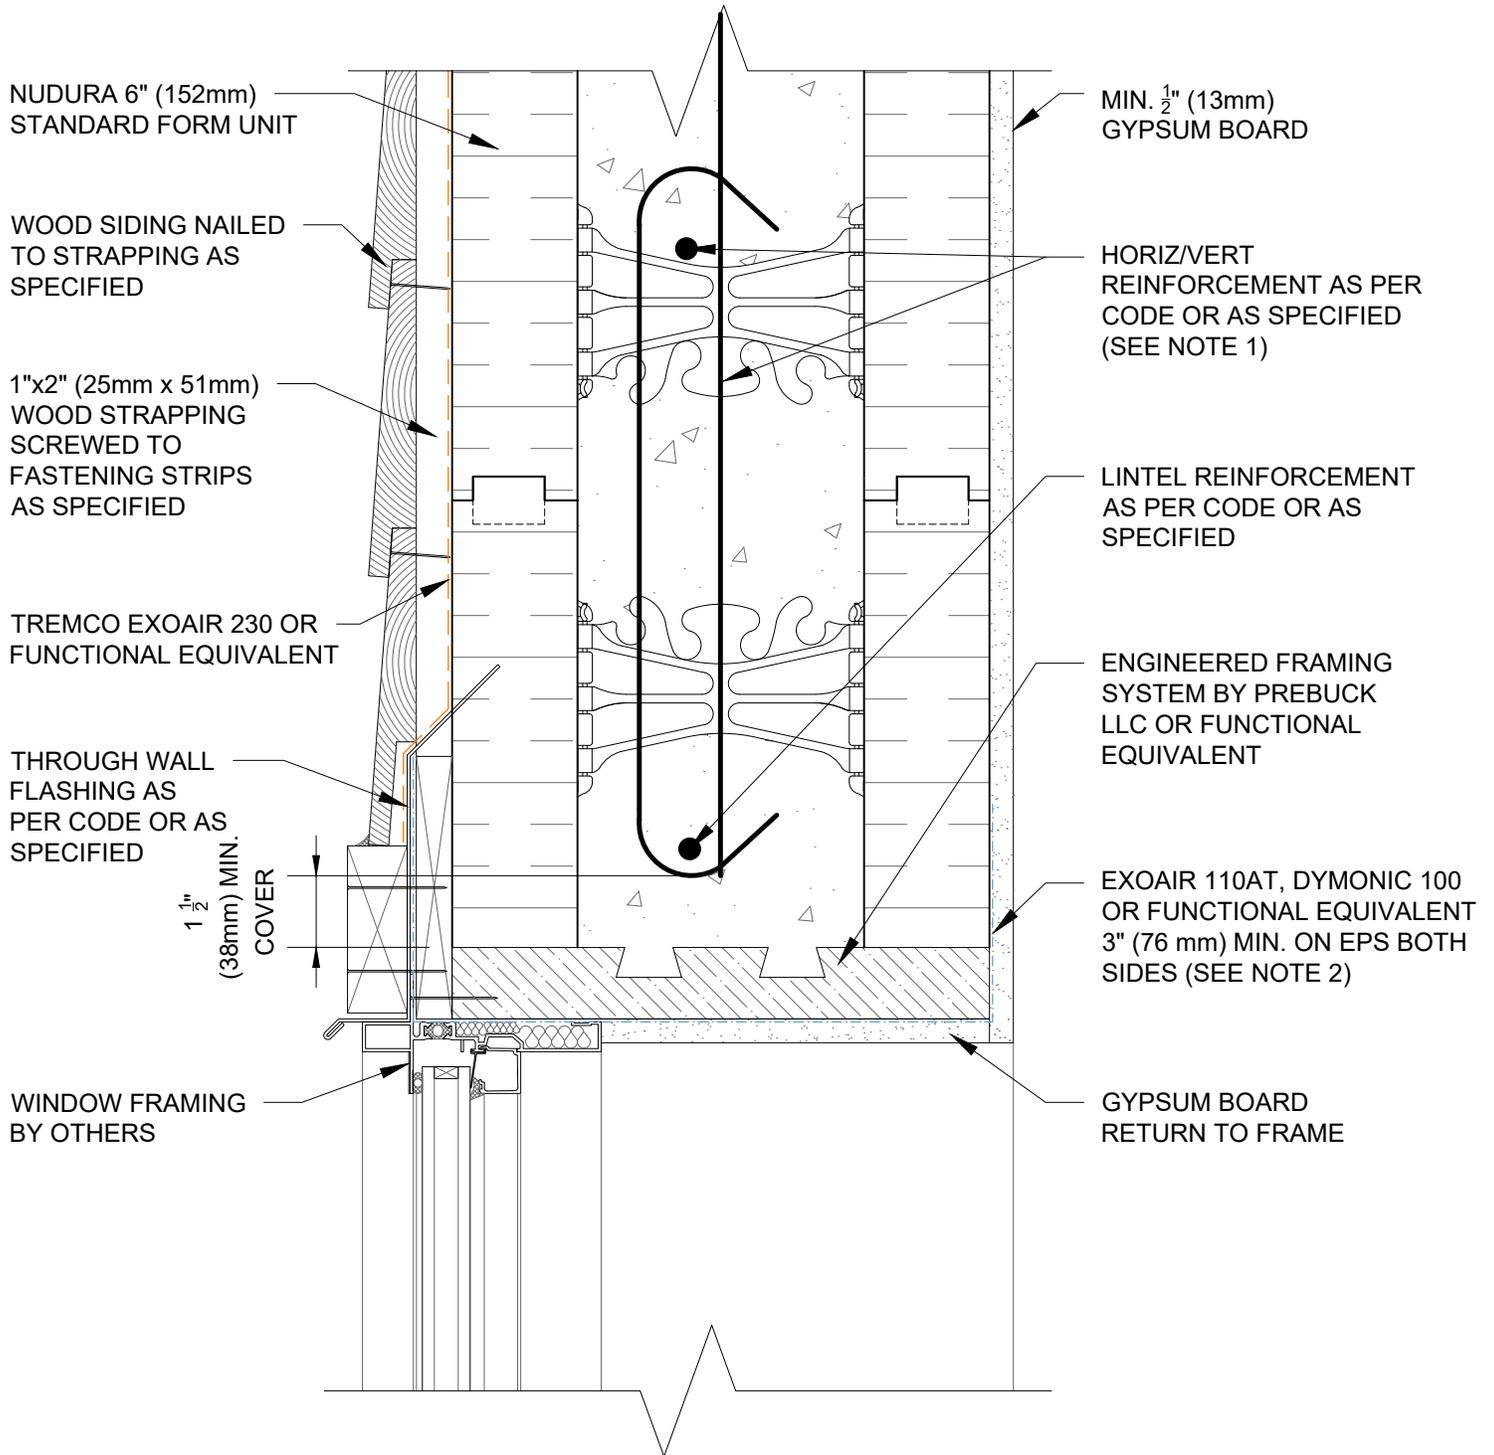

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Wood Rough Buck, Horizontal Wood Siding Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6B07



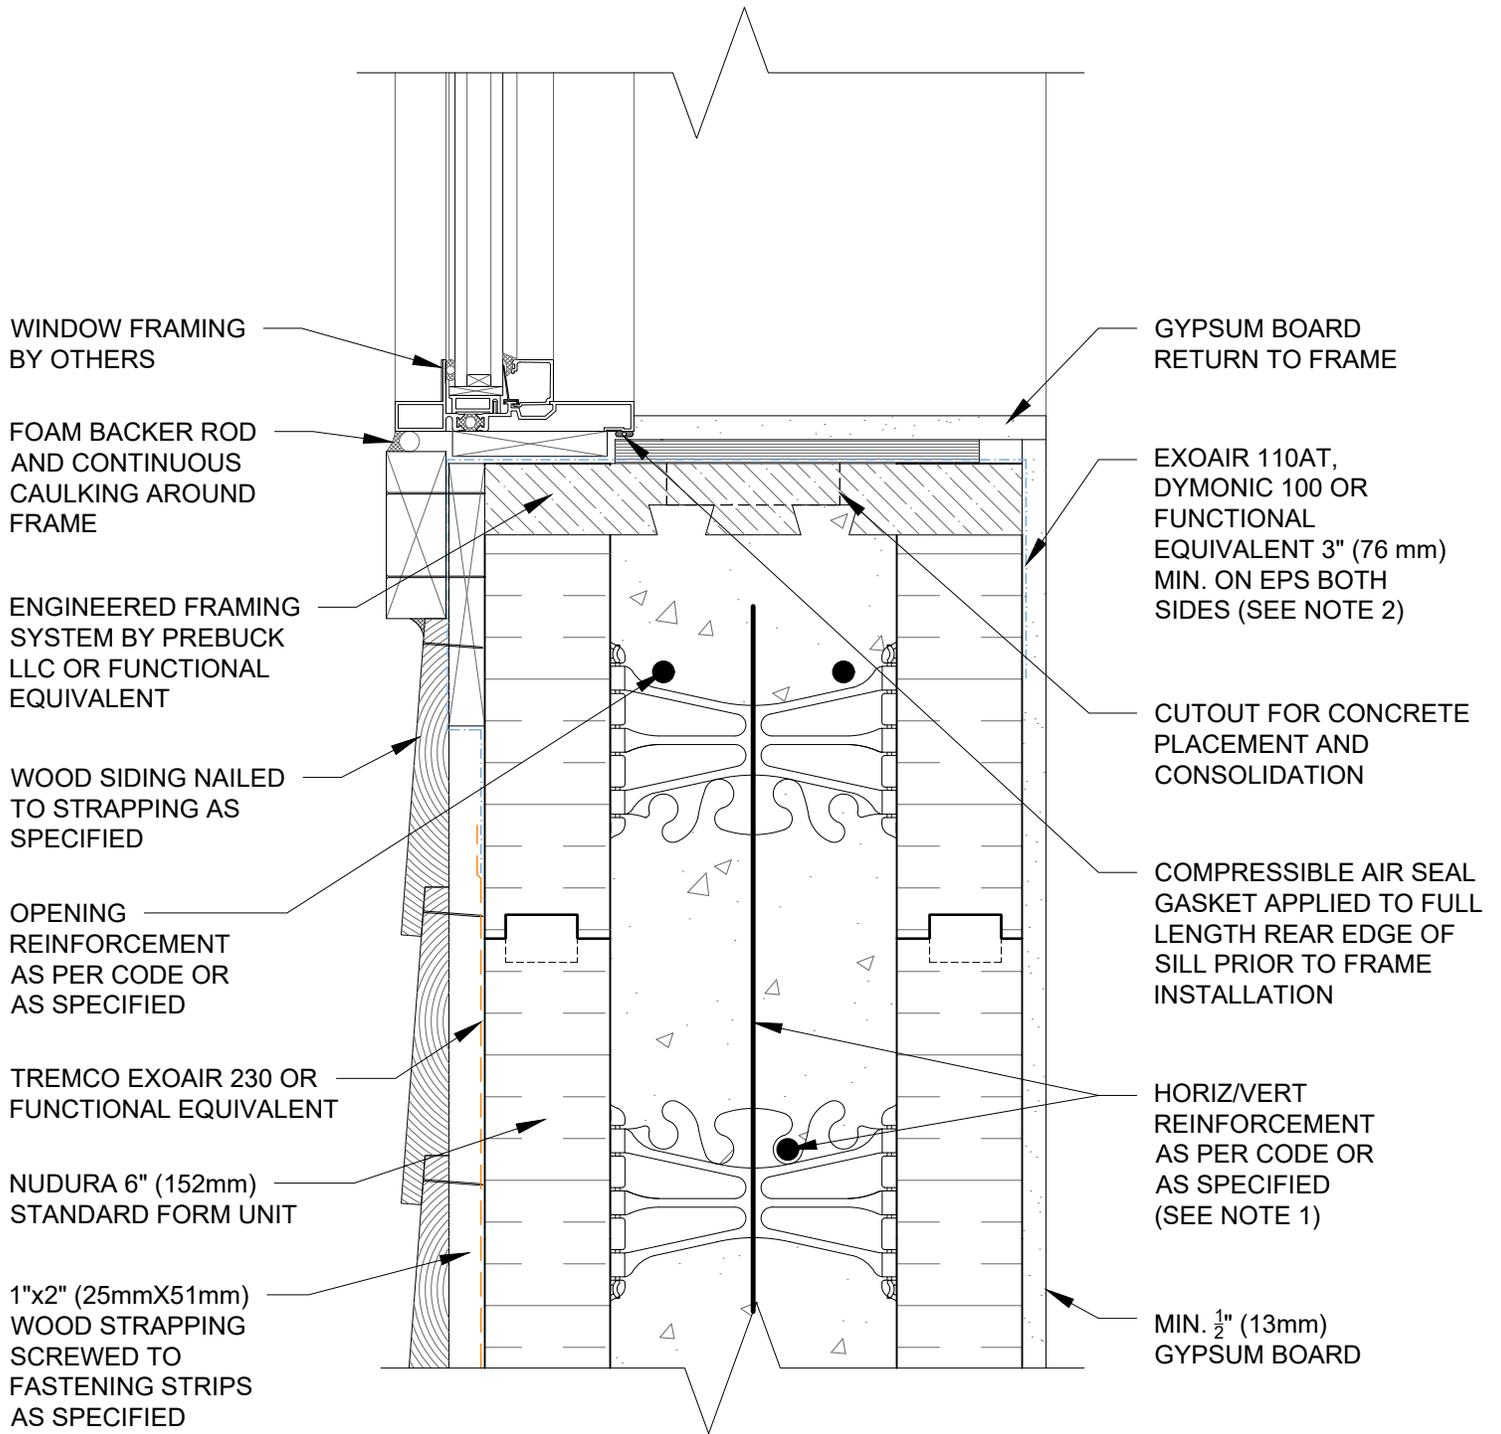

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Horizontal Wood Siding Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6B08

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

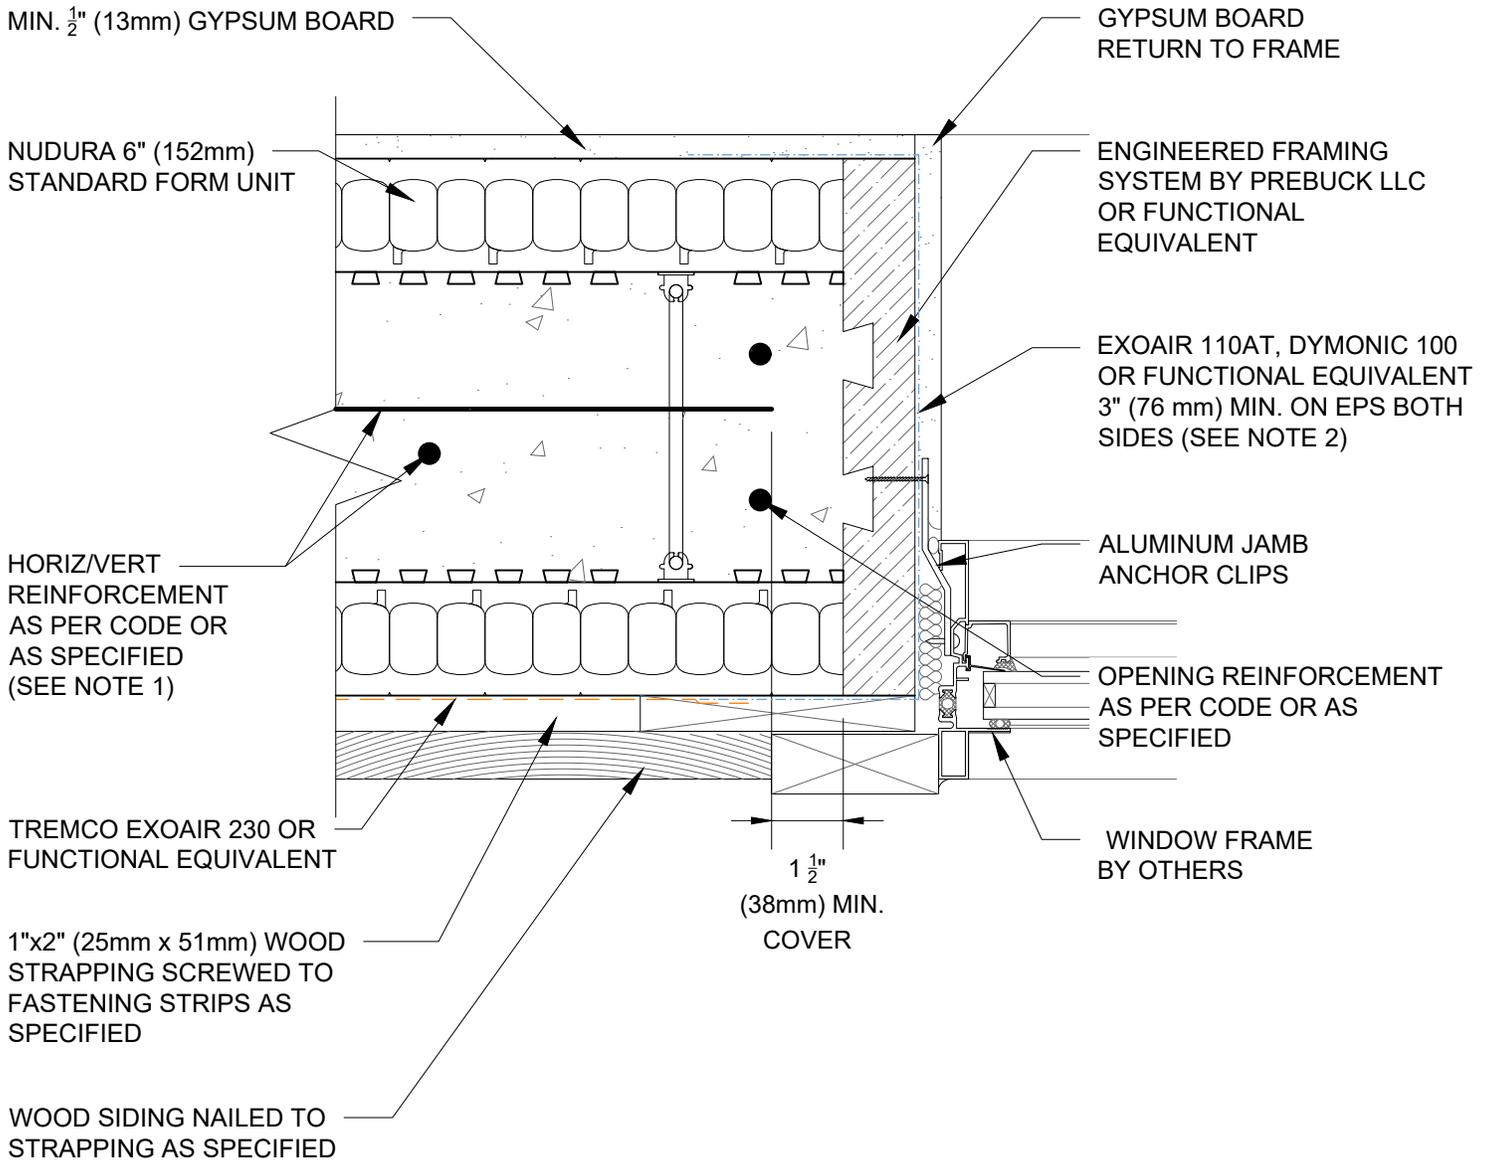

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**




Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Horizontal Wood Siding Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:

H6B09



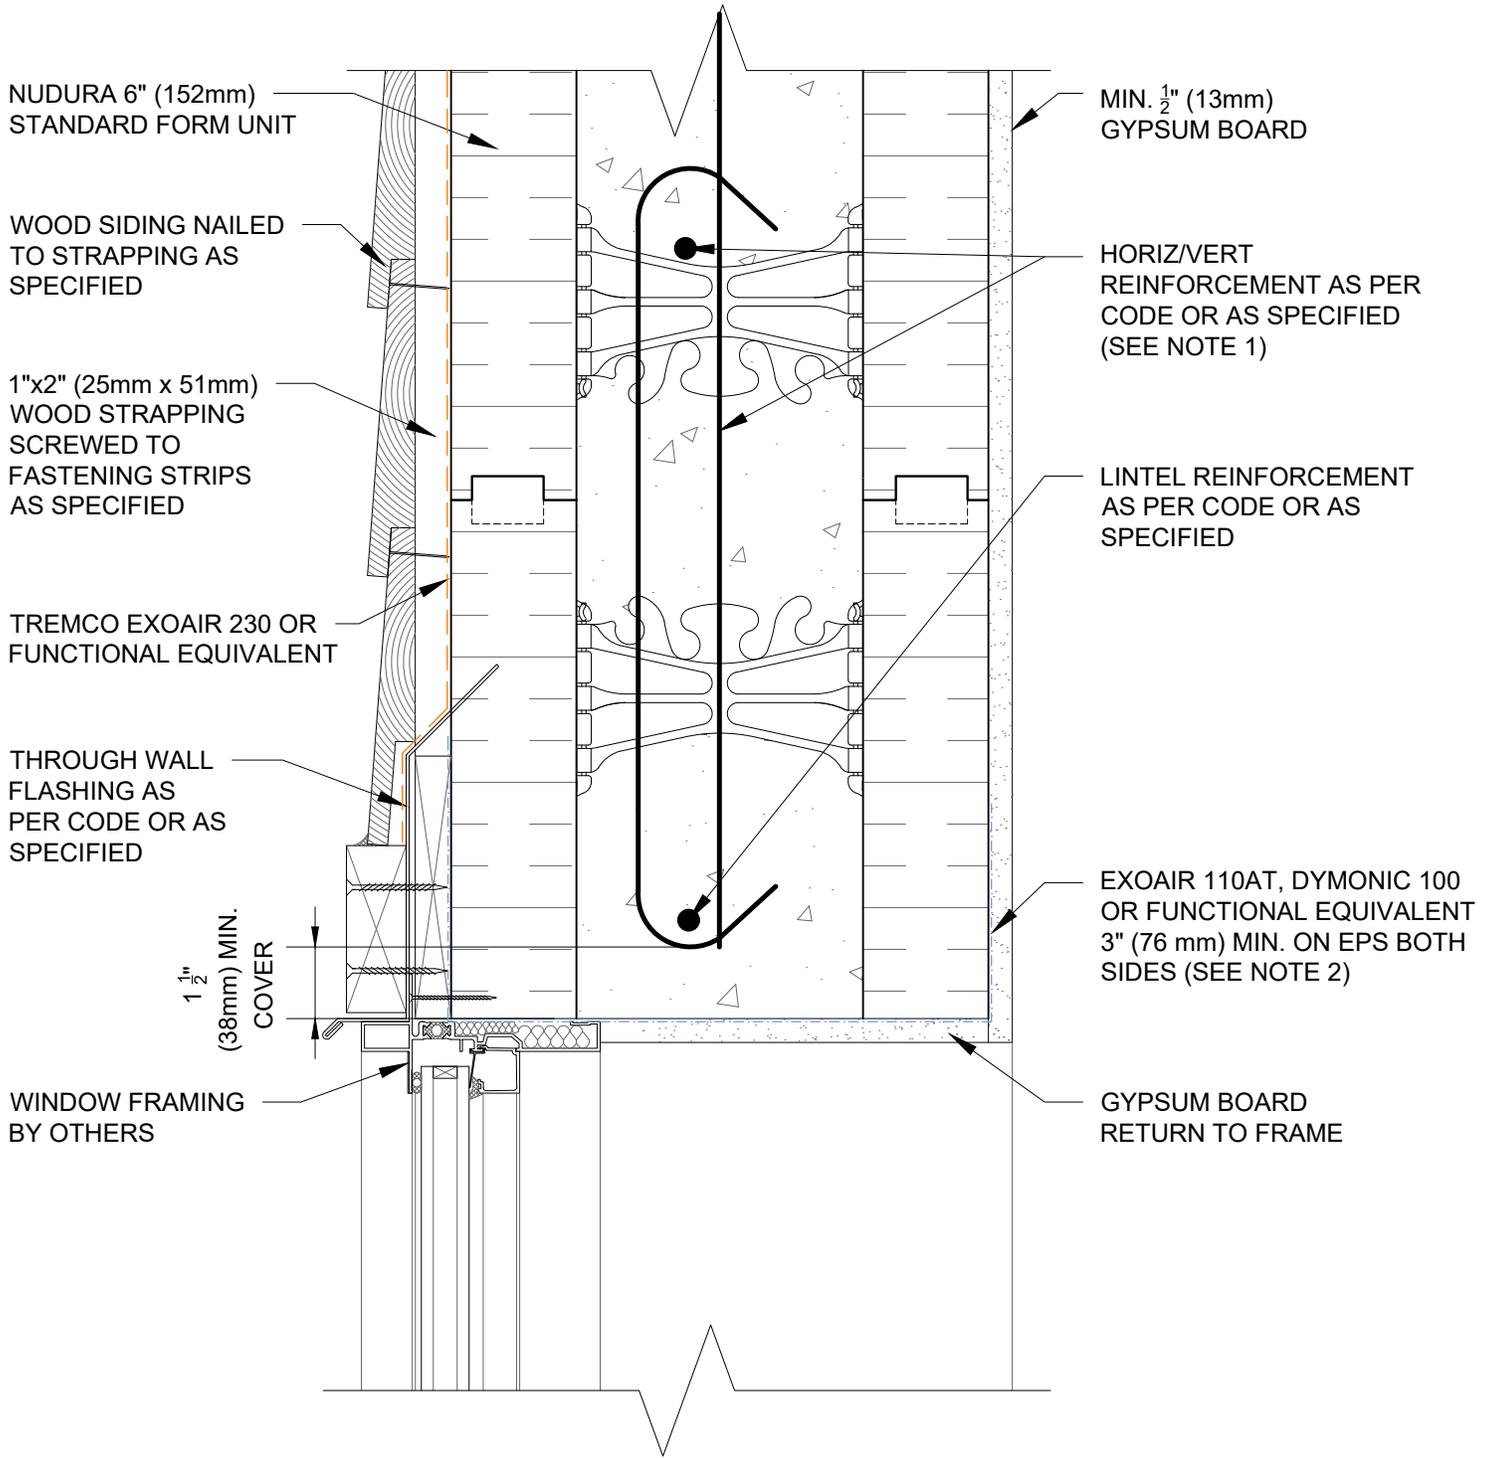

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Concrete Mounted, Horizontal Wood Siding Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6B10



WINDOW FRAMING BY OTHERS

FOAM BACKER ROD AND CONTINUOUS CAULKING AROUND FRAME

WOOD SIDING NAILED TO STRAPPING AS SPECIFIED

OPENING REINFORCEMENT AS PER CODE OR AS SPECIFIED

TREMCO EXOAIR 230 OR FUNCTIONAL EQUIVALENT

NUDURA 6" (152mm) STANDARD FORM UNIT

1"x2" (25mmX51mm) WOOD STRAPPING SCREWED TO FASTENING STRIPS AS SPECIFIED

GYPSUM BOARD RETURN TO FRAME

EXOAIR 110AT, DYMONIC 100 OR FUNCTIONAL EQUIVALENT 3" (76 mm) MIN. ON EPS BOTH SIDES (SEE NOTE 2)

COMPRESSIBLE AIR SEAL GASKET APPLIED TO FULL LENGTH REAR EDGE OF SILL PRIOR TO FRAME INSTALLATION

HORIZ/VERT REINFORCEMENT AS PER CODE OR AS SPECIFIED (SEE NOTE 1)

MIN. 1/2" (13mm) GYPSUM BOARD

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Concrete Mounted, Horizontal Wood Siding Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6B11

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

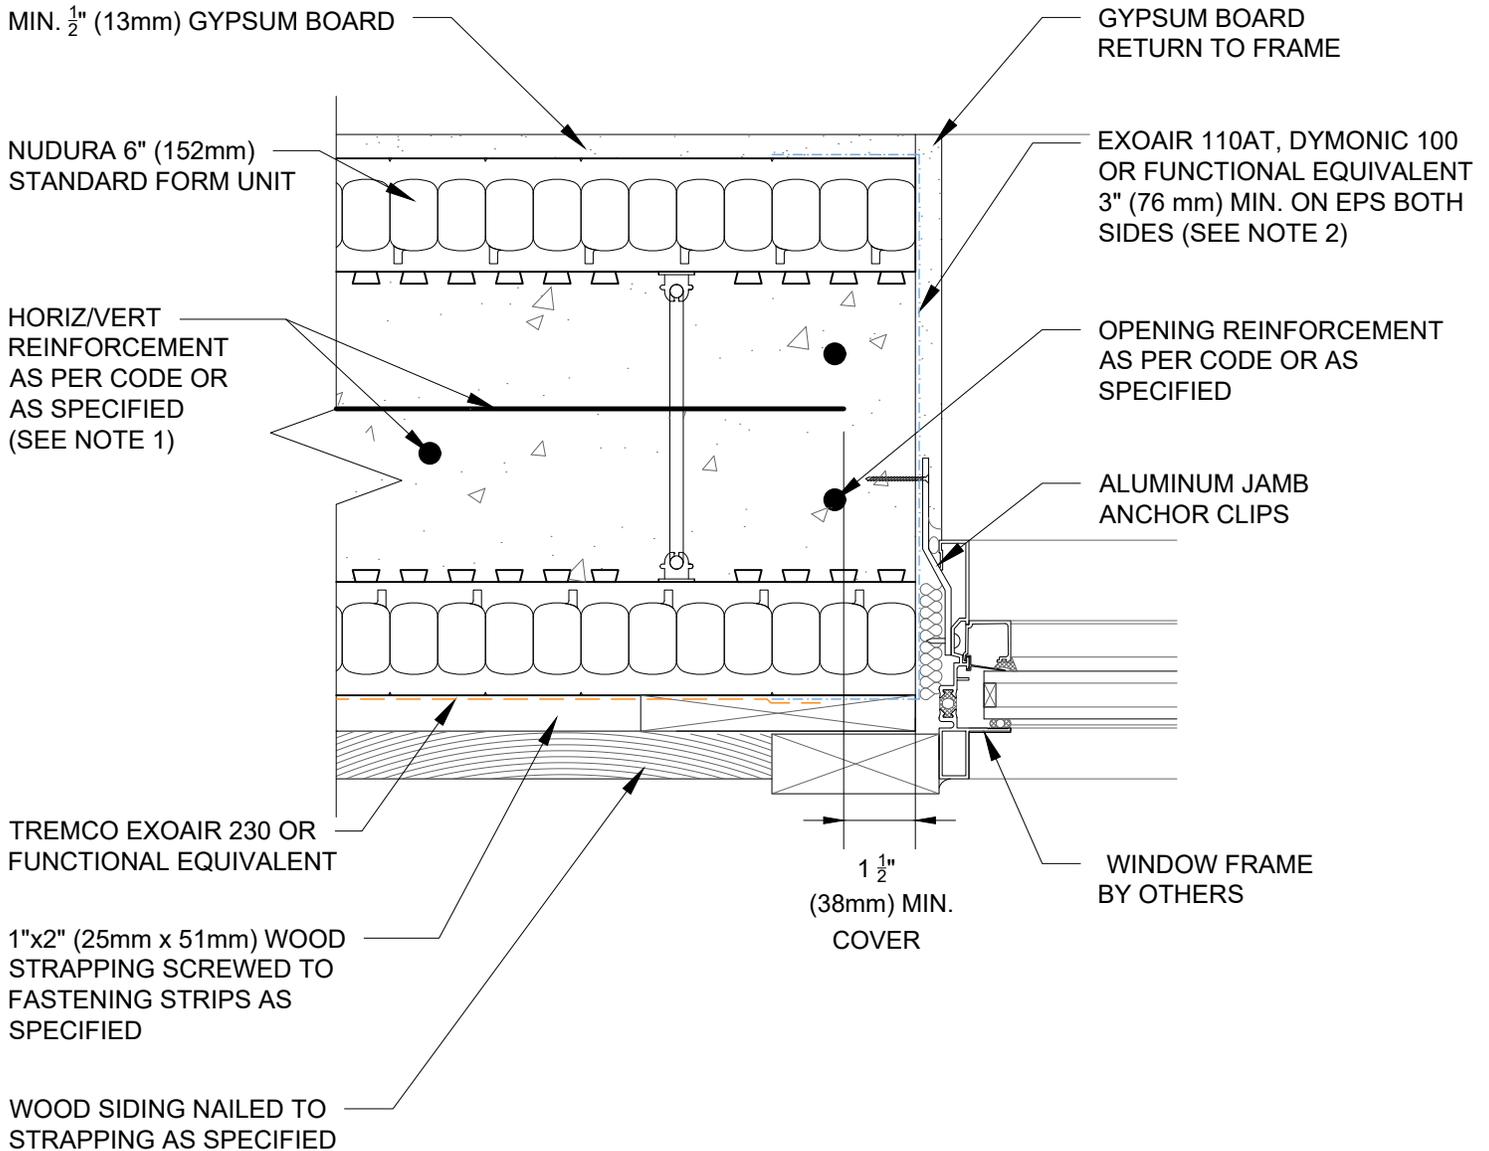

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Horizontal Wood Siding Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6B12

Revision #: 01

Revised by: KAB

Date: 3/13/2024



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

NUDURA 6" (152mm)  
STANDARD FORM UNIT

MIN. 1/2" (13mm)  
GYPSUM BOARD

DRYVIT TEXTURED  
ACRYLIC FINISH OR  
FUNCTIONAL  
EQUIVALENT

HORIZ/VERT  
REINFORCEMENT AS PER  
CODE OR AS SPECIFIED  
(SEE NOTE 1)

FASTEN MESH TO BUCK PRIOR  
TO PLACING BUCK AT HEAD  
CONDITION

LINTEL REINFORCEMENT  
AS PER CODE OR AS  
SPECIFIED

FOR MULTI-STOREY  
APPLICATIONS, MESH  
TO LAP BACK AROUND  
BUCK TO LINK W/  
CONCRETE

ENGINEERED FRAMING  
SYSTEM BY PREBUCK  
LLC OR FUNCTIONAL  
EQUIVALENT

1 1/2"  
(38mm) MIN.  
COVER

GYPSUM BOARD  
RETURN TO FRAME

FOAM BACKER ROD AND  
CONTINUOUS CAULKING  
AROUND FRAME

EXOAIR 110AT, DYMONIC  
100 OR FUNCTIONAL  
EQUIVALENT 3" MIN. ON  
INTERIOR SIDE OF EPS  
c/w FOAM ROD/CAULK  
OR SEAL TO INTERIOR  
EDGE OF FRAME

WINDOW FRAMING  
BY OTHERS

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window,  
Wood Rough Buck, Direct Applied Acrylic Finish

Drawn by: KS

Checked by: KS

Scale: 1:4

Revision #: 01

Revised by: KAB

Date: 3/13/2024


File Name:

H6C01



Construction Products Group

www.tremcocpg.com

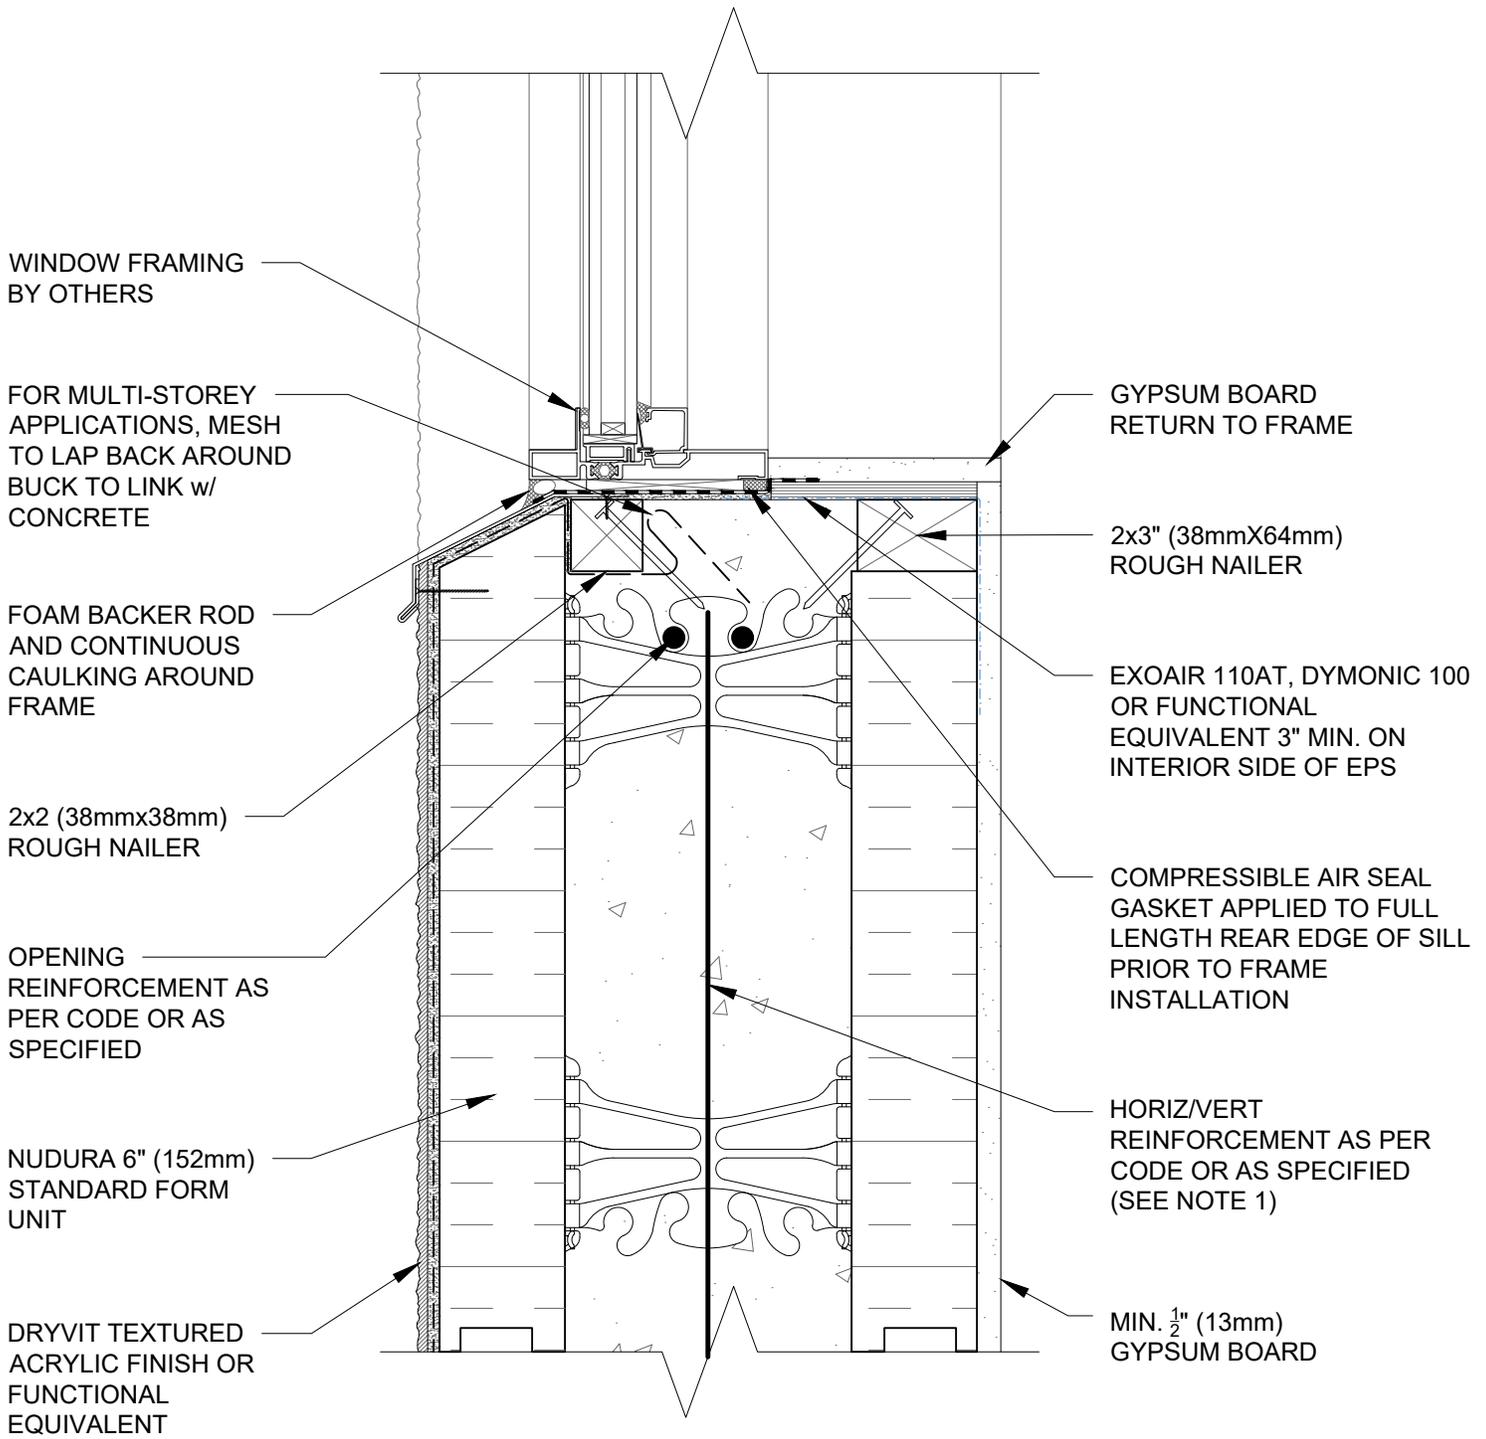

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Direct Applied Acrylic Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:
H6C02



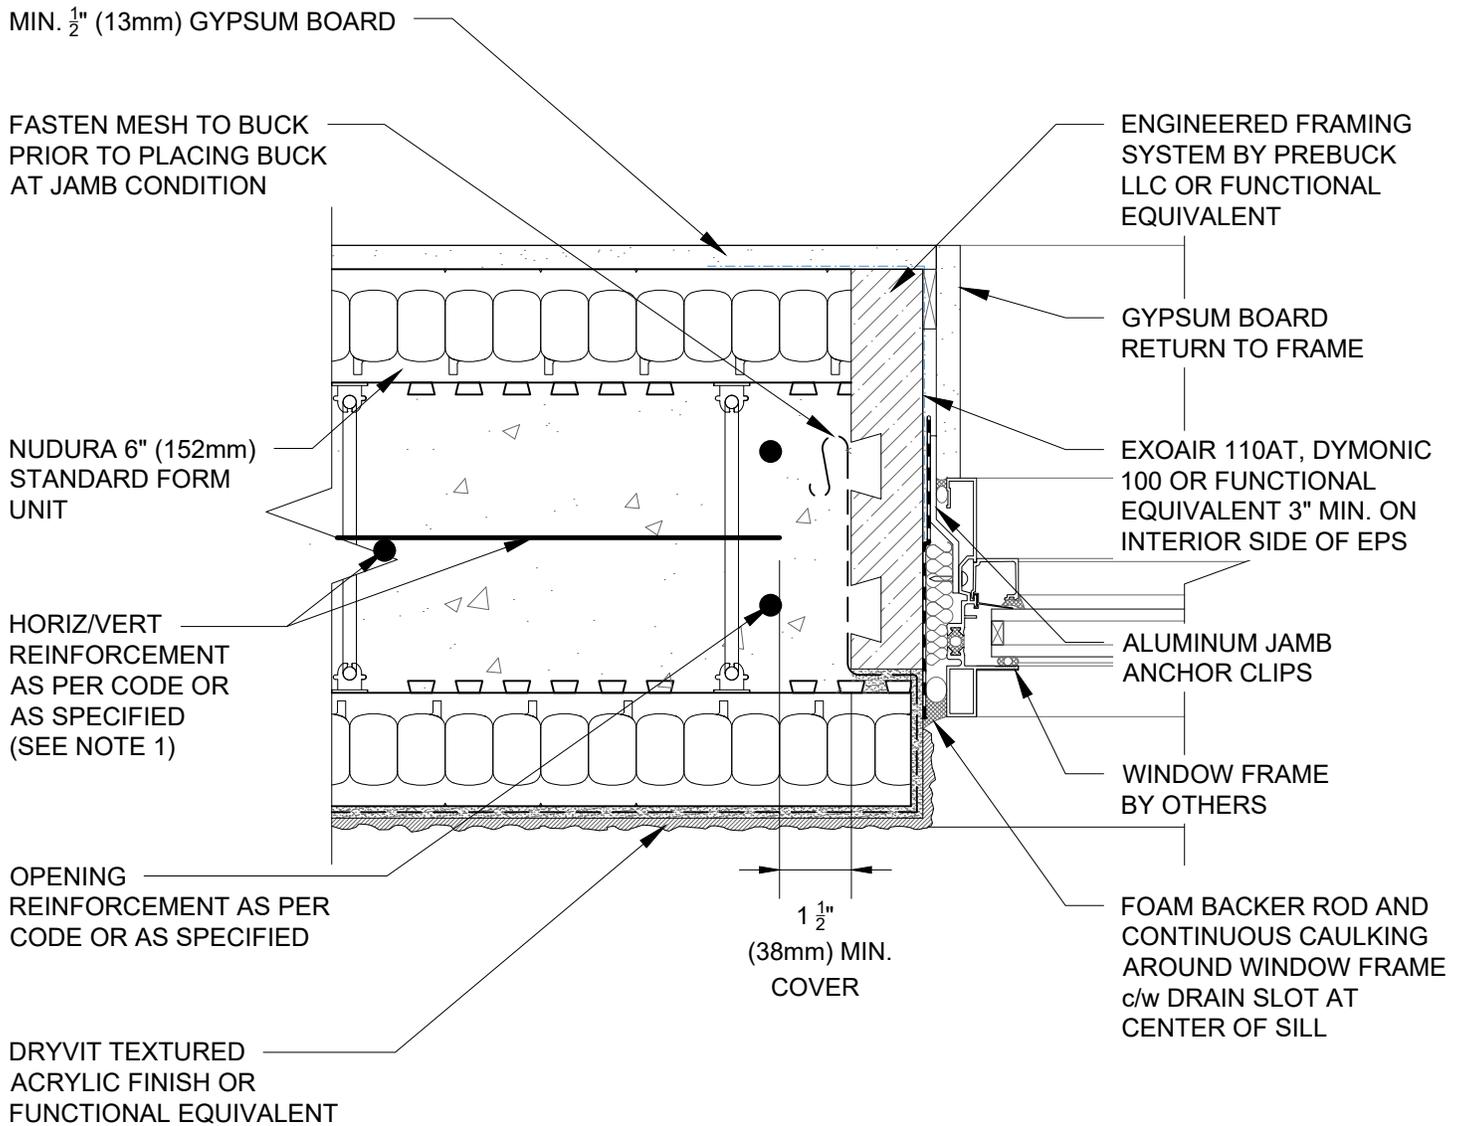

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows




Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Direct Applied Acrylic Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:

H6C03



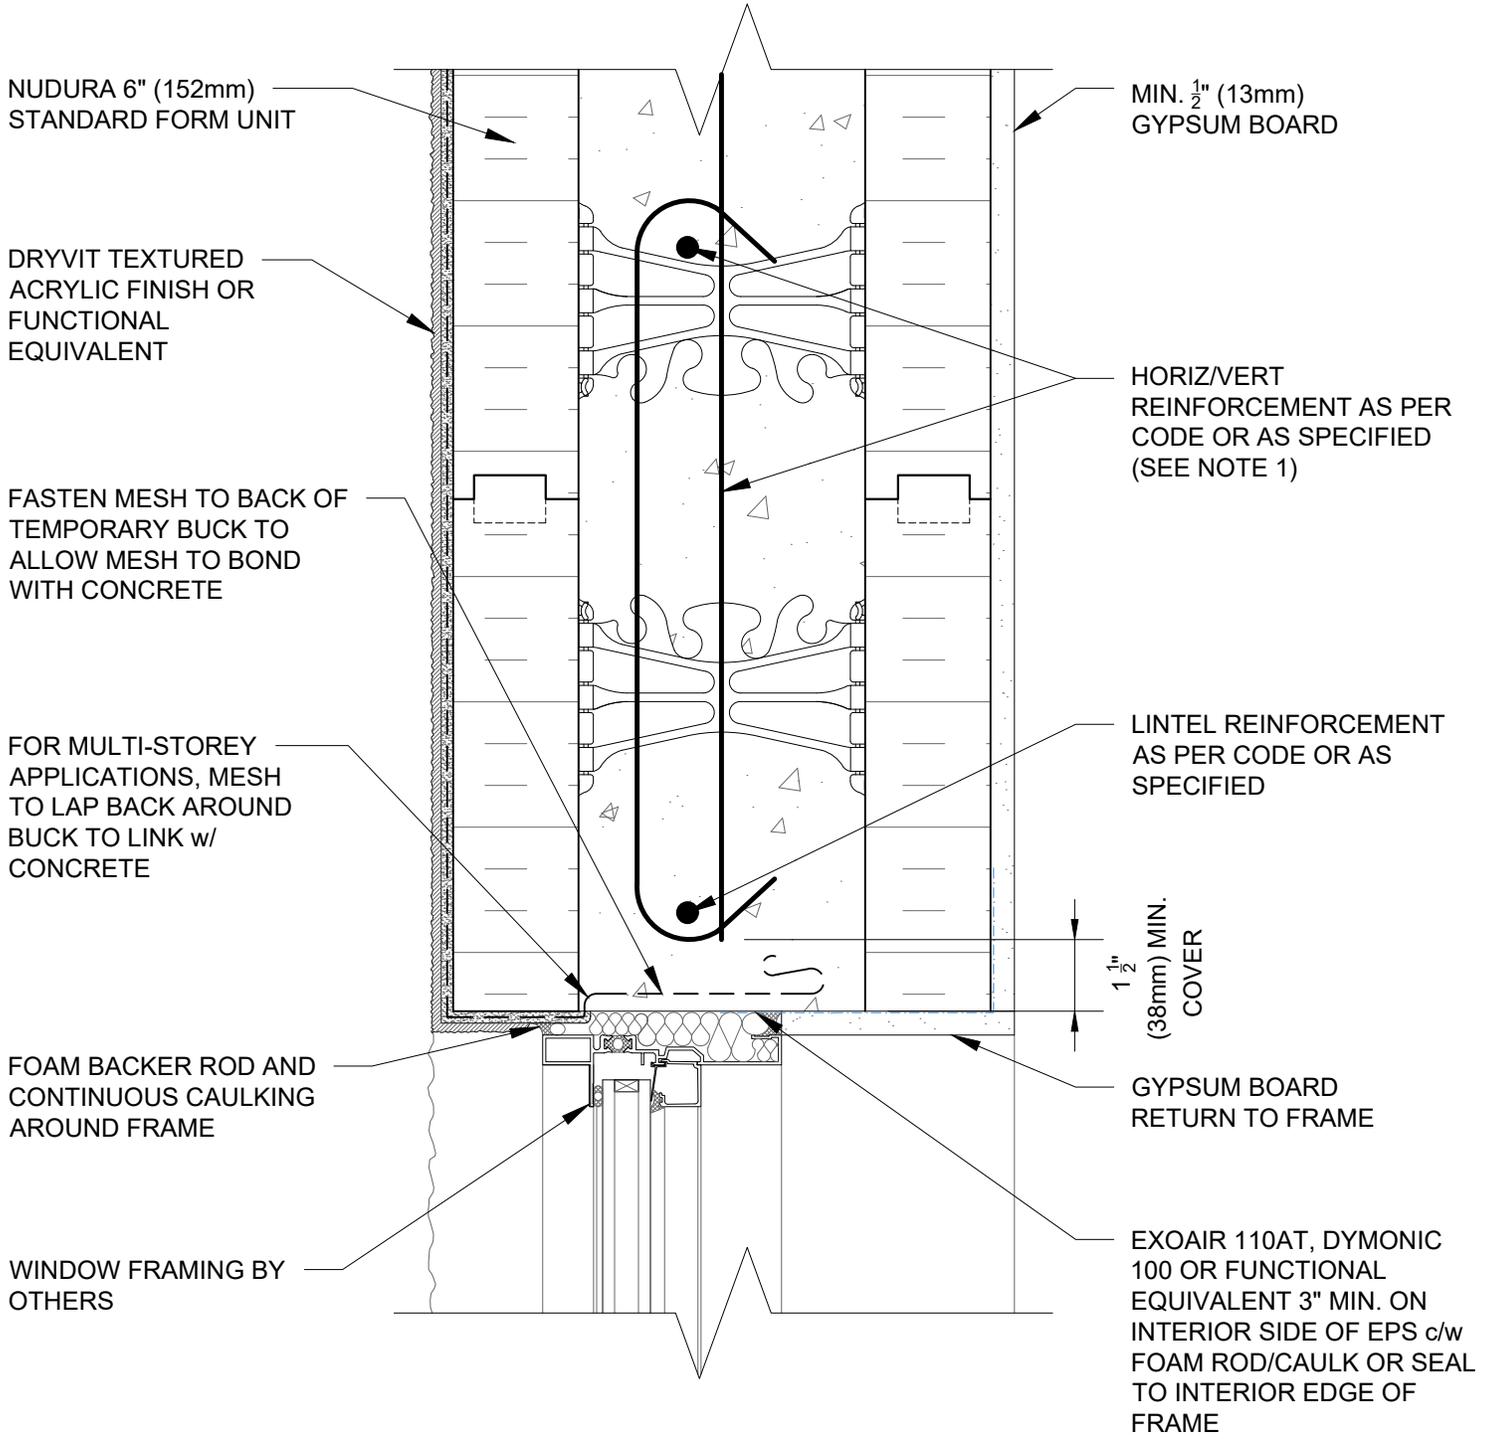

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6C04



WINDOW FRAMING  
BY OTHERS

FOR MULTI-STOREY  
APPLICATIONS, MESH TO  
LAP BACK AROUND BUCK  
TO LINK w/ CONCRETE

FOAM BACKER ROD  
AND CONTINUOUS  
CAULKING AROUND  
FRAME

OPENING  
REINFORCEMENT AS  
PER CODE OR AS  
SPECIFIED

NUDURA 6" (152mm)  
STANDARD FORM UNIT

DRYVIT TEXTURED  
ACRYLIC FINISH OR  
FUNCTIONAL  
EQUIVALENT

GYPSUM BOARD RETURN  
TO FRAME

EXOAIR 110AT, DYMONIC 100  
OR FUNCTIONAL  
EQUIVALENT 3" MIN. ON  
INTERIOR SIDE OF EPS

COMPRESSIBLE AIR SEAL  
GASKET APPLIED TO FULL  
LENGTH REAR EDGE OF  
SILL PRIOR TO FRAME  
INSTALLATION

HORIZ/VERT  
REINFORCEMENT AS PER  
CODE OR AS SPECIFIED  
(SEE NOTE 1)

MIN. 1/2" (13mm)  
GYPSUM BOARD

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6C05

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

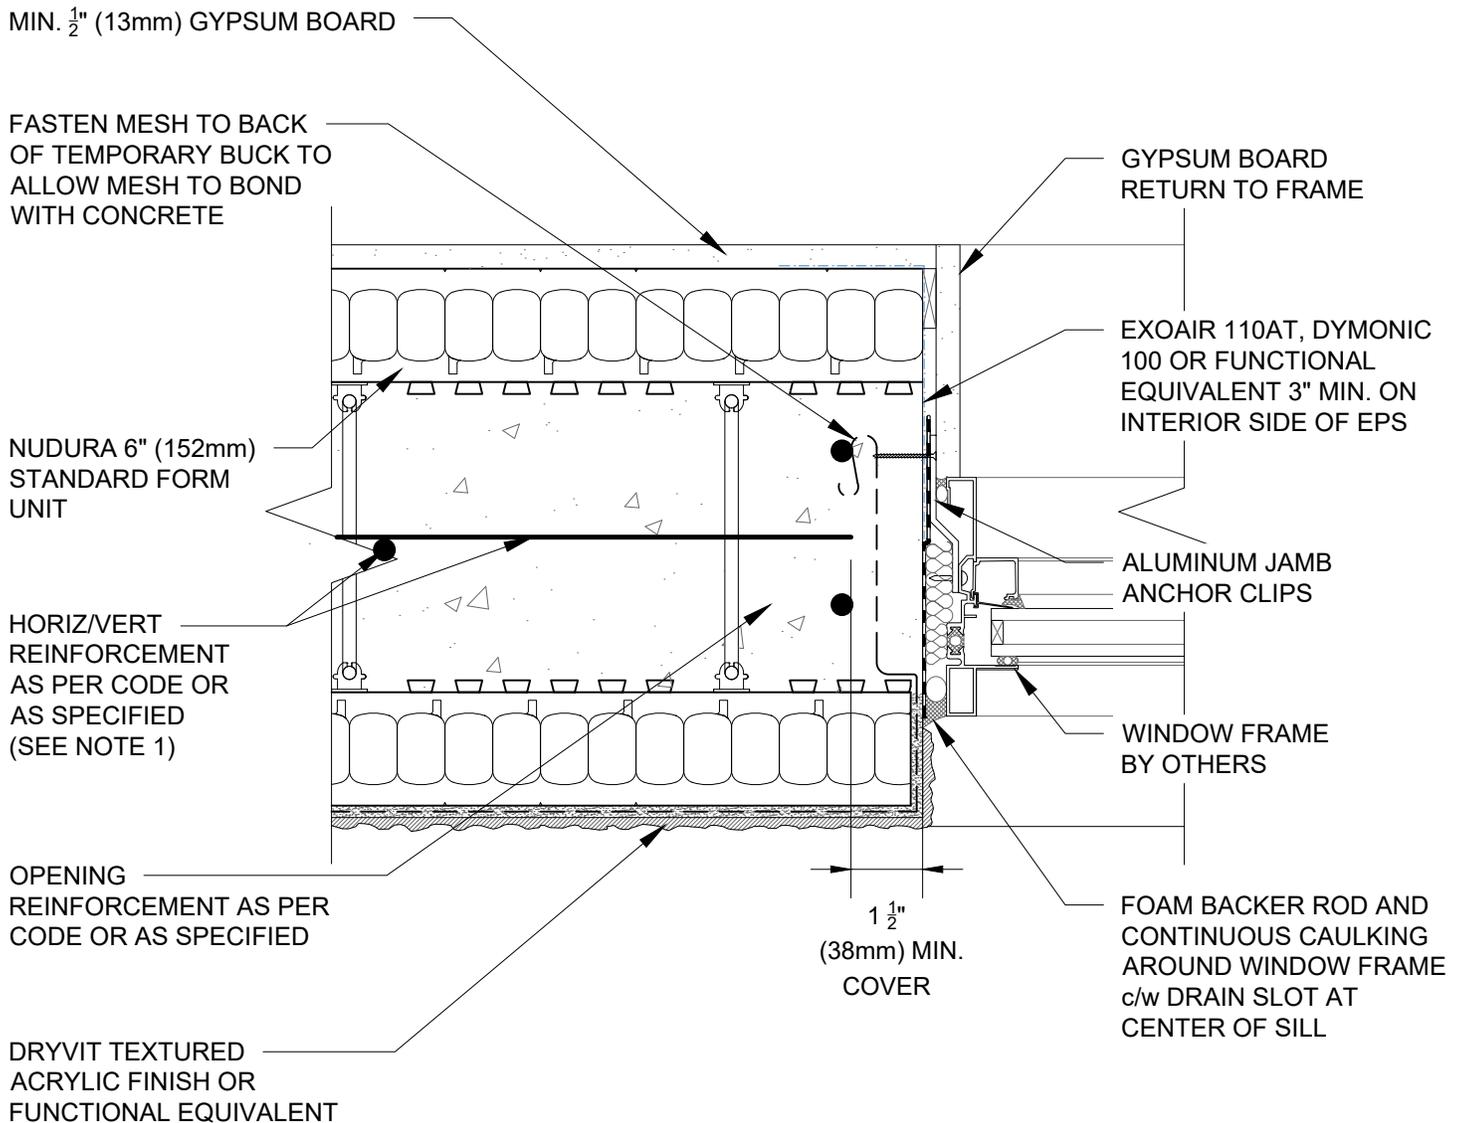

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6C06

Revision #: 01

Revised by: KAB

Date: 3/13/2024



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

NUDURA 6" (152mm)  
STANDARD FORM UNIT

MIN. 1/2" (13mm)  
GYPSUM BOARD

DRYVIT TEXTURED  
ACRYLIC FINISH OR  
FUNCTIONAL  
EQUIVALENT

HORIZ/VERT  
REINFORCEMENT AS PER  
CODE OR AS SPECIFIED  
(SEE NOTE 1)

FOR MULTI-STOREY  
APPLICATIONS, MESH  
TO LAP BACK AROUND  
BUCK TO LINK w/  
CONCRETE

LINTEL REINFORCEMENT  
AS PER CODE OR AS  
SPECIFIED

DECORATIVE EPS FOAM  
TRIM APPLIED TO  
NUDURA FORM USING  
EPS COMPATIBLE  
ADHESIVE

FASTEN MESH TO BUCK PRIOR  
TO PLACING BUCK AT HEAD  
CONDITION

1 1/2"  
(38mm) MIN.  
COVER

ENGINEERED FRAMING  
SYSTEM BY PREBUCK  
LLC OR FUNCTIONAL  
EQUIVALENT

FOAM BACKER ROD AND  
CONTINUOUS CAULKING  
AROUND FRAME

GYPSUM BOARD  
RETURN TO FRAME

WINDOW FRAMING  
BY OTHERS

EXOAIR 110AT, DYMONIC 100  
OR FUNCTIONAL EQUIVALENT  
3" MIN. ON INTERIOR SIDE OF  
EPS c/w FOAM ROD/CAULK OR  
SEAL TO INTERIOR EDGE OF  
FRAME

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window,  
Wood Rough Buck, Direct Applied Acrylic Finish

Drawn by: KS

Checked by: KS

Scale: 1:4

Revision #: 01

Revised by: KAB

Date: 3/13/2024


File Name:

H6D01



Construction Products Group

www.tremcocpg.com

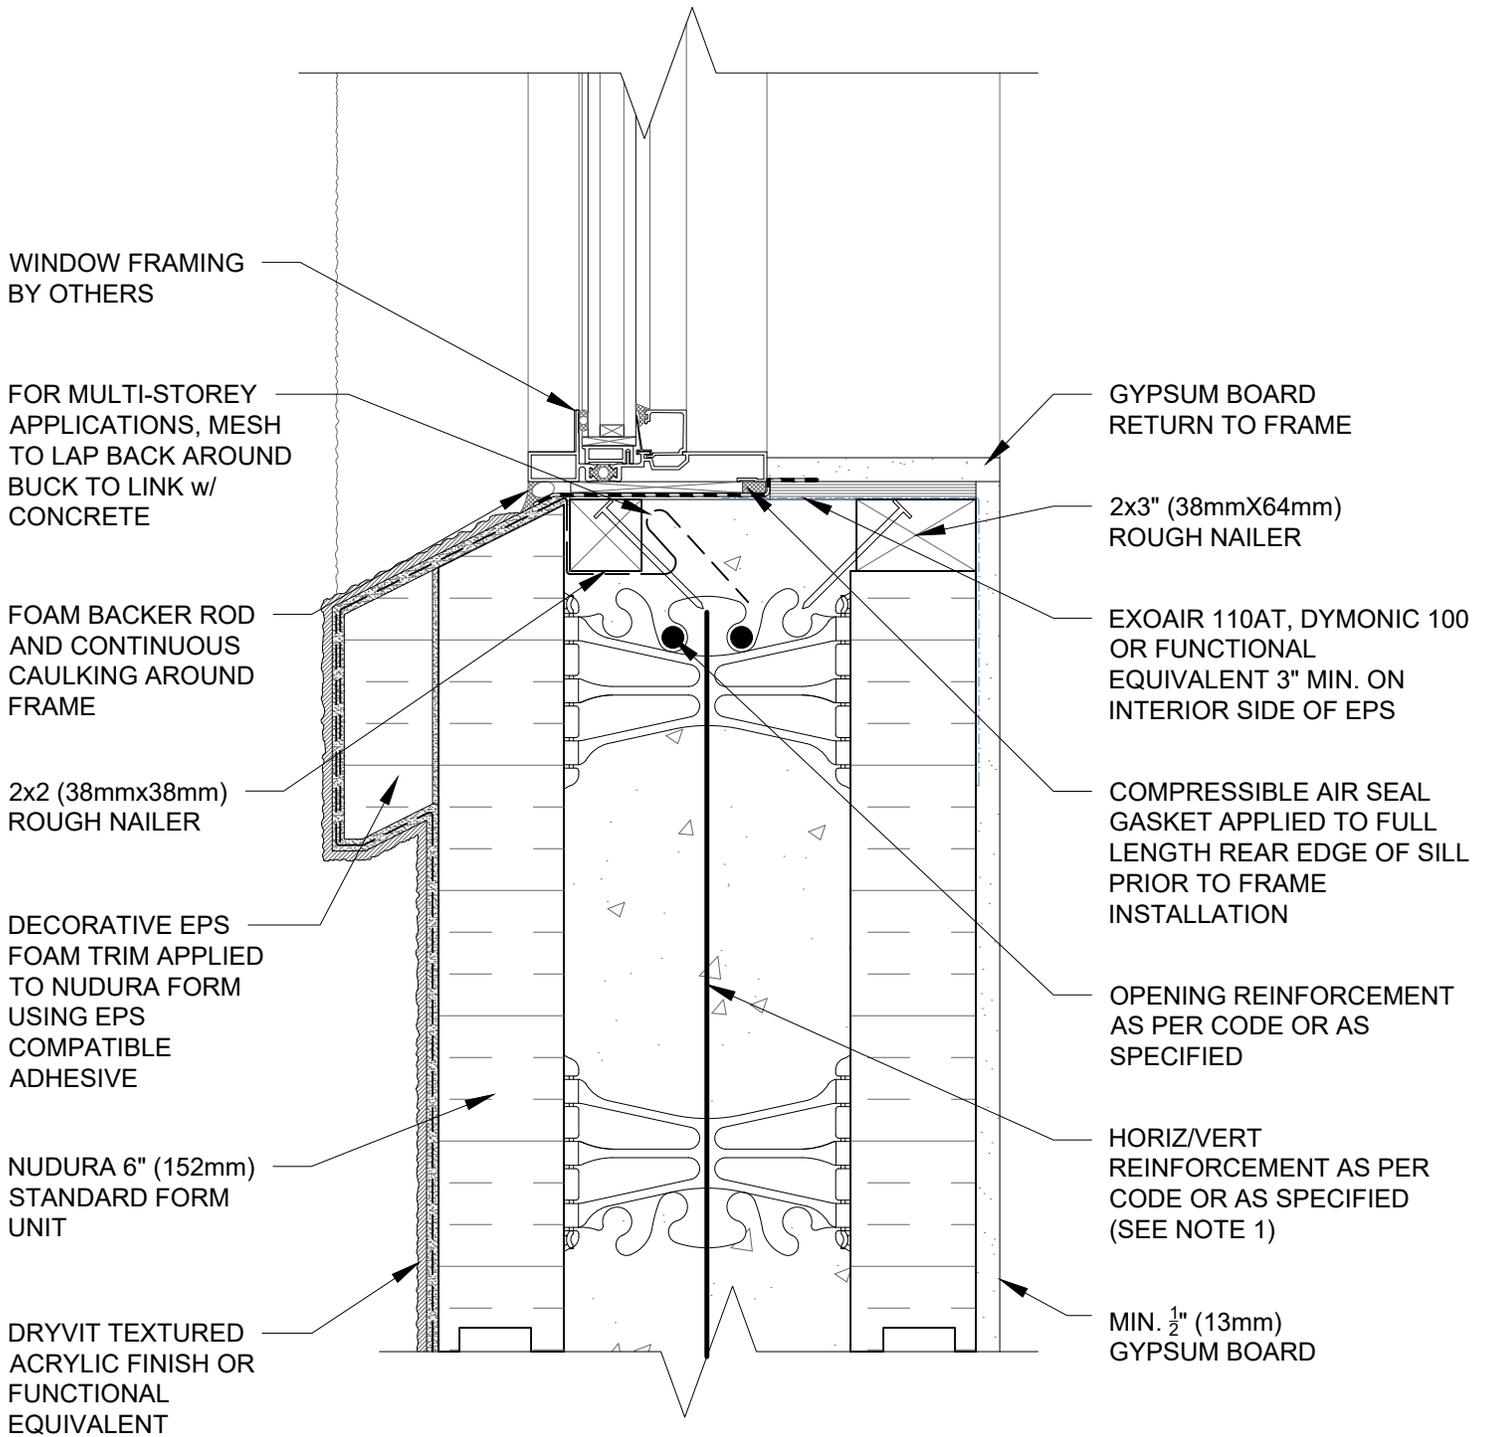

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Direct Applied Acrylic Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6D02

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

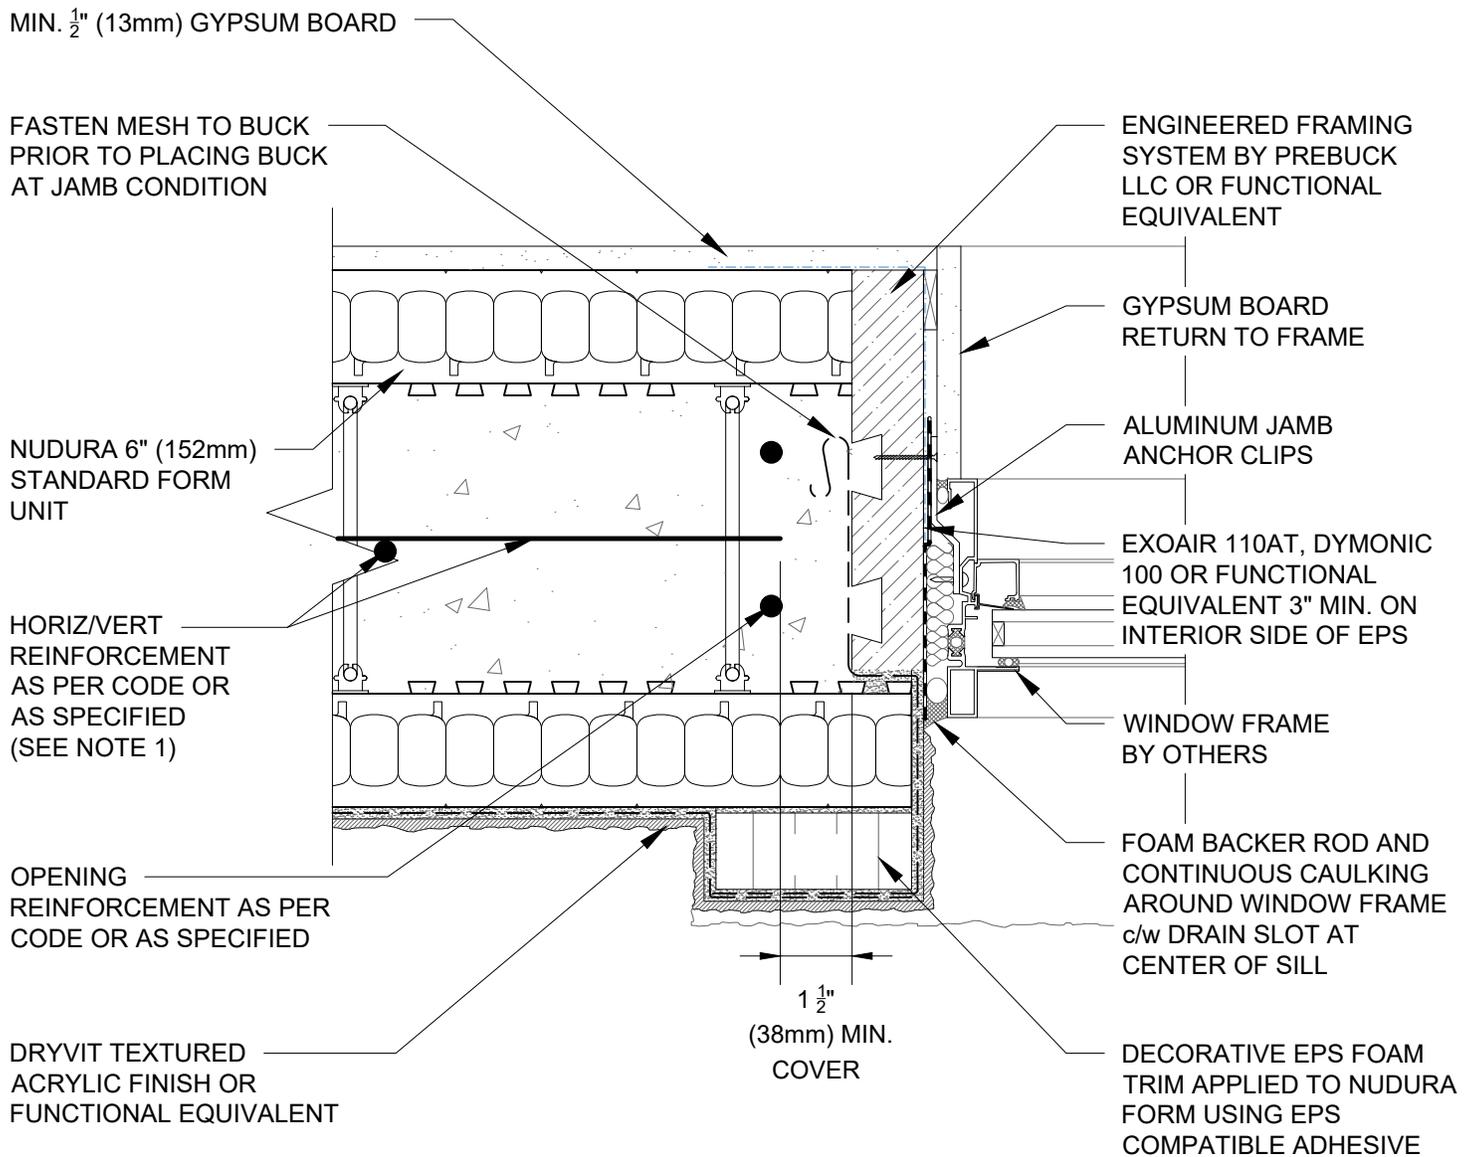

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes, only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Direct Applied Acrylic Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6D03

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

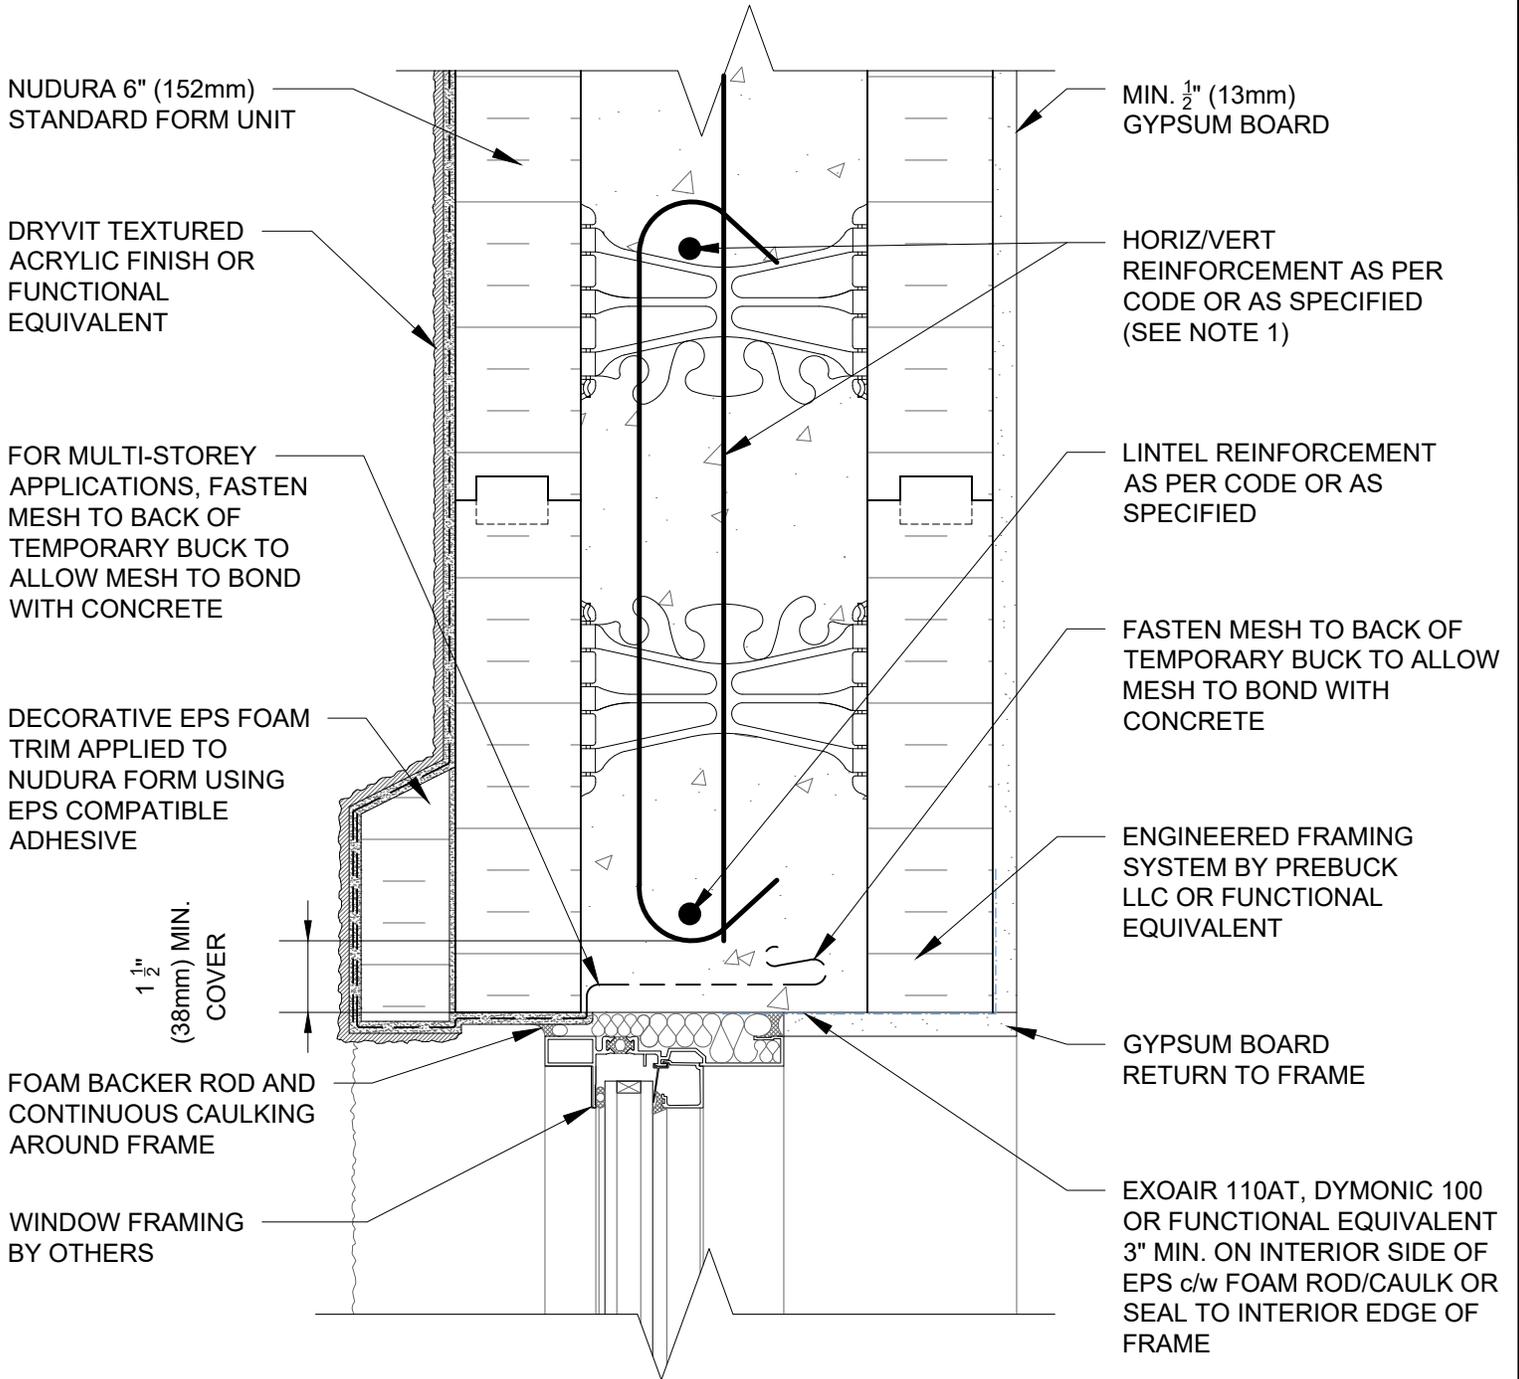

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*


**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6D04



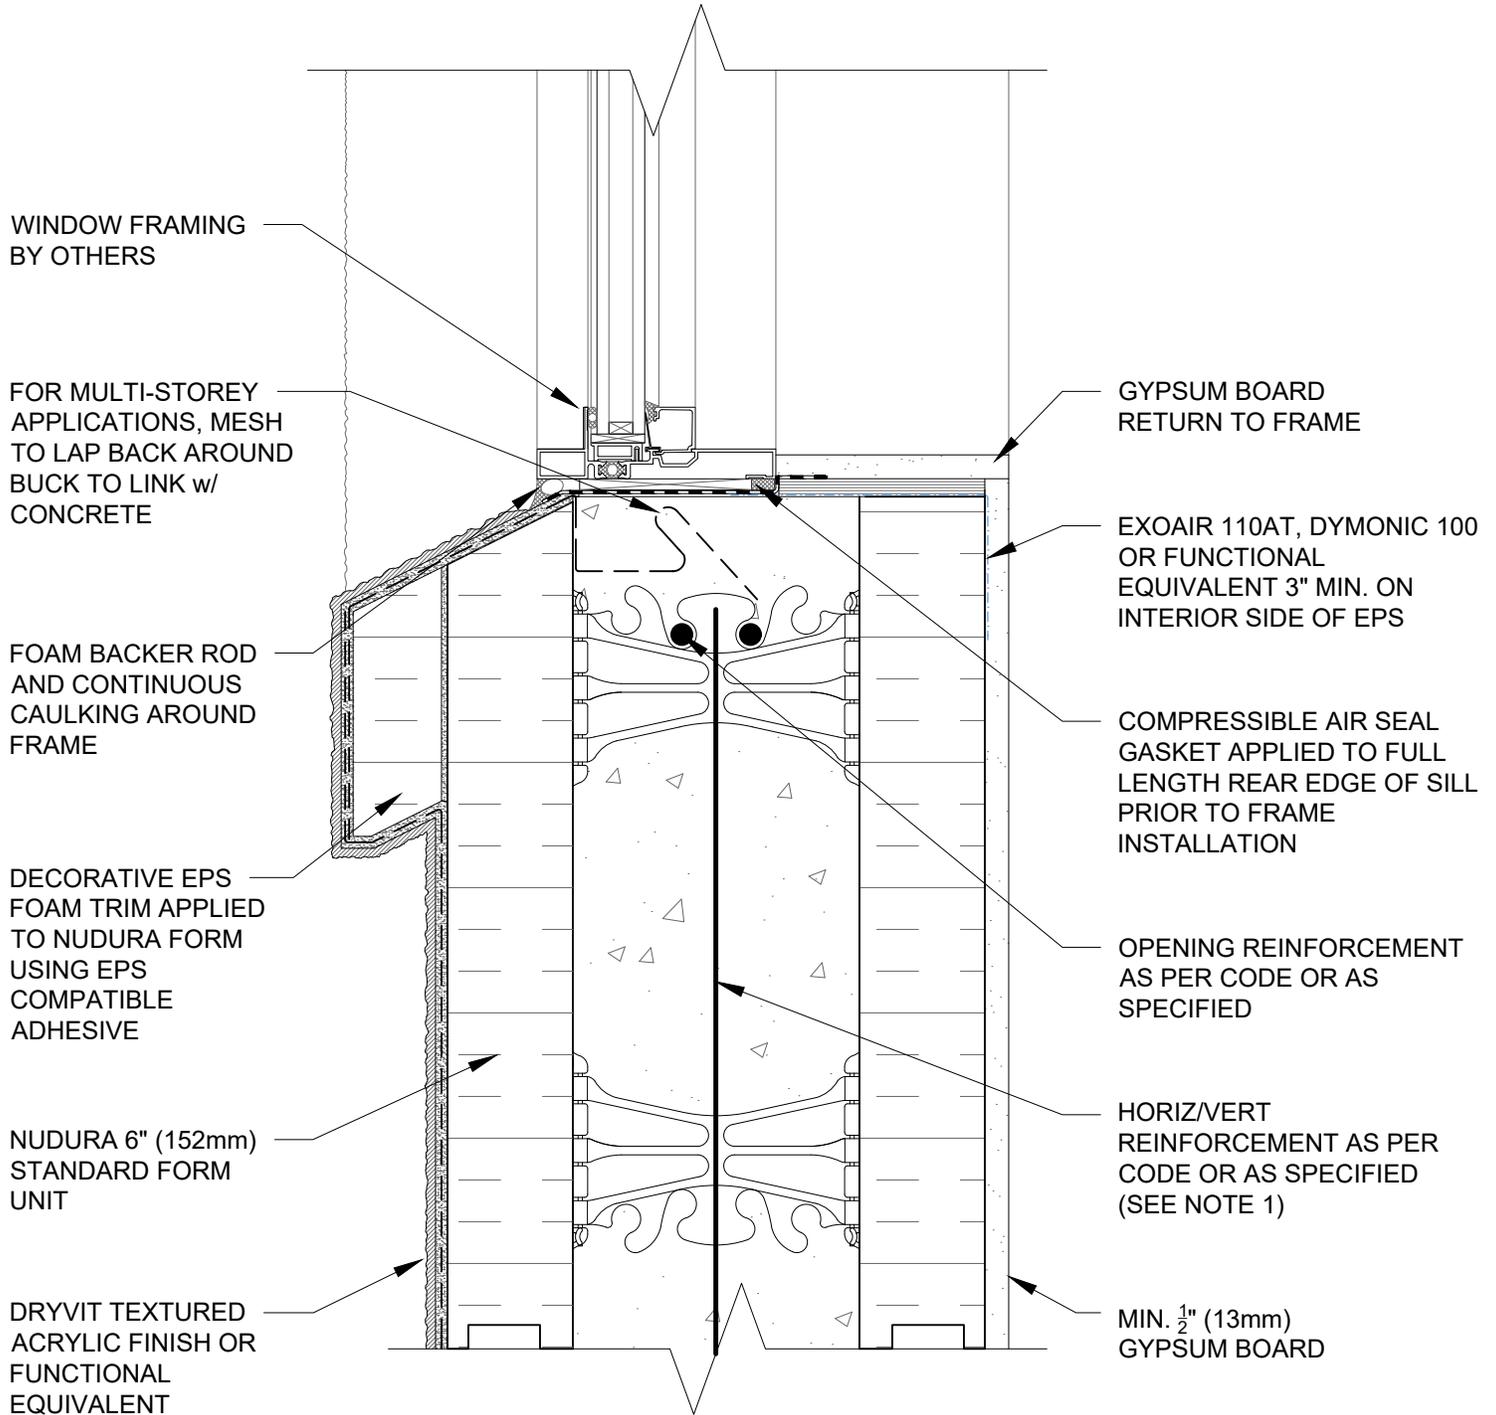

**NOTES:**

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish

Drawn by: KS

Checked by: KS

Scale: 1:4

Revision #: 01

Revised by: KAB

Date: 3/13/2024

File Name:

H6D05



MIN. 1/2" (13mm) GYPSUM BOARD

FASTEN MESH TO BACK OF TEMPORARY BUCK TO ALLOW MESH TO BOND WITH CONCRETE

NUDURA 6" (152mm) STANDARD FORM UNIT

HORIZ/VERT REINFORCEMENT AS PER CODE OR AS SPECIFIED (SEE NOTE 1)

OPENING REINFORCEMENT AS PER CODE OR AS SPECIFIED

DRYVIT TEXTURED ACRYLIC FINISH OR FUNCTIONAL EQUIVALENT

GYPSUM BOARD RETURN TO FRAME

ALUMINUM JAMB ANCHOR CLIPS

EXOAIR 110AT, DYMONIC 100 OR FUNCTIONAL EQUIVALENT 3" MIN. ON INTERIOR SIDE OF EPS

WINDOW FRAME BY OTHERS

FOAM BACKER ROD AND CONTINUOUS CAULKING AROUND WINDOW FRAME c/w DRAIN SLOT AT CENTER OF SILL

1 1/2" (38mm) MIN. COVER

DECORATIVE EPS FOAM TRIM APPLIED TO NUDURA FORM USING EPS COMPATIBLE ADHESIVE

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

Non-Combustible Construction - Windows

Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Concrete Mounted, Direct Applied Acrylic Finish

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6D06

Revision #: 01

Revised by: KAB

Date: 3/13/2024




Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

www.tremcocpg.com



Construction Products Group

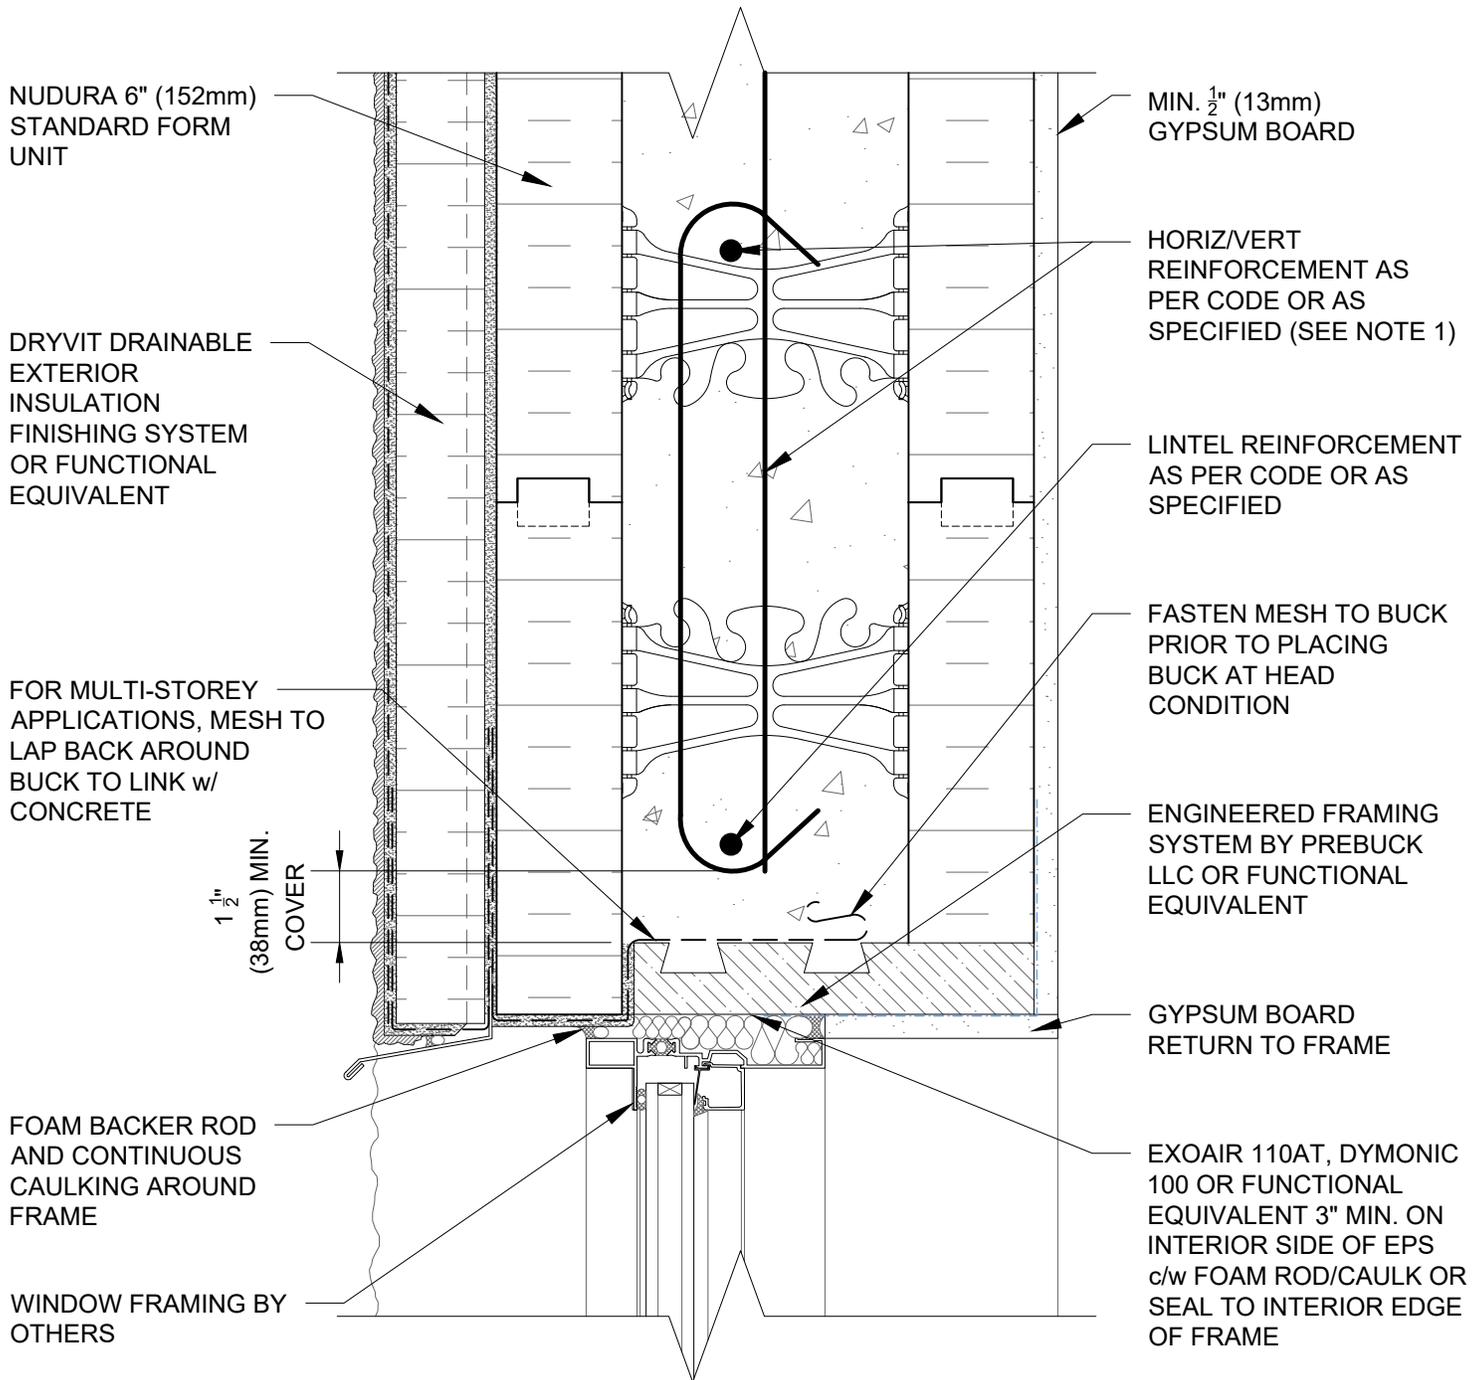

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Wood Rough Buck, Drainable EIFS		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:  
H6E01



WINDOW FRAMING  
BY OTHERS

FOR MULTI-STOREY  
APPLICATIONS, MESH  
TO LAP BACK AROUND  
BUCK TO LINK w/  
CONCRETE

FOAM BACKER ROD  
AND CONTINUOUS  
CAULKING AROUND  
FRAME

2x2 (38mmx38mm)  
ROUGH NAILER

OPENING  
REINFORCEMENT  
AS PER CODE OR  
AS SPECIFIED

NUDURA 6" (152mm)  
STANDARD FORM  
UNIT

DRYVIT DRAINABLE  
EXTERIOR INSULATION  
FINISHING SYSTEM OR  
FUNCTIONAL EQUIVALENT

GYPSUM BOARD  
RETURN TO FRAME

2x3" (38mmX64mm)  
ROUGH NAILER

EXOAIR 110AT, DYMONIC  
100 OR FUNCTIONAL  
EQUIVALENT 3" MIN. ON  
INTERIOR SIDE OF EPS

COMPRESSIBLE AIR SEAL  
GASKET APPLIED TO FULL  
LENGTH REAR EDGE OF  
SILL PRIOR TO FRAME  
INSTALLATION

HORIZ/VERT  
REINFORCEMENT AS PER  
CODE OR AS SPECIFIED  
(SEE NOTE 1)

MIN.  $\frac{1}{2}$ " (13mm)  
GYPSUM BOARD

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**

Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Drainable EIFS

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6E02

Revision #: 01

Revised by: KAB

Date: 3/13/2024



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499



Construction Products Group

www.tremcocpg.com

WINDOW FRAMING  
BY OTHERS

FOR MULTI-STOREY  
APPLICATIONS, FASTEN  
MESH TO BACK OF  
TEMPORARY BUCK TO  
ALLOW MESH TO BOND  
WITH CONCRETE

FOAM BACKER ROD  
AND CONTINUOUS  
CAULKING AROUND  
FRAME

OPENING  
REINFORCEMENT  
AS PER CODE OR  
AS SPECIFIED

NUDURA 6" (152mm)  
STANDARD FORM  
UNIT

DRYVIT DRAINABLE  
EXTERIOR INSULATION  
FINISHING SYSTEM OR  
FUNCTIONAL EQUIVALENT


GYPSUM BOARD  
RETURN TO FRAME

EXOAIR 110AT, DYMONIC  
100 OR FUNCTIONAL  
EQUIVALENT 3" MIN. ON  
INTERIOR SIDE OF EPS

COMPRESSIBLE AIR SEAL  
GASKET APPLIED TO FULL  
LENGTH REAR EDGE OF  
SILL PRIOR TO FRAME  
INSTALLATION

HORIZ/VERT  
REINFORCEMENT AS PER  
CODE OR AS SPECIFIED  
(SEE NOTE 1)

MIN. 1/2" (13mm)  
GYPSUM BOARD

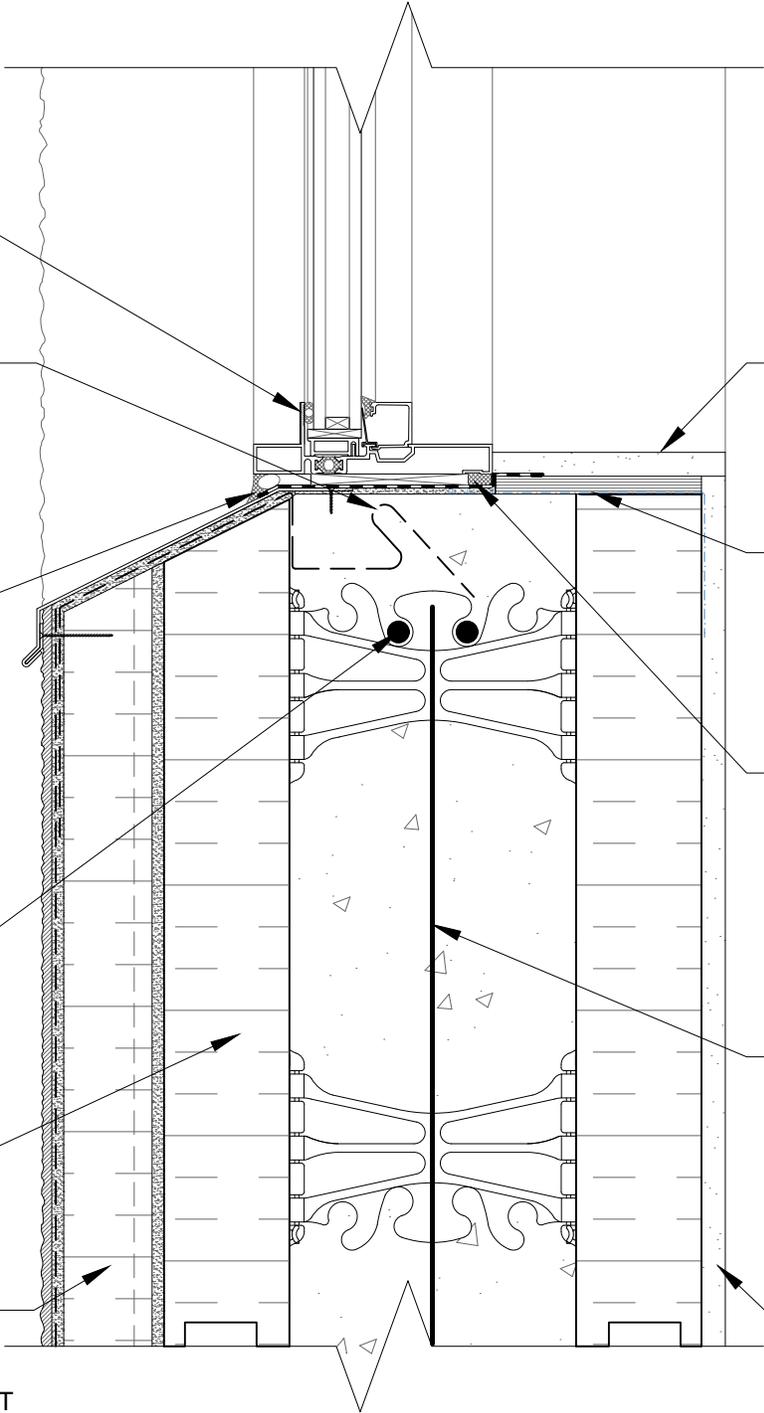

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Wood Rough Buck, Drainable EIFS		
Drawn by: KS	Checked by: KS	Scale: 1:4
Revision #: 01	Revised by: KAB	Date: 3/13/2024

File Name:	H6E03



FASTEN MESH TO BUCK PRIOR TO PLACING BUCK AT JAMB CONDITION

MIN. 1/2" (13mm) GYPSUM BOARD

HORIZ/VERT REINFORCEMENT AS PER CODE OR AS SPECIFIED (SEE NOTE 1)

OPENING REINFORCEMENT AS PER CODE OR AS SPECIFIED

DRYVIT DRAINABLE EXTERIOR INSULATION FINISHING SYSTEM OR FUNCTIONAL EQUIVALENT

ENGINEERED FRAMING SYSTEM BY PREBUCK LLC OR FUNCTIONAL EQUIVALENT

GYPSUM BOARD RETURN TO FRAME

ALUMINUM JAMB ANCHOR CLIPS

EXOAIR 110AT, DYMONIC 100 OR FUNCTIONAL EQUIVALENT 3" MIN. ON INTERIOR SIDE OF EPS

WINDOW FRAME BY OTHERS

FOAM BACKER ROD AND CONTINUOUS CAULKING AROUND WINDOW FRAME c/w DRAIN SLOT AT CENTER OF SILL

1 1/2" (38mm) MIN. COVER

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**

Detail: Nudura 6" (152mm) Form Unit, Window Jamb, Aluminum Framed Window, Wood Rough Buck, Drainable EIFS			File Name:
Drawn by: KS	Checked by: KS	Scale: 1:4	H6E04
Revision #: 01	Revised by: KAB	Date: 3/13/2024	



NUDURA 6" (152mm)  
STANDARD FORM  
UNIT

MIN. 1/2" (13mm)  
GYPSUM BOARD

DRYVIT DRAINABLE  
EXTERIOR  
INSULATION  
FINISHING SYSTEM  
OR FUNCTIONAL  
EQUIVALENT

HORIZ/VERT  
REINFORCEMENT AS  
PER CODE OR AS  
SPECIFIED (SEE NOTE 1)

FOR MULTI-STOREY  
APPLICATIONS, FASTEN  
MESH TO BACK OF  
TEMPORARY BUCK TO  
ALLOW MESH TO BOND  
WITH CONCRETE

LINTEL REINFORCEMENT  
AS PER CODE OR AS  
SPECIFIED

FASTEN MESH TO BUCK  
PRIOR TO PLACING  
BUCK AT HEAD  
CONDITION

1 1/2"  
(38mm) MIN.  
COVER

GYPSUM BOARD  
RETURN TO FRAME

FOAM BACKER ROD  
AND CONTINUOUS  
CAULKING AROUND  
FRAME

EXOAIR 110AT, DYMONIC  
100 OR FUNCTIONAL  
EQUIVALENT 3" MIN. ON  
INTERIOR SIDE OF EPS  
c/w FOAM ROD/CAULK OR  
SEAL TO INTERIOR EDGE  
OF FRAME

WINDOW FRAMING BY  
OTHERS

NOTES:

1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.

2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

**Non-Combustible Construction - Windows**



Nudura Technical Support: 866-468-6299  
International: +1 705-726-9499

Detail: Nudura 6" (152mm) Form Unit, Window Head, Aluminum Framed Window, Concrete Mounted, Drainable EIFS

Drawn by: KS

Checked by: KS

Scale: 1:4

Revision #: 01

Revised by: KAB

Date: 3/13/2024


File Name:

H6E05



Construction Products Group

www.tremcocpg.com

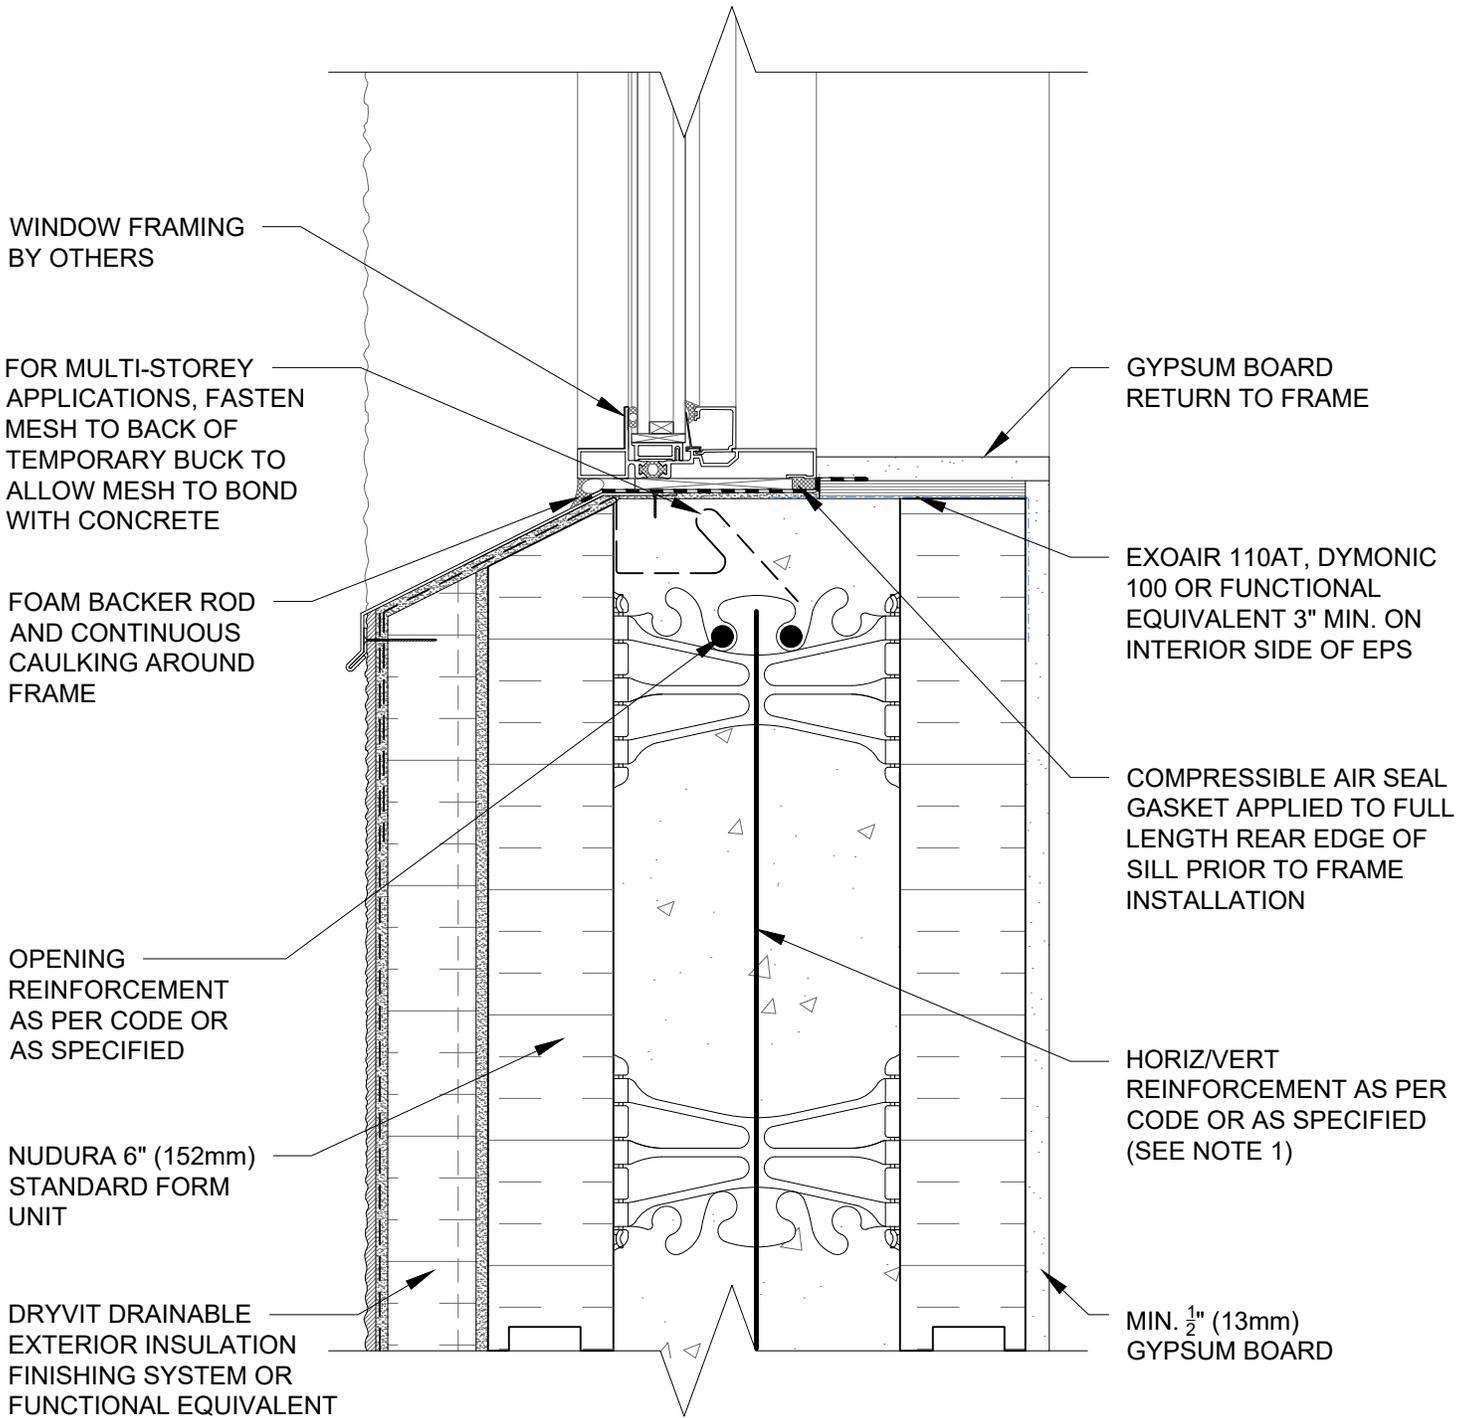

- NOTES:
- 1) FOR OPTIMAL REINFORCEMENT PLACEMENT IN THE NUDURA FORM, SPACING OF HORIZONTAL REINFORCEMENT TO BE SPECIFIED AT 18" (457mm) O.C. AND VERTICAL REINFORCEMENT TO BE SPECIFIED AT MULTIPLES OF 8" (203mm) O.C. REFER TO NUDURA REINFORCEMENT PLACEMENT DETAILS.
  - 2) AIR BARRIER/DRAINAGE FLASHINGS TO BE INSTALLED AROUND COMPLETE OPENING PERIMETER AS PER TREMCO/NUDURA APPLICATION INSTRUCTIONS OR AS DETAILED BY LOCAL APPLICABLE CODES (CODE GOVERNS)

*This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. and Prebuck, LLC from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco and Prebuck to ensure you have the most recent version.*

### Non-Combustible Construction - Windows



Detail: Nudura 6" (152mm) Form Unit, Window Sill, Aluminum Framed Window, Concrete Mounted, Drainable EIFS

File Name:

Drawn by: KS

Checked by: KS

Scale: 1:4

H6E07

Revision #: 01

Revised by: KAB

Date: 3/13/2024

www.tremcocpg.com

